

VILLAGE OF EPHRAIM

FOUNDED 1853



Wastewater Committee Agenda
Wednesday, December 13, 2023, 10:00 AM
Village Hall 9996 Water Street

NOTE: This Meeting of the Village Wastewater Committee will also be held via teleconferencing. It will be available to the public to attend in person or by computer, phone, tablet, or dial-in. Connection information is included below in this notice.

1. Call to order
2. Changes in Agenda
3. Previous minutes November 6, 2023
4. Visitors' comments
5. Ephraim Wastewater Operator in Charge Report.
6. Discussion and recommendation regarding future projects with McMahon Engineering.
7. Visitors' comments
8. New business for next meeting
9. Adjournment

WW Committee Meeting

Dec 13, 2023, 10:00 AM – 12:00 PM (America/Chicago)

Please join my meeting from your computer, tablet or smartphone.

<https://meet.goto.com/928958085>

You can also dial in using your phone.

Access Code: 928-958-085

United States: [+1 \(872\) 240-3212](tel:+18722403212)

**It is possible that a quorum of the Village Board or other Village Committees may be present at the meeting. However, no action will be taken by any other Board or Committee unless specifically noticed.*

Andrea Collak, Clerk

Kim Roberts, Deputy Clerk

Date 12/11/2023

Village Administrative Office

Visitors' Center

Post Office

Website www.ephraim-wisconsin.com

Emailed to WDOR/Peninsula Pulse

VILLAGE OF EPHRAIM

FOUNDED 1853



Wastewater Committee Minutes Monday, November 6, 2023, 9:00 AM

Present: Karen McMurtry- Chair, Bruce Nelson, Jim Peterman, Dennis Jewell

Absent: Michael McCutcheon

Staff: Brad Rasmusson – Wastewater Manager/Operator in Charge, Brent Bristol-Administrator
Andrea Collak – Clerk/Treasurer, Dan Oakley – Operator in Charge

1. **Call to order:** The meeting was called to order by Chair - McMurtry and a quorum was present for this meeting.
2. **Changes in Agenda:** None
3. **Previous minutes – Minutes from October 2, 2023**

Peterman moved, McMurtry seconded to approve October 2, 2023, meeting minutes as presented, all eyes, and the motion carried.

4. **Visitors' comments:** None
5. **Ephraim Wastewater Operator in Charge Report:** Rasmusson reviewed the WW, WWT, and SS OIC reports as included in the agenda packet. Wastewater duties were completed according to schedule.

September 29, Rasmusson took and passed the WW collection systems exam. Last subclass he needed as of now.

October 4, UV system removed, cleaned, and stored for the season (November – May).

October 9, delivery of 3,500 gallons of aluminum sulfate for phosphorus removal.

October 11, ammonia/arsenic test was sent out. Rasmusson ordered the new WW service vehicle.

October 19, EDMR was submitted.

October 24, the annual required sludge characteristics test was sent out.

On October 26, while performing a confined space entry into the west aeration basin to replace two broken diffusers, they found some of the brackets, that hold the main influent 10” pipe, are rotten away and in need of repair. They have a call into Lee’s Welding. Jay will be coming up next week to look at and quote.

The month of October 2023:

There were 104 in-house bacteria tests completed, 116 water tests (905 for the year so far), and 12 clean water tests. 8 holding tank pump-outs and 7 septic pump-outs/problems. There were no emergency call-ins.

6. **Discussion and recommendation regarding UV disinfection system rebuild:**
Rasmusson reported that the Ironbrook UV has provided us with a quote for a complete refurbishment/rebuild of the UV system. The system is 26 years old; they believe it would go another 25 years with this work completed. They would come on-site, remove, package, and ship the whole system back to their facility in Canada. They would rebuild the system and come back to reinstall it.

The UV system is in the needs assessment provided by McMahan. Tony's recommendation was to replace the system and relocate the cabinet out of the tank room.

Jamie at Ironbrook is good to work with and having a system that we know works well has always kept us within our limits of everything is operating correctly. Rasmusson thinks that having the system rebuilt would be very beneficial for the plant and would be a good start to the system upgrades. Rasmusson presented the committee with the quote of \$32,010.00 and breakdown of all parts. The money would come out of the replacement fund. The UV disinfection system will be back on May 1, 2024.

Committee members had no issues with the proposed plan.

Peterman moved, Jewell seconded to approve the refurbishment of UV disinfection system, and pass it onto the Village Board, all ayes and the motion carried.

7. **Visitors' comments:** None
8. **New business for the next meeting:** Updates on projects. Next steps from McMahan. The next meeting is Monday, December 4th, 2023, at 9:00 AM.
9. **Adjournment**

McMurtry moved, Nelson seconded to adjourn the meeting, all ayes, and the motion carried.

Recorded by,
Andrea Collak- Clerk/Treasurer

11/1 to 12/7/2023
Ephraim WW, WWT, SS
Manager OIC Report



Po4 lab setup-complete with lab cleanup:

EFF samples sent to Pace Analytical LLC for EFF arsenic/ammonia testing:

Ph testing: Five times per week as required.

TSS, BOD labs with lab cleanup: Twice per week as required.

11-3 Dan completed the annual thermometer calibration.

11-9 Took down the west clarifier for the season, while doing so we found that one of the grease lines attached to the wall let loose causing damage to the flights and possibly the lower bearing. Sable Mechanical will be coming up soon to look at this being that they installed the lines last September.

11-14 New influent pipe brackets installed in the west basin by Lee's Contracting.

11-15 Greased roof exhaust fans and changed belts. Installed new grinder lid on Diekman grinder now has a quick connect to avoid removing the lid every time we dump water

11-17 EDMR submitted.

11-21 Hauled out 6 loads of sludge. Had the annual sludge characteristics test performed by Northern Lake Services, and everything tested within our parameters.

11-26 Plowed streets with Justin.

12-7 Redirected flows to the west basin and transferred the east basin to the west in preparation for Lee's to continue changing rotten brackets.

Ephraim Well Water Testing:

Number of Water Tests: 67

In House Bacteria: 67 973 for the year so far

Clean Water Testing: 0

Ephraim Septage Service:

Holding Tank Pump Outs: 4 We had two new customers sign up with us.

Septic Pump Outs: 0

Emergency Call Ins: 0

Weather:

Precip: 0.96 inches rain/snow

Snow: 2 inches

Max Temp: 56

Min Temp: 14

Respectfully submitted,
Brad Rasmuson

Village of Ephraim
Wastewater Manager

Facility Plan Amendment

Wastewater Collection & Treatment System

Prepared for



VILLAGE OF EPHRAIM

DOOR COUNTY, WISCONSIN

McMAHON
ENGINEERS ARCHITECTS

DECEMBER 2023

McMAHON ASSOCIATES, INC.

1445 McMAHON DRIVE NEENAH, WI 54956 Mailing: PO BOX 1025 NEENAH, WI 54957-1025 PH 920.751.4200 MCMGRP.COM

McM. No. E0035-09-22-00363.04 / ESL:jlh

Facility Plan Amendment

Wastewater Collection & Treatment System

Prepared for



VILLAGE OF EPHRAIM

DOOR COUNTY, WISCONSIN

DECEMBER 2023

McM. No. E0035-09-22-00363.04

TABLE OF CONTENTS

CHAPTER I	INTRODUCTION
CHAPTER II	WATER QUALITY OBJECTIVES
	A. Federal Background
	B. Sanitary Sewer System Overflows
	C. WI Administrative Code Revisions
	D. Sludge Regulations
	E. WI Water Quality Objectives
	F. Current Effluent Requirements
CHAPTER III	CURRENT SITUATION & NEEDS ASSESSMENT
	A. Current Influent Flows & Loadings
	B. WPDES Permit Limits
	C. WWTF Performance
	D. Needs Assessment
CHAPTER IV	FUTURE CONDITIONS
	A. Background
	B. Planning Period
	C. Design Period
	D. Population Projections
	E. Current WWTF Flows & Loadings
	F. WWTF Design Flows & Loadings
	G. Staging Analysis
	H. Future Effluent Limitations
CHAPTER V	INFILTRATION & INFLOW (I/I) ANALYSIS
	A. Background
	B. Infiltration/Inflow Analysis
	C. Addressing Infiltration/Inflow

TABLE OF CONTENTS (continued)

CHAPTER VI ALTERNATIVES EVALUATION & PRELIMINARY SCREENING

- A. Introduction
- B. 'No Action' Alternative
- C. Regional Treatment Alternative
- D. Wastewater Collection & Treatment Facilities Improvements

CHAPTER VII ENVIRONMENTAL ASSESSMENT

CHAPTER VIII OPINIONS OF PROBABLE COST

CHAPTER IX RECOMMENDED PLAN

FIGURES

- Figure #1 WWTF Site Plan
- Figure #2 WWTF Flow Schematic

TABLES

- Table #1 Summary of Influent Flows & Loadings - 2018 through 2023
- Table #2 Current Influent Flows & Loadings vs. Design Criteria
- Table #3 Summary of Effluent Flows & Loadings - 2018 through 2023
- Table #4 Summary of Influent Flows & Loadings - Collection System - 2018 through 2023
- Table #5 Summary of Hauled-In Waste Flows & Loadings - 2018 through 2023
- Table #6 Projected Future Flows & Loadings vs. Design Criteria

APPENDICES

- Appendix #1 WPDES Permit
- Appendix #2 WWTF Influent Flows & Loadings and Plant Performance Data Tables
- Appendix #3 Effluent Limits Request Correspondence
- Appendix #4 Infiltration / Inflow (I/I) Analysis
- Appendix #5 Destination Door County Executive Summary, September 2022

Chapter I Introduction

The Village of Ephraim, Door County, Wisconsin, owns and operates a wastewater collection system and Wastewater Treatment Facility (WWTF), located at 10285 Town Line Drive, Ephraim, Wisconsin, which currently serve a residential population of approximately 350 and a seasonal tourist population. The treatment facility also accepts approximately 1.0 million gallons (MG) of septage and holding tank waste from surrounding areas each year. There are no industrial wastewater contributors to the system.

Most of the Village is served by a gravity sanitary sewer collection system, originally constructed 1986, and two (2) sewage lift stations, one (1) at the public beach (Lift Station #1) and the other at the intersection of Spruce Street and Water Street (Lift Station #2), which accepts and pumps most of the Village's wastewater in an 8-inch force main to a newer section of gravity sewer on STH 42 flowing directly to the WWTF. Additional sanitary sewers and a WWTF on-site lift station were constructed in 2005 to serve the areas along STH 42 and Town Line Road near the WWTF. Properties along the bluff on the north (North Shore Road) and south (Crystal Springs Road) ends of the collection system are served by individual grinder pump stations and common low pressure sewer systems, which connect to the main collection system.

The WWTF, which was originally constructed in 1986, generally includes the following major unit processes:

- Hauled-In Waste Receiving, Holding Tanks, and Pumping
- Raw Wastewater Pumping
- Fine Screening
- Vortex Grit Removal
- Conventional Activated Sludge Secondary Treatment
 - ▶ Two (2) Aeration Basins With Fine Bubble Diffusers
 - ▶ Two (2) Rectangular Shaped Final Clarifiers
 - ▶ Chemical Addition For Phosphorus Removal
- Ultraviolet Disinfection
- Effluent Pumping
- Aerated Sludge Holding Tanks and Loadout

An overall WWTF Site Layout is shown in Figure #1. A WWTF Process Flow Schematic is provided in Figure #2.

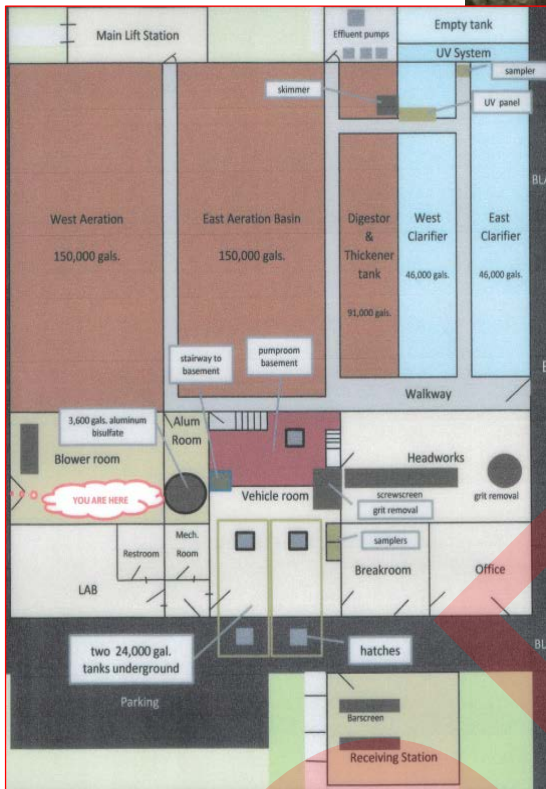


FIGURE #1
WWTF SITE PLAN



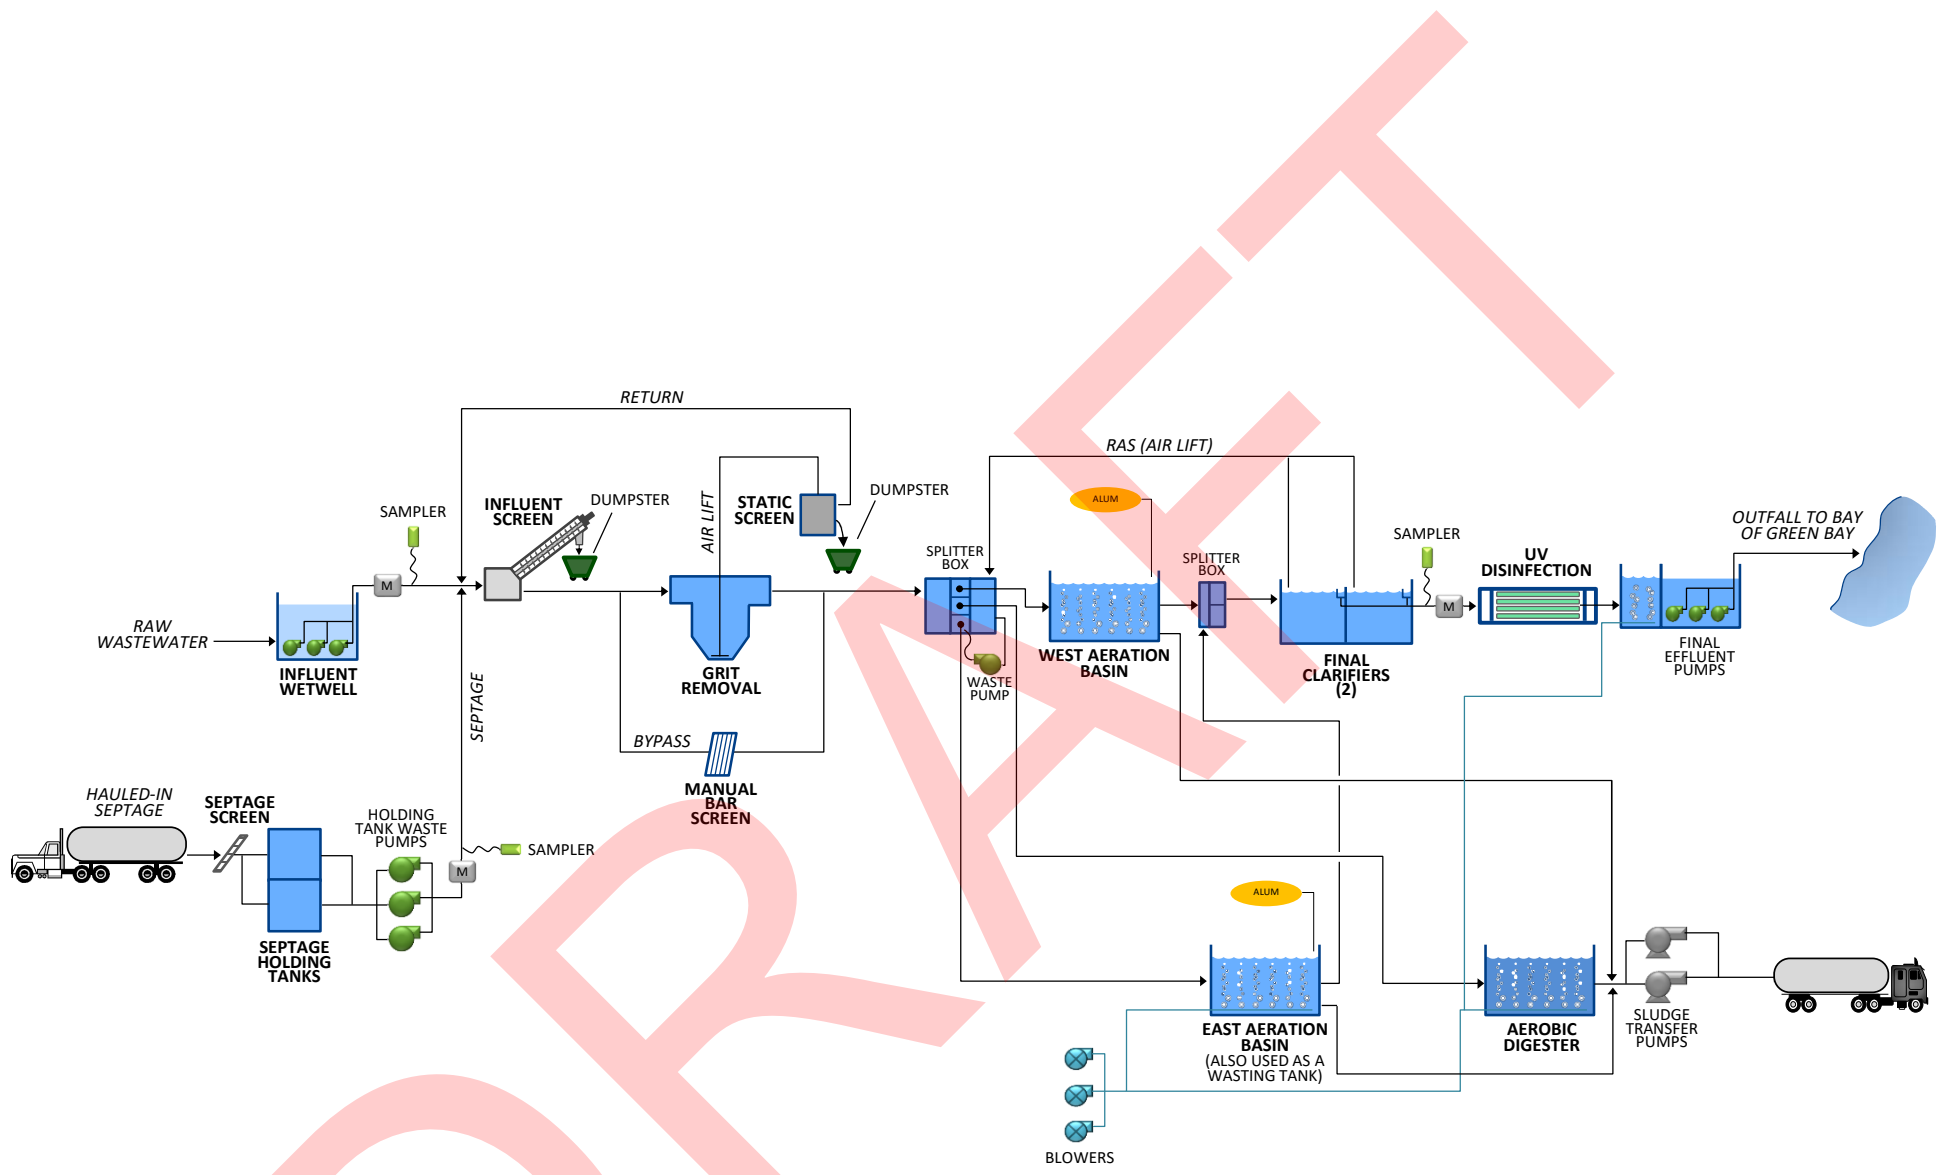


FIGURE #2
WWTF FLOW SCHEMATIC

**WASTEWATER TREATMENT FACILITIES PLAN AMENDMENT
 VILLAGE OF EPHRAIM, WI**

McM #E0035-9-22-00363.04 12/5/2023
 ID: \2023\MCM WIS\EPHRAIM, VILL OF- WWTF PROCESS FLOW SCHEMATIC.PPTX ESL

The original WWTF influent design criteria are summarized below.

Design Flows & Loadings	Peak Season	Off-Season
Flow, gpd		
Average	0.31	0.0827
Maximum Day	0.62	0.1654
BOD, lbs./day		
Average	1,400	300
Maximum Day	2,100	600
TSS, lbs./day		
Average	1,200	250
Maximum Day	1,800	500
Total P, lbs./day		
Average	48	10
Maximum Day	72	20

Peak season is assumed to be the period from May through October, while the off-season is assumed to be November through April.

Raw wastewater received at the WWTF is pumped from the influent lift station to the Headworks of the WWTF using three (3) submersible pumps. The raw wastewater is metered and sampled prior to being discharged in the Headworks. Hauled-in septage and holding tank waste is screened before discharging into two (2) holding tanks. Three (3) positive displacement pumps transfer the hauled-in waste to the screening and grit removal process in the Headworks Room.

After screening and grit removal, the raw wastewater flows by gravity through a splitter box to the activated sludge secondary treatment system, which consists primarily of two (2) rectangular aeration basins and two (2) rectangular final clarifiers. Alum is added to the Mixed Liquor Suspended Solids (MLSS) between the aeration basins and final clarifiers for chemical Phosphorus (P) reduction. Return Activated Sludge (RAS) is recycled back to the aeration basin splitter box via air lift pumps.

During disinfection season (May through September) effluent from the final clarifiers is treated via UV disinfection prior to discharge. Following disinfection, effluent flows through a reaeration channel to the effluent wet well. Three (3) final submersible effluent pumps transfer treated effluent to the outfall in Lake Michigan's Green Bay.

A portion of the RAS flow is pumped as Waste Activated Sludge (WAS) with a submersible pump to one of the aeration basins that is not currently used for treatment. The WAS is aerated and eventually transferred to the adjacent aerobic digester tank. The WAS is occasionally thickened in the aerated sludge holding tank and eventually hauled to the Sturgeon Bay Utilities WWTF for further treatment and disposal.

Chapter II

Water Quality Objectives

A. FEDERAL BACKGROUND

During the past five decades, major Federal legislation has been enacted in an effort to alleviate the pollution of the Nation's waters. The basic Federal Water Pollution Control Legislation is Public Law (PL 84-660), approved July 9, 1956, which has been amended by: 1) The Federal Water Pollution Control Act Amendment Of 1961 (PL 87-88); 2) The Water Quality Act Of 1965 (PL 89-234); 3) The Federal Water Pollution Control Act Amendment Of 1972 (PL 92-500); 4) The Clean Water Act Of 1977 (PL 95-217), with amendments in 1981; and 5) The Water Quality Act Of 1987.

The Water Quality Act of 1965 required each State adopt water quality criteria applicable to interstate waters or portions thereof within the State, and adopt a plan for implementing and enforcing those criteria. It was soon found that the water quality standards were difficult, if not impossible, to enforce from an administrative viewpoint. The 1972 Federal Amendments sought to correct this situation by establishing restrictions for municipalities, based upon the concentration of certain pollutants in their wastewater. If these guidelines were found to be insufficient to ensure water quality criteria adopted under the 1965 Amendments, further treatment of wastes would be required to achieve the applicable standards.

The Federal Water Pollution Control Act Amendments of 1972 (PL 92-500) replaced the previous language of Act (PL 84-660) and its amendments entirely. The 1977 Amendments to the Clean Water Act (PL 95-217) includes, in part, as its declared goals:

1. To restore and maintain the chemical, physical and biological integrity of the Nation's waters by:
 - a. Eliminating the discharge of pollutants into navigable waters by 1985.
 - b. Attaining, where possible, an interim goal of water quality, which provides for the protection and propagation of fish, shellfish and wildlife, and provides for recreation in and on the water, be achieved by July 1, 1983.
 - c. Prohibiting the discharge of toxic pollutants in toxic amounts.
2. To recognize, preserve and protect the primary responsibilities and rights of States to reduce and eliminate pollution, to plan and use (including restoration, preservation and enhancement) land and water resources.¹

Although substantial progress has been made since passage of PL 92-500 and the 1987 Amendments, nevertheless, many waterways (notably marine estuaries, lakes and rivers in heavily populated areas) still suffer from degradation. In amending the Clean Water Act of 1987, the basic issue lawmakers had to confront was that, after most technology standards called for in the 1970's

¹ Clean Water Act, as amended.

had been issued and the final push to get cities to provide a minimum of secondary treatment for sewage was at hand, some stubborn water pollution problems still remained. The most serious of these remaining problems are excessive levels of toxic pollutants in some waters (even where discharges have installed required pollution control technologies) and contained in runoff from 'non-point' sources, such as farmland and city streets.

The Water Quality Act of 1987 sought to correct these problems. The Amendments direct the Environmental Protection Agency (EPA) and State officials to supplement existing, nationwide technology-based standards with a water-quality-based approach to control persistent pollution problems. Essentially, Congress said regulators should identify waterways that are still polluted and do what is needed to restore them.

In other key changes, the Amendments:

1. Require permits for all discharges of stormwater from industrial facilities, and set deadlines for cities to obtain permits for stormwater discharges.
2. Limit the ability of industrial facilities to get exemptions or 'variances' from Federal pollution control regulations.
3. Prohibit, except in certain, narrowly-defined circumstances, 'backsliding' on permits or the weakening of treatment requirements when industrial and municipal discharge permits are renewed or reissued.
4. Extend deadlines for industries to comply with national pollution control standards to account for the fact that the EPA has not finished issuing some of these regulations.
5. Specify deadlines for the EPA to issue remaining, needed industrial effluent limitations.
6. Require the EPA to promulgate regulations to control toxic pollutants in sewage sludge.
7. Limit availability of modifications of Federal treatment standards for non-conventional pollutants for five well understood substances.

Recent Federal regulations have dealt with sludge management and toxins affecting the Great Lakes.

40 CFR, Part 503, sets standards for the use or disposal of sewage sludge. These regulations set metals limits, establish pathogen reduction standards and establish vector attraction reduction standards for sludge being land applied. The Wisconsin Department of Natural Resources (DNR) administers these regulations through the Wisconsin Administrative Code, NR 204.

40 CFR, Part 132, establishes water quality guidance for the Great Lakes system. This regulation sets limits on bio-accumulating compounds. The Wisconsin DNR administers these regulations through NR 105 and 106, and via the Sturgeon Bay Utilities' Wisconsin Pollutant Discharge Elimination System (WPDES) permit.

Pretreatment regulations are also established by the Federal government for specific categories of industrial dischargers.

B. SANITARY SEWER SYSTEM OVERFLOWS

The EPA proposed revisions to National Pollutant Discharge Elimination System (NPDES) permit regulations to improve the operation of municipal sanitary sewer collection systems, reduce the frequency and occurrence of sewer overflows, and provide more effective public notification when overflows do occur. The goal of the proposal was to provide communities with a framework for reducing health and environmental risks associated with overflowing sewers. The anticipated result was to be fewer overflows, better information for local communities, and extended lifetime for the Nation's infrastructure. This Rule primarily addresses sanitary sewer overflows, not combined sewer overflows.

Sewer system overflows are covered by the Wisconsin DNR in Administrative Code NR 210 – Sewage Treatment Works. NR 210 requires the following:

- **Capacity Assurance, Management, Operation & Maintenance Programs**

All permittees are required to implement a CMOM program. The goal of the program is to ensure collection systems have adequate wastewater collection and treatment capacity, and incorporate many standard operation and maintenance activities for good system performance. When implemented, these programs should provide for efficient operation of sanitary sewer collection system.

- **Notifying The Public & Health Authorities**

Permittees must notify the public of any sanitary sewer and sewage treatment facility overflows consistent with its emergency response plan. Such public notification shall occur promptly following any overflow event using the most effective and efficient communications available in the community. At minimum, a daily newspaper of general circulation in the county(s) and municipality whose waters may be affected by the overflow shall be notified by written or electronic communication.

- **Prohibition Of Overflows**

The existing Clean Water Act prohibition of sanitary sewer overflows that discharge to surface waters is clarified to provide communities with limited protection from enforcement in cases where overflows are caused by factors beyond their reasonable control or severe natural conditions, provided there are no feasible alternatives.

- **Expanding Permit Coverage To Satellite Systems**

Satellite municipal collection systems are those collection systems where the Owner or Operator is different from the Owner or Operator of the Treatment Facility. Satellite collection systems are required to obtain WPDES permit coverage.

C. WISCONSIN ADMINISTRATIVE CODE REVISIONS

1. WISCONSIN DNR AMMONIA POLICY

The DNR Natural Resources Board approved the proposed ammonia regulations on October 22, 2003. A summary of the Rule changes related to Ammonia Water Quality Criteria are:

a. NR 104 - Uses & Designated Standards

The Ammonia Water Quality Criteria and effluent limitations of 3 and 6 mg/L that applied in summer and winter, respectively, for discharges to limited forage fish streams were deleted. Criteria for limited forage fish streams are included in NR 105 and effluent limitations are to be calculated similar to other aquatic life waters, as described in NR 106.

b. NR 105 - Surface Water Quality Criteria & Secondary Values For Toxic Substances

Acute and Chronic Ammonia Criteria are included in NR 105. The acute criteria relate to the pH of the effluent; the chronic criteria relate to both the pH and temperature of the receiving water body. These criteria were developed consistent with the EPA 1999 criteria update, and reflect the fish species present in Wisconsin. Criteria were developed for cold water fish, warm water sport fish, limited forage fish, and limited aquatic life classifications. These criteria are also protective for wildlife and human health uses. This approach establishes criteria that are necessary to assure attainment of the designated use for the water body receiving the discharge.

c. NR 106 - Procedures For Calculating Water Quality Based Effluent Limitations For Toxic & Organoleptic Substances Discharged For Surface Waters

A new subchapter, entitled '*Effluent Limitations For Ammonia Discharges*' was included. Although conceptually the same, the specific calculation procedures for determining an ammonia effluent limitation differs significantly from those used for other toxicants. Temperature, pH and the percent of stream flow used, and the presence of early life stages of fish are all considered in determining the limits. It was, therefore, appropriate to establish a separate subchapter for ammonia. Additionally, the subchapter contains implementation procedures for lagoon and pond systems treating primarily domestic wastewater that is unique to ammonia. A one-time categorical variance procedure with an approximate 5-year term was developed for these systems.

d. NR 210 - Sewage Treatment Works

As in NR 104, the limits of 3 and 6 mg/L in the summer and winter, respectively, for discharges to intermediate (limited forage fish) streams were deleted. This was replaced with criteria in NR 105 and the effluent limitation calculation procedures in NR 106.

2. NR 217 PHOSPHORUS REGULATIONS

NR 217 was adopted in 1992, and established a technology based effluent Phosphorus limit of 1.0 mg/L for Wastewater Treatment Facilities. A limit of up to 2.0 mg/L was applicable for Facilities that employed biological Phosphorus removal systems. Municipalities discharging less than 150 lbs./month and industries discharging less than 60 lbs./month were exempt from the 1.0 mg/L limit. Revisions to the NR Codes were adopted on December 1, 2010. A summary of the Rule changes related to Phosphorus Water Quality Criteria are as follows:

a. NR 102 - Water Quality Standards For Wisconsin Surface Waters

New numeric water quality criteria for Phosphorus were established as follows for Wisconsin surface waters:

- 1) Large Streams.....0.1 mg/L
- 2) Small Streams.....0.075 mg/L
- 3) Non-Stratified Lakes & Impoundments.....0.040 mg/L
- 4) Stratified Lakes & Impoundments.....0.015 - 0.030 mg/L
- 5) Great Lakes.....0.005 - 0.007 mg/L

The new water quality criteria generally do not apply to the following water classifications:

- 1) Ephemeral streams.
- 2) Lakes and reservoirs of less than 5-acres.
- 3) Wetlands.
- 4) Waters identified as limited aquatic life water under NR 104.

However, discharges to the above water classes could be subject to Phosphorus Water Quality Based Effluent Limits (WQBEL's) to ensure that the applicable water quality criteria for downstream water classes are being achieved.

b. **NR 217 - Effluent Standards & Limitations**

New Subchapter III repealed and replaced NR 102.06, and includes detailed procedures for establishing WQBEL's for Phosphorus discharges. NR 217 also provided provisions for different types of Phosphorus limits, including:

1) **WQBEL's**

Takes stream flow and background Phosphorus concentration into account, where the limit is established at a concentration where resulting Phosphorus concentration downstream of the discharge is equal to the water quality criterion at the combined base stream and discharge flow.

2) **Total Maximum Daily Load (TMDL)-Based Limits In Addition To Or In Lieu Of The WQBEL's**

Considers contributions and potential reductions from non-point source discharges in determining discharge limits for point sources. A mass based limit is included, in addition to or in lieu of the WQBEL. Up to two (2) permit terms or 'specified implementation period' are provided for compliance with the TMDL, where the WQBEL may be applied if no progress is observed in the receiving water body.

3) **Technology-Based Limits If More Stringent Than The WQBEL**

The technology based limits of 1.0 mg/L and 2.0 mg/L (Biological P removal) will be in effect if they are more restrictive than WQBEL's.

In addition, the regulations are no longer wastewater specific, applying to other point source dischargers of Phosphorus, including non-contact cooling water discharges, Concentrated Animal Feeding Operations (CAFO's), and other sites where NR 151 and NR 216 regulations are not sufficient to meet the Water Quality Criteria established in NR 102. The WPDES permit limits will be expressed as a concentration (30-day rolling average) and a mass limit if the discharge is to a lake or reservoir, outstanding or exceptional resource water, impaired water, or surface water with approved TMDL for Phosphorus.

NR 217 also allows for an allowable load to be divided amongst multiple dischargers, establishes that the effluent limit cannot be more restrictive than NR 102 criteria, and new sources cannot discharge to an impaired water unless a TMDL has established reserve capacity, the discharger improves the water quality or a pollutant trade occurs. NR 217 provides some flexibility for compliance with WPDES permit effluent Phosphorus limits, including approved TMDL's, extended compliance schedules, and

variances for municipal stabilization ponds and storage lagoons, as well as Adaptive Management plans and pollutant Trading options.

c. NR 151 - Runoff Management

New provisions were established to control runoff from farmland, including new agricultural performance standards, which place a numerical limit on the amount of Phosphorus that can be applied to agricultural fields. There are three (3) major changes to the previous NR 151 rules.

- 1) NR 151.03 prohibits crop producer from conducting a tillage operation that negatively impacts stream bank integrity or deposits soil directly in surface waters, and establishes tillage setbacks of greater than 5-feet but no more than 20-feet.
- 2) NR 151.04 establishes an average Phosphorus index of 6 or less over the accounting period, and no greater than 12 in any individual year during the period for croplands, pastures and winter grazing areas.
- 3) NR 151.055 restricts significant discharge of process wastewater to waters of the State.
Permitted Non-Point Sources (CAFO's) are subject to these rules under their WPDES permits; however, unpermitted non-point sources are subject to these rules to the extent of cost-share or funding dollars offered to the non-point source for implementation of Best Management Practices (BMP's).

The changes to NR 151 affect wastewater treatment facilities two-fold:

- 1) It may be increasingly difficult to obtain suitable land for application of biosolids generated at wastewater treatment facilities.
- 2) Providing cost-share dollars for implementation of agricultural performance standards may provide a means of meeting NR 217 regulations through available Adaptive Management and Watershed-Based Effluent Trading.

NR 217 also allows for an 'Adaptive Management' approach, where up to three permit terms would be available for achieving compliance with Water Quality Standards. In order to be eligible for the Adaptive Management option:

- 1) The exceedance of Phosphorus Water Quality Criterion must be attributed to both point (wastewater treatment facilities) and non-point (agricultural) sources.
- 2) The sum of the non-point source plus permitted municipal separate storm sewer systems must be at least 50% or Water Quality Criteria cannot be met without non-point source control.
- 3) The permittee will be required to implement advance filtration or an equivalent technology to achieve compliance.

- 4) The Adaptive Management plan identifies specified actions that will achieve compliance with the water quality criterion.

Several reduction strategies are available under the Adaptive Management option including:

- 1) Providing financial support to non-point sources to implement BMP's, such as Nutrient Management Plans.
- 2) Working with other point sources to reduce Phosphorus loading.
- 3) Using Water Quality Trading to either meet the effluent limit or to meet an Adaptive Management tool.
- 4) Completing wetlands restoration within the watershed.
- 5) Creation of a bubble limit or watershed permit, which integrates the aggregate Phosphorus load on the watershed under a group or under a single permit.
- 6) Creation of a third party TMDL.

Watershed Trading is an option that can be used in conjunction with other compliance options, where another source reduces Phosphorus to satisfy the difference between the permittee's discharge and the WPDES permit limit. The DNR and EPA impose a number of conditions on acceptable Trades, unless the Trading is used to meet an Adaptive Management goal; in which case, the conditions are much more flexible because the Trades are being used to meet a management goal, and not a specific effluent limit. Generally, Trades will only be allowed with sources that contribute to the same stream segment, unless the Trade is within the context of a TMDL, which would allow for a broader reach. A Trade ratio would be included to address the uncertainty in non-point source reduction practices.

d. Temperature Regulations

Water Quality Standards for temperature have been established in NR 102 to protect fish and other aquatic life from lethal and sub-lethal effects. The rules primarily affect power plants and other industrial dischargers that add heat to process wastewater and non-contact cooling water; however, the rules also apply to municipal wastewater treatment facilities. The 'thermal limits' are based on both acute and chronic or sub-lethal impacts on aquatic life.

- Acute limits are established is the effluent discharge exceeds default values assigned to a particular classification of water body on a monthly basis or exceeds site specific stream temperatures based on wastewater treatment facility data. For 'effluent dominated' streams, the temperature at the outfall can be used as the ambient temperature.

- Chronic limits are established if the effluent discharge exceeds default values or measured values, and the DNR determines, by examining several site specific factors, that the effluent has a reasonable potential to cause or contribute to the inability of the water body to support aquatic life.

Specific procedures for calculating WQBEL for temperature are specified in NR 106. These Rule changes became effective on October 1, 2010. Temperature sampling requirements and a Compliance Schedule to meet temperature limits would be set in the WPDES permit. The limitations and Compliance Schedule may be invalidated, if testing indicates that the temperature limit is not necessary.

D. SLUDGE REGULATIONS

1. 503 REGULATIONS

Land application of sewage sludge is regulated under CFR 40, Part 503, ‘Standards For The Use Or Disposal Of Sewage Sludge’. This regulation establishes two (2) levels of sewage sludge quality, with respect to heavy metal concentrations [ceiling concentrations and exceptional quality (see below)], two (2) levels of quality, with respect to pathogen densities (Class A or Class B), and two (2) types of approaches for meeting vector attraction reduction. In order for the sludge to qualify for land application, metals must be below ceiling limits, and the sludge must meet Class B requirements for pathogens and vector attraction reduction requirements.

a. Metals

Metals limits for land application of sewage sludge are summarized below:

LAND APPLICATION POLLUTANT LIMITS
(All Weights Are On Dry Weight Basis)

Table In 503 Rule	Table #1	Table #2	Table #3	Table #4
Pollutant	Ceiling Concentration Limits* (mg/kg)	Cumulative Pollutant Loading Rates (kg/ha)	“High Quality” Pollutant Concentration Limits * (mg/kg)	Annual Pollutant Loading Rates (lbs./acre/yr.)
Arsenic	75	41	41	1.78
Cadmium	85	39	39	1.69
Copper	4,300	1,500	1,500	66.9
Lead	840	300	300	13.4
Mercury	57	17	17	0.76
Molybdenum	75	N/A	N/A	N/A
Nickel	420	420	420	18.7
Selenium	100	100	100	4.4
Zinc	7,500	2,800	2,800	125

* Absolute Values

** Monthly Averages

To be land applied, bulk sewage sludge must meet the pollutant Ceiling Concentrations and Cumulative Pollutant Loading or Pollutant Concentrations limits.

b. Pathogen Reduction

Sewage sludge that is land applied must meet Class A or B pathogen requirements.

For Class A, the sludge must meet one of the following criteria:

- Fecal coliform density less than 1,000 Most Probable Number (MPN) per gram of total dry solids; or
- Salmonella density less than 3 MPN/4 grams of total dry solids.

Class B sewage sludge must meet one of the following pathogen requirements:

- The sewage sludge must be treated by a Process To Significantly Reduce Pathogens (PSRP) process; or
- At the time of disposal, the geometric mean of sewage sludge samples must be less than 2,000,000 MPN/gram total solids (dry weight).

c. Vector Attraction

Vector attraction reduction reduces the potential for spreading of infectious disease agents by vectors (flies, rodents and birds). At a minimum, one of the following must be met prior to land application of the sludge for anaerobic processes:

- Minimum volatile solids reduction of 38% of raw sludge, compared to stabilized sludge.
- Injection - Liquid sludge should be injected beneath the soil surface, with no significant amount of sewage sludge present after 1-hour of injection (Class B) or 8-hours for Class A.
- Incorporation - Sewage sludge that is land applied on a surface disposal site shall be incorporated into the soil within 6-hours of application (Class B) or 8-hours for Class A. This applies to dewatered sludge.

2. NR 204 REGULATIONS

The DNR regulates sludge disposal through Chapter NR 204 of the Wisconsin Administrative Code. The 1996 Revisions to NR 204, for the most part, mirror the 503 Regulations. Following are the NR 204 major revisions are summarized:

- Additional testing requirements are required of the sludge, depending upon its end use and facility size. These will be specified in the WPDES permit. Additional tests could include SOUR, salmonella, viruses, viable helminth ova and a priority of pollutant scan.
- The DNR defines an ‘Exceptional Quality Sludge’ as one that meets Class A pathogen requirements, high quality pollutant concentrations and vector reduction requirements of the 503 Regulations. Sludge certified as ‘Exceptional Quality’ is exempt from the minimum separation distances to residences, businesses, recreational areas or property lines, if land applied. A permit is not required to land apply the sludge and site life is unlimited. Sludge may be commercially distributed in bulk, only if it is certified as exceptional quality.
- Application of sludge on frozen or snow covered ground is prohibited, unless a permittee can demonstrate that there are no other reasonable disposal methods available and there is absolutely no likelihood that the sludge will enter the waters of the State. Application may be approved on a case by case basis until storage is available.
- Sludge quality standards, with respect to vector attraction reduction, pathogen reduction and metals from the 503 Regulations are incorporated into these regulations, including site restrictions.
- All municipal mechanical treatment plants that land apply sludge shall have the ability to store sludge for 180-days.

E. WISCONSIN WATER QUALITY OBJECTIVES

The State of Wisconsin enforces the requirements of the Federal Water Pollution Control Act through the WPDES. This system is a permitting process, which permits point discharges of treated effluent to receiving waters. Effluent requirements are established by the DNR, based upon water quality limitations associated with the receiving waters; and are established for the protection of public health and welfare for the propagation of fish and wildlife, and for domestic, recreational, agricultural, commercial, industrial and other legitimate uses.

F. CURRENT EFFLUENT REQUIREMENTS

The existing Wastewater Treatment Facility discharges to Lake Michigan's Green Bay. The discharge is permitted under WPDES Permit No. WI-0061271-07-1 (Appendix #1), effective January 1, 2022, modified May 1, 2022. The effluent limits are based upon an annual average discharge flow of 0.31 mgd.

Parameter	Daily Maximum	Daily Minimum	Weekly Average	Monthly Average	Sample Frequency	Sample Type
BOD ₅			45 mg/L	30 mg/L	2/Week	F.P.
TSS			45 mg/L	30 mg/L	2/Week	F.P.
pH	9.0 s.u.	6.0 s.u.			5/Week	Grab
E. Coli				126#/100 mL	Weekly	Grab
Total Phosphorus				0.6 mg/L	2/Week	F.P.
NH ₃ -N	18 mg/L		18 mg/L	18 mg/L	Monthly	F.P.

F.P. = 24-hour flow proportional composite.

E. Coli limit of 126#/100 mL calculated using the geometric monthly mean. Also, no more than 10% of E. Coli samples in a month may exceed 410#/100mL. E. Coli limits apply May through September.

A. CURRENT INFLUENT FLOWS & LOADINGS

Influent flows and loadings to the WWTF, including both wastewater from the collection system and hauled-in waste, from 2019 through 2023 are summarized below in Table #1. Additional tables showing monthly influent flows and loadings to the WWTF from 2019 through 2023 are provided in Appendix #2.

TABLE #1
SUMMARY OF INFLUENT FLOWS & LOADINGS - 2018 THROUGH 2023

Parameter	2019	2020	2021	2022	2023	Average	Max
Flow, mgd							
Average Day	0.090	0.083	0.075	0.081	0.066	0.081	-
Max Month	0.141	0.146	0.142	0.145	0.111	-	0.146
Max Day	0.270	0.209	0.182	0.185	0.197	-	0.270
BOD, mg/L							
Average Day	116	111	155	116	103	122	-
Max Month	207	189	231	158	156	-	231
Max Day	288	288	411	258	329	-	411
BOD, lbs./day							
Average Day	95	83	105	73	49	85	-
Max Month	253	221	268	176	125	-	268
Max Day	466	250	296	257	329	-	466
TSS, mg/L							
Average Day	125	135	176	134	124	140	-
Max Month	237	238	252	251	206	-	252
Max Day	550	718	775	468	700	-	775
TSS, lbs./day							
Average Day	102	98	114	77	57	93	-
Max Month	287	238	275	164	134	-	287
Max Day	582	474	304	223	180	-	582

Current seasoned flows and loadings to the WWTF compared to the plant’s original design criteria are summarized in Table #2.

**TABLE #2
CURRENT INFLUENT FLOWS & LOADINGS VS. DESIGN CRITERIA**

Parameter	PEAK SEASON			OFF-SEASON		
	¹ Current	Design	% of Design	¹ Current	Design	% of Design
Flow, mgd						
Average Day	0.114	0.310	37%	0.050	0.083	60%
Max Day	0.270	0.620	44%	0.197	0.165	119%
BOD, lbs./day						
Average	140	1,400	10%	33	300	11%
Max Day	466	2,100	22%	136	600	23%
TSS, lbs./day						
Average	151	1,200	13%	40	250	16%
Max Day	582	1,800	32%	298	500	60%
² Total P, lbs./day						
Average	-	48	-	-	10	-
Max Day	-	72	-	-	20	-

1 2019 through 2023 Average and Max Day values.

2 Influent Total P is not monitored.

Peak season is assumed to be the period from May through October, while the off-season is assumed to be November through April.

Current flows to the WWTF during peak season are typically around 37% of the WWTF's rated peak season design capacity, while Biological Oxygen Demand (BOD) and Total Suspended Solids (TSS) loadings are typically in the 10 to 13% range of the rated peak season capacity. During the off-season, influent flows are roughly half of those observed during the peak season and are typically around 60% of the rated off-season capacity. Off-season BOD and TSS loadings are roughly 25% of those observed during the peak season and are typically around 11 to 16% of the rated off-season capacity.

B. WWTF PERFORMANCE

Wastewater effluent discharges from the WWTF from 2019 through 2023 are summarized in Table #3. Additional tables showing monthly WWTF effluent discharges from 2019 through 2023 are provided in Appendix #2.

**TABLE #3
SUMMARY OF EFFLUENT FLOWS & LOADINGS - 2018 THROUGH 2023**

Parameter	2019	2020	2021	2022	2023	Average	Max
Flow, mgd							
Average Day	0.087	0.080	0.072	0.078	0.063	0.078	-
Max Month	0.135	0.141	0.136	0.137	0.104	-	0.141
Max Day	0.265	0.204	0.176	0.183	0.197	-	0.265
BOD, mg/L							
Average Day	4.3	3.4	3.4	3.5	4.1	3.7	-
Max Month	5.0	4.0	4.6	4.8	5.4	-	5.4
Max Day	9.4	6.0	6.1	7.4	11.1	-	11.1

**TABLE #3
SUMMARY OF EFFLUENT FLOWS & LOADINGS - 2018 THROUGH 2023**

Parameter	2019	2020	2021	2022	2023	Average	Max
TSS, mg/L							
Average Day	11.6	7.7	8.3	11.1	12.2	9.9	-
Max Month	16.4	12.7	10.9	15.1	14.6	-	16.4
Max Day	21.2	18.6	16.8	22.0	21.9	-	22.0
Total P, mg/L							
Average Day	0.33	0.30	0.28	0.29	0.25	0.30	-
Max Month	0.54	0.56	0.45	0.45	0.31	-	0.56
Max Day	0.88	0.80	0.53	0.63	0.43	-	0.88
NH3-N, mg/L							
Average Day	0.11	0.06	0.13	0.10	0.14	0.10	-
Max Month	0.61	0.29	0.82	0.23	0.14	-	0.82
Max Day	0.61	0.29	0.82	0.23	0.14	-	0.82
E. coli, #/100mL							
Average Day	1.6	2.1	1.1	1.1	1.0	1.5	-
Max Month	3.3	3.9	1.4	1.5	1.0	-	3.9
Max Day	9.5	7.5	3.2	2.0	1.0	-	9.5
pH, s.u.							
Min Day	6.9	6.6	6.9	6.9	7.1	6.6 (Min)	-
Average Day	7.2	7.1	7.3	7.2	7.3	7.2	-
Max Day	7.9	7.7	7.6	7.5	7.8	-	7.9

The WWTF has performed quite well over the last four and a half years. Current effluent permit limits are provided below.

- BOD
 - ▶ 45 mg/L (Weekly Avg)
 - ▶ 30 mg/L (Monthly Avg)
- TSS
 - ▶ 45 mg/L (Weekly Avg)
 - ▶ 30 mg/L (Monthly Avg)
- pH
 - ▶ 6.0 to 9.0 s.u. (Daily Min and Max)
- E. coli
 - ▶ 126#/100 mL (Geometric Monthly Mean)
 - ▶ 10% Exceedance (Monthly, % of samples >410#/100 mL)
- NH3-N
 - ▶ 18 mg/L (Daily Max, Monthly Avg, and Weekly Avg)
- Total P
 - ▶ 0.6 mg/L (Monthly Avg)

Effluent results have been well below permit limits, resulting in no permit effluent limit exceedances over the last five (5) years.

C. NEEDS ASSESSMENT

The existing WWTF was assessed with respect to age, condition, capacity, performance, and code compliance. The purpose of the Needs Assessment is to establish a basis for the need for improvements to the WWTF to comply with permit requirements, current codes, and future flows and loadings. Each unit process is evaluated individually. Code compliance is based upon Chapter NR 110 of the Wisconsin Administrative Code and the National Electric Code (NEC).

The findings from this Needs Assessment are outlined in the following Sections.

1. SANITARY SEWER COLLECTION SYSTEM

The Village's collection system consists primarily of gravity sewer with two (2) sewage lift stations, one located at the public beach within the bathhouse (Lift Station #1) and the other at the intersection of Spruce Street and Water Street (Lift Station #2). Lift Station #1 transfers wastewater north along Hwy 42 to the gravity sewer flowing toward Lift Station #2. Lift Station #2 handles all the original collection system, pumping wastewater up to the WWTF site. Sections low pressure sewer main serve properties along the bluff off North Shore Road in the north end of the Village and along Crystal Springs Drive on the south end of the Village.

1. Low Pressure Sewer System

The low-pressure force main, which serves properties with privately owned individual grinder pump stations, transfers residents' wastewater from North Shore Road to the gravity sewer main at North Water Street. The force main has experienced freezing during winter months when some properties in the area are unoccupied, resulting in stagnant flow conditions in the main and exposure to frozen soil, both from frost penetrating below the paved road above and exposure from the adjacent bluff. The Village has mitigated pipe freezing by periodically unloading water at a private grinder pump station near the end of the south leg.

A "Freeze Mitigation Study" of the North Shore low pressure force main was conducted in 2016 to identify feasible alternatives for eliminating the freezing issues. Several alternatives were evaluated including (1) continuing the current practice of hauling water to the grinder pump station near the head of the force main, (2) construction of a well to supply water to a pump station and, in turn, the low pressure force main, (3) heat tracing the section of force main affected by freezing, and (4) insulating the section of force main affected by freezing. The study recommended continuing the practice of hauling water to the private grinder pump station. However, this practice relies on cooperation from the

property owner. The most feasible long-term remedy is likely insulation of the section of impacted force main. However, the force main is below a private road, and work would need to be coordinated with the property owners.

2. Gravity Sewer

The Village's sanitary sewer collection system is generally believed to be in good condition. However, there are several unused lateral stubs at vacant lots along Larson Lane, Hidden Springs Road, and Brookside Lane that are believed to be leaking and a source of clear water (infiltration) to the collection system and WWTF. A corrective measure to eliminate this source of infiltration would involve lining the sections of sewer main at each lateral location. The lining could then be cut out at the lateral connection to the sewer main when a customer connects to the lateral stub in the future.

3. Lift Station #1 (Public Beach)

Lift Station #1 consists of two (2) 3 hp Ebara submersible pumps and ductile iron discharge piping in a precast concrete manhole located inside the bathhouse building and a separate precast concrete below grade valve vault with rubber "duckbill type" check valves and plug valves outside the building. A spare pump is normally kept on-site. A monorail beam and electric hoist were provided for removing the pumps from the wet well for service. The pumps are operated from the control panel using a level sensor with float backup system. The pump station is remotely monitored using both landline alarm communication and Mission Communication managed SCADA. A propane fueled generator installed outside the building in a weather enclosure provides backup power for the lift station.

The main issues identified with Lift Station #1 include primarily pump ragging issues and extended run times during rain events. In addition, there is metal corrosion evident in the lift station wet well and valve vault; however, the precast structures appear to be in good condition. The lift station control panel is showing its age and some of the electrical components associated with the lift station may not be suitable for the environment.

Suggested improvements to Lift Station #1 include the following:

- Replacement of submersible pumps and slide rail systems with new pumps with higher capacity and ability to handle rags without clogging.
- Replacement of piping in both the wet well and valve vault with stainless steel piping.
- Replace check valves and plug valves in the valve vault.
- Replace wet well hatch with a tighter sealing hatch including safety grating for fall protection.

- Upgrade lift station electrical, controls, and telemetry with modern technology and components suitable for the environment in which they are installed.
- Replace the generator if necessary to operate new pumps.
- Inspection and televising of the collection system serviced by the lift station to identify sources of infiltration.

4. Lift Station #2 (Spruce St. and Water St.)

Lift Station #2 is a Usemco wet well/dry well “can style” pump station originally installed in 1989. The wet well is a combination of precast concrete base and an upper fiberglass barrel section. The can dry style well contains two (2) centrifugal pumps and associated ductile iron piping and valves. The pump volutes were recently replaced in 2021 following failure and flooding of the dry well. The below grade dry well is also provided with a local control and power distribution panel, sump pump, and heating and ventilation systems. The lift station’s main control panel and emergency backup diesel generator with automatic transfer switch are installed in the nearby Smith Building.

While the lift station dry well and wet well structures and internal components generally appear to be in good condition, the main issues identified at Lift Station #1 primarily involve operator safety related accessing the dry well, which is considered a “confined space” and presents a safety hazard for operating staff. The lift station controls and backup generator are showing age and may need replacement in the near future.

Suggested improvements to Lift Station #2 include the following:

- Replacement of existing lift station with a new submersible type pump station including precast concrete wet well and valve vault structures and modern control panel. The existing wet well would be converted to a flow through manhole, discharging to the new lift station wet well.
- Replacement of the backup generator.
- Integration of fire and intrusion monitoring of the Smith Building.

2. WASTEWATER TREATMENT FACILITY

a. Site & Structures

The existing WWTF site primarily includes a masonry block hauled-in waste receiving station and a masonry block main treatment building which utilizes cast-in-place concrete common wall construction and houses all of the main unit processes in the treatment train as well as a laboratory area with office space. Both buildings have precast roof panels covered with tapered insulation, single

ply membrane roofing, and gravel ballast. The site is accessed off of Townline Road by an asphalt drive which loops around both the main treatment building and the hauled waste receiving station.

The on-site structures were originally constructed in 1986, while a public works garage was later constructed west of the main treatment building. An influent lift station addition to the main treatment building was constructed in 2005.

While the facilities and grounds have generally been well maintained, the main treatment and hauled-in waste receiving buildings are approaching 40-years old and are in need of some general improvements to extend their service life.

Suggested improvements to the WWTF site and structures include the following:

- Mill and overlay existing asphalt paving.
- Inspect membrane roofing system and replace if necessary.
- Paint exposed metal surfaces and replace entry and overhead doors with extensive corrosion.
- Replace building lighting with modern, energy efficient fixtures.
- Improve HVAC systems in corrosive areas.

b. Hauled-In Waste Receiving Station, Holding Tanks & Transfer Pumps

The WWTF currently accepts hauled-in waste from surrounding unsewered areas. Hauled-in waste facilities primarily include a receiving station with mechanical and manual screening as well as two (2) below grade cast-in-place concrete holding tanks and three (3) positive displacement transfer pumps, which discharge the holding tank waste to the main treatment facilities at a controlled rate. The Village also owns and operates a tanker truck for collecting and hauling septage and holding tank waste to the WWTF.

The existing mechanical screening unit has failed and is no longer in operation. Metal channel mounted bar screens, which require frequent manual cleaning, are currently used to remove foreign objects from the hauled-in waste stream. The holding tank access hatches, both inside and outside of the main treatment building, are corroded and in need of replacement. The cast-in-place concrete tank cover outside the building is also showing wear and need of repairs. The three (3) Penn Valley double diaphragm style transfer pumps have been rebuilt and are in good working condition; however, associated piping and valves are showing age and are in need of rehabilitation or replacement. The Village's tank truck dates back to the 1990's, has surpassed its service life, and is in need of replacement.

Should the Village intent to continue hauling and accepting septage and holding

tank waste at the WWTF, suggested improvements to the hauled-in waste facilities include the following:

- Replacement of the existing mechanical screening equipment.
- Replacement of the interior and exterior holding tank hatches with tight sealing gasketed traffic rated hatches.
- Repairs to the outdoor portion of concrete holding tank cover
- Inspection and repairs to holding tank interior concrete as necessary.
- Replacement of transfer pump valves and painting or replacement of transfer pump piping.
- Replacement of the hauled waste tanker truck with modern equipment that may also be used for sewer cleaning.

c. **Influent Lift Station**

The influent lift station building addition to the main treatment building was constructed in 2005 in conjunction with sanitary sewer construction to serve the area immediately surrounding the WWTF on Hwy 42 and Town Line Drive. The influent lift station primarily includes three (3) 5 hp Ebara submersibles in a precast concrete wet well with ductile iron discharge piping and an above grade ductile iron discharge piping and valve nest. A spare pump is kept onsite. A monorail beam and chain hoist is provided for servicing the pumps. A Motor Control Center (MCC) with variable frequency drives for pump operation was installed inside the influent lift station building.

While the influent lift station facilities generally appear to be in good condition, the influent lift station has been problematic since construction. The submersible pumps initially needed to be modified with new volutes and impellers to provide sufficient capacity, and the Variable Frequency Drives (VFD's) meant to flow pace the pumps have never been used. The very large common access hatch above the pumps with no fall protection presents a safety issue for operating staff. While some of the influent lift station building's electrical components appear suitable for a hazardous classified area, the MCC and associated VFD's, panels, and lighting do not appear to be suitable for the area, which is also considered very corrosive. Area classification requirements are likely met through continuous ventilation of the space.

Suggested improvements to the influent lift station include the following:

- Replacement of submersible pumps as they reach their service life.
- Modification or replacement of wet well access hatch to a vapor tight seal when closed and fall protection grating when open.

- Relocation/replacement of the MCC and other electrical components outside of the corrosive and hazardous classified area.
- Modification of controls to allow for variable speed pumping.
- Modifications to HVAC equipment to improve efficiency.
- Removal of items currently stored in the influent lift station building.

d. Headworks Facilities (Influent Fine Screening & Grit Removal)

Preliminary treatment, consisting of fine screening of foreign objects and grit removal from the influent raw wastewater, is currently provided within a designated area (Headworks) of the main treatment building. A channel mounted cylindrical fine screen, consisting of a perforated basket strainer and spiral conveyance screw, was installed approximately 13-years ago, replacing the original mechanical bar screen. Following screening, the raw wastewater flows by gravity through a vortex type grit removal chamber and on to the flow splitting box upstream of the secondary treatment system. The existing Smith and Loveless Pista Grit system with air lift type transfer system and slope screen type grit separator are original to the treatment facility. The grit removal unit has been rebuilt since installation.

The fine screen, which was built by Lee's Contracting/Fabrication, Inc. and installed only 12-years ago, appears to be in good working order. However, foreign objects can be found in the sludge and treated effluent, which brings into question the efficiency and capacity of the fine screen unit. The grit removal equipment has reached its service life and is due for replacement with modern, more efficient equipment. The "Headworks" area of the plant is often the most odorous and corrosive area of the treatment facility. Therefore, improvements to this area of the treatment facility should be aimed at mitigating odors and corrosive gases and replacement of corroded mechanical and electrical components.

Suggested improvements to the existing Headworks include the following:

- Replacement of the fine screen equipment.
- Replacement of the mechanical components of the vortex grit removal unit.
- Installation of a grit pump replacing the air lift type grit transfer system.
- Replacement of the grit separation system with a modern grit washer.
- Improvements to the HVAC system to contain odors and removal corrosive gases from the area.

e. **Aeration Basins & Blowers**

Activated sludge type biological secondary treatment is provided in two (2) 24-foot wide by 60-feet long by 14-foot side water depth concrete aeration basins. Aeration and mixing in the basins is provided via fine bubble tube type diffusers, which replaced the original coarse bubble diffusers in 2012. Currently, only one (1) aeration basin is used for treatment as flows and loadings to the facility do not warrant having both basins in service. Therefore, the second aeration basin is currently used for sludge holding. The facility has enough spare fine bubble tube diffuser elements for one (1) aeration tank.

Air is supplied to the aeration basins using two (2) 30 hp lobe style blowers installed in 2005. The blowers are operated on VFD's and can be controlled based on the Dissolved Oxygen (DO) concentration being monitored in the aeration basins. There is also a single 75 hp lobe style blower available as a backup that was original to the WWTF construction. The blowers also supply air to the aerobic digester, hauled-in waste holding tanks, and air lift type grit and RAS pumps in a common header pipe.

While the aeration basins and diffuser grids appear to be in good working order, deficiencies in the air supply system often result in aeration basin operation at excessive DO concentrations and operational difficulties associated with controlling air supply to multiple processes operating at different pressures off a common supply header.

Suggested improvements to the existing aeration basins and blowers include the following:

- Adding submersible mixers to the aeration basins to provide mixing independent of blower operation.
- Replacement of all aeration blowers.
- Reconfiguration of the air supply piping.

3. **ALUM STORAGE & FEED SYSTEM**

The WWTF has a permit effluent Total Phosphorus discharge limit of 0.6 mg/L. Alum is currently dosed to the MLSS upstream of the secondary clarifiers for phosphorus removal. Alum is stored in a 6,000-gallon FRP bulk storage tank that is original to the WWTF. The bulk storage tank was installed in a below grade concrete containment area. Alum is transferred up from the containment pit to a 100-gallon "day tank" using an end suction centrifugal pump installed on the floor of the containment pit. The two (2) chemical feed pumps draw from the day tank and discharge to the secondary clarifier splitter box. One (1) chemical feed pump, which is original to the treatment facility, is flow paced, while the second replacement pump is operated during peak season at a constant rate, as the flow pacing never worked with the replacement pump.

Suggested improvements to the existing alum storage and feed system include the following:

- Inspection and refurbishment of the FRP alum storage tank and containment area.
- Replacement of all chemical feed pumps and piping.
- Installation of an orthophosphate analyzer for chemical feed control.

4. SECONDARY CLARIFIERS

Two (2) 8-feet wide by 60-feet long by 13-feet side water depth rectangular final clarifiers with mechanical sludge collectors are used for settling MLSS from the aeration basins. Clarified effluent overflows fiberglass finger weirs at the end of the clarifier tanks. Scum removal is manual using a rotating skimmer. The scum discharges to a hopper and is air lifted to the aerated sludge holding tank. RAS is air lifted from the hopper on the south end of each clarifier into a channel which flows to the aeration basin splitter box. RAS flow is monitored using a Parshall Flume. The chain and scraper style sludge collectors are original to the WWTF; however, the rails have been previously rebuilt.

Suggested improvements to the existing final clarifiers include the following:

- Replacement of the chain and scraper sludge collectors.
- Optimization/Automation of the sludge return and wasting processes.

5. UV DISINFECTION & EFFLUENT PUMPING

Clarified effluent is disinfected using UV disinfection. The original chlorine contact tank was modified for installation of the UV disinfection system about 25-years ago. Effluent flow is metered using a 45 degree V-notch weir and discharges to the final effluent pump station which contains three (3) submersible effluent pumps. Plant effluent is pumped to the outfall in the lake in an 8-inch force main.

The existing Fischer Porter UV disinfection system equipment is approximately 25-years old. It was inspected 3-years ago, and boards in the control panel were replaced at that time. The system is currently in good working order, and the facility is meeting E. coli discharge limits.

Suggested improvements to the existing UV disinfection system and effluent pump station include the following:

- Replacement of the UV disinfection system and relocation of control panel outside of the secondary treatment area.
- Replacement of effluent pumps.

- Covering the UV system and chlorine contact tank to mitigate freezing and algae growth.

6. AERATED SLUDGE HOLDING

Aerobic digestion and sludge holding is provided in a single 14.5-foot wide by 60-foot long by 14-foot side water depth concrete basin. Aeration and mixing in the basin is provided via the original stainless steel coarse bubble diffusers. The aerated sludge holding tank is provided with a decant air lift pump for sludge thickening.

The original design intent for this basin was to provide aerobic digestion during peak season and act as the main aeration basin during the off-season. However, the WWTF is currently operated with one (1) aeration basin in service year round, one (1) aeration basin used for aerated sludge holding, and the aerated sludge holding tank used for sludge thickening prior to hauling the liquid sludge to the WWTF in Sturgeon Bay for disposal.

Suggested improvements to the aerated sludge holding tank include the following:

- Improving aeration control through piping and valve modifications.
- Improving sludge thickening in the basin or adding mechanical thickening of WAS.

7. SLUDGE TRANSFER PUMPS

Two (2) 3 horsepower EMU centrifugal pumps are used to transfer sludge from any of the three (3) aeration basins to the loadout station. The pumps have been rebuilt over their service life and are currently in good working order.

Suggested improvements to the existing sludge transfer pumps include the following:

- Replacement of pumps and associated valves and piping.
- Reconfigure discharge piping to allow for transfer from one basin to another.

8. ELECTRICAL SYSTEMS, CONTROLS, & SCADA

The WWTF's main MCC is in the Service Building Blower Room along with the 250-kW diesel generator. A 1,000-gallon diesel fuel storage tank for the generator is located just outside the Blower Room. Both the MCC and generator are original to the WWTF. Danfoss VFD's were added to the MCC in 2005 for operation of the 30 hp aeration blowers. A small MCC with VFD's in the influent pump station building addition was added in 2005 and powered out of the main MCC in the Blower Room.

Most of the treatment facility is either controlled directly out of the main MCC and via a series of remotely mounted control panels, which are either original to the treatment facility or supplied with equipment later retrofitted into the WWTF. The control systems

were later integrated into a Supervisory Control and Data Acquisition (SCADA) system utilizing Wonderware software, which is currently maintained by PJ Kortens. The SCADA computer, which is located at a desk in the Service Building Laboratory, is running the Windows 7 Professional operating system.

The electrical and controls systems, as well as the WWTF SCADA system, are reaching or have surpassed their service life and are due to replacement.

Suggested improvements to the existing electrical systems, controls, and SCADA are as follows:

- Replacement of the main MCC.
- Replacement of the plant controls and SCADA system including integration of the two (2) lift stations.
- Replacement of the diesel generator considering outdoor installation.
- Replacement of building lighting with modern energy efficient fixtures.

9. **LABORATORY**

The Village operates a certified laboratory out of the WWTF Service Building. Operating staff also perform water testing in addition to the regulatory testing necessary for demonstrating compliance with the WWTF WPDES effluent discharge permit. The laboratory, while original to the WWTF, contains new lab equipment. Existing cabinetry and counter tops are showing some age but are in relatively good condition. Some remodeling of the space and replacement of lab equipment should be considered if the Village intends to continue operating with the certified laboratory.

10. **PRIORITIZATION OF NEEDS**

The existing sanitary sewage collection system, lift stations and WWTF were originally constructed around 1986, and while some improvements have been made at the WWTF since startup, much of the infrastructure is approaching 40-years old. The buildings and tankage appear to be in very good condition with only minor improvements needed to extend their service life. However, much of the wastewater process, mechanical and electrical equipment is reaching, or has already surpassed, its intended service life and is due for replacement.

Given the age of the WWTF, it is important to identify what infrastructure improvements are needed to (1) maintain compliance with WPDES effluent discharge permit limits; (2) maintain reserve capacity for growth in the sewer service area; (3) extend the service life of the treatment facility and; (4) improve operability and maintainability, with the goal of avoiding major capital improvements costs over the 20-years following a significant WWTF upgrade.

The existing treatment facility has an abundance of reserve capacity. Current wastewater flows to the WWTF during summer/peak season months (approximately 120,000 to 160,000 gpd) are less than half of the facility's rated average design flow capacity (310,000 gpd), and loadings to the facility are less than a quarter of the rated design capacity. Therefore, improvements aim at increasing the facility's treatment capacity would not be considered a high priority.

Given the current infrastructure in place and the associated reserve capacity, the existing WWTF should be well suited for maintaining compliance with WPDES permit limits with only minor improvements. Current effluent BOD, TSS, ammonia, and Total Phosphorus limitations should be readily achievable with the existing activated sludge biological secondary treatment system and associated chemical addition and should not require additional advanced treatment to meet these limits. It is expected that current effluent limits will remain unchanged in future WPDES permit reissuances. However, it should be noted that one of operating staff's biggest concerns is maintaining compliance with effluent phosphorus limits (0.6 mg/L), especially during peak season with periods of higher flows and loadings to the WWTF. Concerns are primarily associated with the impacts of alum addition on the effluent pH, rising chemical costs, and sludge hauling costs, where chemical phosphorus removal results in a significant amount of chemical sludge production.

Prioritization of needs and associated improvements can be somewhat subjective. However, an emphasis should always be placed on improving operator safety whenever possible. High priority should also be given to improving the operability and maintainability of the facilities. After prioritizing needs associated with Operator safety and improving Operation and Maintenance, consideration can be given to refurbishment or replacement of general items that have surpassed their service life, where failure can be expected within a 5- to 10-year period, replacement parts may be no longer available, or modern more efficient technology is available.

Proposed improvements identified in the previous section have been ranked based on perceived priority.

a. **High Priority Improvements**

- Complete improvements to Lift Station #1 including replacement of submersible pumps, slide rail systems and wet well access hatch to improve operator safety and maintainability and increase the capacity of the lift station.
- Replace Lift Station #2 with a submersible type lift station to improve Operator safety and maintainability of the station.
- Should the Village choose to continue to accept hauled-in waste, complete improvements to the hauled-In waste receiving facilities including replacement of the existing mechanical screening equipment, and holding tank access hatches, and complete repairs to the concrete tank cover to

improve operability and maintainability of the system. Replacement of the hauled waste tanker truck may also be warranted should the Village decide to continue to haul septage and holding tank wastewater.

- Complete modifications or replacement of influent pump station wet well access hatch to improve Operator safety.
- Complete improvements to secondary treatment system including installation of submersible mixers to the aeration basins, replacement of aeration blower(s), and reconfiguration of air supply piping to improve efficiency, operability, and maintainability of the system.
- Replace the alum feed pumps and associated piping and accessories and install an orthophosphate analyzer for chemical feed control to improve efficiency and operability of the system and maintain permit compliance.
- Complete piping and valve modifications associated with the aerated sludge holding tank and improve sludge thickening to improve efficiency and operability of the process.

b. Medium Priority Improvements

- Replace the discharge piping and valves and upgrade the electrical system, controls, and telemetry to improve operability and maintainability as well as extend the service lift of Lift Station #1.
- Replace the backup generator at Lift Station #2 and integrate fire and intrusion monitoring of the Smith Building, which currently houses the lift station controls and generator, to extend the service life of the lift station and improve security.
- Relocate the influent pump station MCC and controls out of the corrosive and potentially hazardous area.
- Complete improvements to the Headworks area HVAC systems to contain odors and removal corrosive and hazardous gases from the area, improving operability and maintainability while extending the service life of the building and equipment installed in the Headworks.
- Replace the final clarifier chain and scraper sludge collector equipment to extend the service lift of the system and optimize/automate of the sludge return and wasting processes to improve efficiency and operability.
- Replace the main MCC and plant controls and SCADA system to improve operability and extend the service life of the facility.
- Replace the emergency backup diesel generator to extend the service lift of the facility. Consideration should be given to installing a new generator outdoors in a weather and sound attenuating enclosure to eliminate noise during operation and free up space in the Blower Room.

c. **Low Priority Improvements**

- Insulate (and heat trace) the section(s) of low-pressure force main impacted by freezing.
- Line sections of sewer with leaking lateral stubs to reduce infiltration to the collection system.
- Replace the generator at Lift Station #1 if necessary to operate new larger pumps.
- Inspection and televising of the collection system serviced by Lift Station #1 to identify sources of infiltration and complete repairs as necessary.
- Mill and overlay the existing asphalt paving at the WWTF.
- Inspect the membrane roofing systems on existing WWTF buildings and replace if necessary.
- Paint exposed metal surfaces and replaced entry and overhead doors with extensive corrosion.
- Inspect the hauled-in waste receiving tank interior and complete repairs as necessary.
- Replace the valves and re-paint or replace the hauled-in waste transfer pump piping.
- Replace the submersible influent pumps as they reach their service life and complete necessary modifications to allow for variable speed control of the pumps.
- Replace the fine screen and grit removal equipment and install a self-priming grit pump to replace the air lift type grit transfer system to improve operability, maintainability, and improve efficiency.
- Inspect and repair the FRP alum storage tank and containment area.
- Replace the UV disinfection system and relocate the control panel outside of the secondary treatment area.
- Replace the effluent pumps and associated discharge piping and valves.
- Cover the UV system and chlorine contact tank to mitigate freezing and algae growth.
- Replace the sludge transfer pumps and associated valves and piping and reconfigure the discharge piping to allow for transfer from one basin to another.
- Replace the building lighting with modern energy efficient fixtures.
- Complete laboratory renovations.

A. BACKGROUND

To evaluate and size facilities for a wastewater management system, future population, wastewater flows and pollutant loadings must be estimated for the planning area. Wastewater flows and loadings are a function of sewered population, per capita water use, commercial and industrial discharges, public authority flows, Infiltration/Inflow (I/I), and hauled-in waste.

This Section defines the planning period, estimates future population, projects future flows and loadings, and established future effluent limitations.

B. PLANNING PERIOD

The planning period is the time period over which a wastewater management system is evaluated for cost effectiveness. The planning period begins with the system's initial year of operation. According to United States Environmental Protection Agency (EPA) and Wisconsin DNR regulations, the planning period for a Facilities Plan shall be 20-years [NR 110.09(1)]. For purposes of this Facilities Plan Amendment, the planning period will be to the year 2045.

C. DESIGN PERIOD

The design period is the time period during which a wastewater management system is expected to reach design capacity. For wastewater treatment facilities, three (3) alternative staging periods of 10-, 15- and 20-years should be analyzed for cost effectiveness, and the least costly period selected [NR 110.09(1)]. A second method of determining the staging period is based upon the following table, contained in NR 110.

FLOW GROWTH	MINIMUM INITIAL STAGING PERIOD
Design Flow Less Than 1.3 Times Initial Flow	20-Years
Design Flow 1.3 To 1.8 Times Initial Flow	15-Years
Design Flow Greater Than 1.8 Times Initial Flow	10-Years

The estimates of flows and loadings developed in this Section will be used to determine the staging period for the Village of Ephraim's Wastewater Treatment Facility.

D. POPULATION ESTIMATES

Historical populations and trends for the Village of Ephraim are shown below:

YEAR	POPULATION	PERCENT CHANGE
1960	221	--
1970	236	6.8%
1980	319	35.2%
1990	261	-18.2%
2000	353	35.2%
2010	288	-18.4%
2020	345	19.8%

The Wisconsin Department of Administration (DOA) provided the following population projections for the Village of Ephraim.

YEAR	DOA PROJECTED POPULATION	ACTUAL POPULATION
2020	280	345
2025	275	--
2030	265	--
2035	255	--
2040	235	--

Note that the Wisconsin DOA estimated a population of 280 for 2020, while the actual population observed from the 2020 Decennial Census for the Village of Ephraim was 345 (a difference of 65 residents). Based on the Wisconsin DOA's population projections, the Village of Ephraim's population is projected to decrease over the planning period.

Wisconsin DOA population projections for all of Door County are included below. Adjusted populations were calculated based on the difference between the 2020 DOA projected population and the 2020 Decennial Census population. These projections will be used to estimate future hauled in waste flows and loadings.

YEAR	DOA PROJECTED POPULATION	PERCENT CHANGE (%)	ACTUAL POPULATION
2020	27,518	--	30,066
2025	27,896	+1.4	--
2030	27,889	-0.0	--
2035	27,207	-2.4	--
2040	26,029	-4.3	--

Based on the adjusted Wisconsin DOA's population projections, the population of Door County is expected to peak in 2025 before declining over the next 15 years.

E. CURRENT WWTF FLOWS & LOADINGS

Influent raw wastewater from the Village’s collection system is metered and sampled prior to discharging to the Headworks. The hauled-in waste is metered and sampled separate from the raw wastewater from the collection system.

Influent flows and loadings from 2019 through 2023 for the Village’s collection system only are summarized below in Table #4. Additional tables showing monthly influent flows and loadings from the collection system between 2019 through 2023 are provided in Appendix #2.

**TABLE #4
SUMMARY OF INFLUENT FLOWS & LOADINGS - COLLECTION SYSTEM -
2019 THROUGH 2023**

Parameter	2019	2020	2021	2022	2023	Average	Max
Flow, mgd							
Average Day	0.088	0.082	0.074	0.080	0.065	0.079	-
Max Month	0.137	0.144	0.140	0.143	0.111	-	0.144
Max Day	0.264	0.203	0.182	0.184	0.197	-	0.264
BOD, lbs./day							
Average Day	89	75	101	68	46	79	-
Max Month	233	213	261	171	125	-	261
Max Day	458	237	290	257	154	-	458
TSS, lbs./day							
Average Day	93	85	110	69	52	86	-
Max Month	238	227	270	159	134	-	270
Max Day	472	334	301	219	161	-	472

Influent flows and loadings from the Village’s collection system have remained relatively consistent over the last five (5) years, with loadings generally decreasing slightly in 2022 compared to the previous years.

Hauled-in waste flows and loadings to the WWTF from 2019 through 2023 are summarized below in Table #5. Additional tables showing monthly hauled-in waste flows and loadings to the WWTF from 2019 through 2023 are provided in Appendix #2.

**TABLE #5
SUMMARY OF HAULED-IN WASTE FLOWS & LOADINGS -
2018 THROUGH MAY 2023**

Parameter	2019	2020	2021	2022	2023	Average	Max
Flow, gpd							
Average Day	1,559	1,493	1,255	1,281	407	1,198	-
Max Month	3,790	3,194	2,287	3,338	1,673	-	3,790
Max Day	20,000	12,700	9,400	13,100	8,400	-	20,000
BOD, lbs./day							
Average Day	11.3	7.9	4.8	5.5	5.1	6.8	-
Max Month	32.0	27.6	9.1	16.3	7.7	-	32.0
Max Day	131	137	37	46	25	-	137
TSS, lbs./day							
Average Day	19	13	4.7	7.9	7.2	10.3	-
Max Month	78	62	13	29	10.3	-	78
Max Day	345	321	65	101	53	-	345

Hauled-in waste flows and loadings appear to have been slowly decreasing over the last five (5) years.

F. WWTF DESIGN FLOWS & LOADINGS

As previously discussed, the Village of Ephraim’s population is not anticipated to increase over the 20 year planning period. Therefore, it is assumed that influent flows and loadings from the collection system will not increase from current flows and loadings.

The population of Door County as a whole is anticipated to peak in 2025 before decreasing over the next 15 years.

Projected future “combined” influent flows and loadings to the WWTF (collection system and hauled-in wastes) compared to current flows and loadings and the original WWTF design criteria are summarized below in Table #6.

**TABLE #6
PROJECTED FUTURE FLOWS & LOADINGS VS. DESIGN CRITERIA**

	¹ PEAK SEASON				¹ OFF-SEASON			
	² Current	Projected Future	Rated Capacity	³ of Capacity	² Current	Projected Future	Rated Capacity	³ of Capacity
Flow, mgd								
Average Day	0.114	0.114	0.310	37%	0.050	0.050	0.083	60%
Max Day	0.270	0.270	0.620	44%	0.197	0.197	0.165	119%
BOD, lbs./day								
Average Day	140	142	1,400	10%	33	33	300	11%
Max Day	466	466	2,100	22%	136	136	600	23%
TSS, lbs./day								
Average Day	151	152	1,200	13%	40	40	250	16%
Max Day	582	599	1,800	33%	298	311	500	62%
⁴ Total P, lbs./day								
Average Day	-	-	48	-	-	-	10	-
Max Day	-	-	72	-	-	-	20	-

¹Peak season is assumed to be May through October, while the off-season is assumed to be November through April.

²2019 through 2023 Average and Max Day values.

³% of Capacity based on projected future flows and loadings.

⁴Influent Total P is not monitored.

The existing WWTF has an abundance of reserve capacity to handle the projected future flows and loadings. It is also assumed that future flows and loadings to the WWTF will not increase over the planning period and that the rated capacity of the WWTF is sufficient. As such, this Facilities Plan Amendment does not aim to change the capacity of the WWTF.

G. STAGING ANALYSIS

The average peak season flow to the WWTF over the last four and a half years was 0.114 mgd, while the average off-season flow to the WWTF over the same time period was 0.050 mgd. The projected peak and off-season future flows to the facility are 0.114 mgd and 0.050 mgd, respectively, providing a ratio of 1.0. Per NR110, if the ratio is less than 1.3, a 20-year staging period can be used. Therefore, a 20-year staging period will be used.

H. FUTURE EFFLUENT LIMITATIONS

A summary of the project future flows and loadings and the plant's original design criteria were sent to the Wisconsin DNR on _____, 2023 along with a request for effluent limitations for Facilities Planning purposes.

The Wisconsin DNR calculated the following effluent limitations for the Village of Ephraim WWTF based on the future conditions provided. A copy of the memorandum from the Wisconsin DNR is provided in Appendix #3.

MONITORING REQUIREMENTS AND EFFLUENT LIMITATIONS

Parameter	Limit Type	Limit & Units	Sample Frequency	Notes
BOD ₅	Weekly Avg	45 mg/L	2/Week	
	Monthly Avg	30 mg/L	2/Week	
TSS	Weekly Avg	45 mg/L	2/Week	
	Monthly Avg	30 mg/L	2/Week	
NH ₃ -N	Daily Max	18 mg/L	Monthly	
	Weekly Avg	18 mg/L	Monthly	
	Monthly Avg	18 mg/L	Monthly	
pH Field	Daily Min	6.0 su	5/Week	
	Daily Max	9.0 su	5/Week	
E. coli	Geometric Mean -Monthly	126 #/100mL	Weekly	Limit effective April through October
	% Exceedance >410 #/100mL	10% per Month	Monthly	
Phosphorus, Total	Monthly Avg	0.6 mg/L	2/Week	

A. BACKGROUND

An Infiltration/Inflow (I/I) Analysis is an integral part of Facility Planning and is required per Wisconsin Administrative Code NR 110. The I/I Analysis shall demonstrate whether or not excess I/I exists in the sewer system and shall identify the presence, flow rate, and type of I/I conditions that exist in the sewer system.

Per NR 110, the definition of infiltration and inflow are:

- *“ ‘Infiltration’ means water other than wastewater that enters a sewerage system (including sewer service connections) from the ground through such sources as defective pipes, pipe joints, connections or manholes. Infiltration does not include, and is distinguished from, inflow.”*
- *“ ‘Inflow’ means water other than wastewater that enters a sewerage system (including sewer service connections) from sources such as roof leaders, cellar drains, yard drains, area drains, foundation drains, drains from springs and swampy areas, manhole covers, cross-connections between storm sewers and sanitary sewers, catch basins, cooling towers, storm waters, surface runoff, street wash water, or drainage. Inflow does not include, and is distinguished from, infiltration.”*

Per NR 110, the following information is required in an I/I Analysis:

- “(a) The infiltration/inflow analysis shall demonstrate whether or not excess infiltration/inflow exists in the sewer system. The analysis shall identify the presence, flow rate and type of infiltration/inflow conditions, which exist in the sewer system.*
- “(b) For determination of the possible existence of excessive infiltration/inflow, the analysis shall include an estimate of the cost of eliminating the infiltration/inflow conditions. These costs shall be compared with estimated total costs for transportation and treatment of the infiltration/flow. This determination shall be made at several levels of infiltration/inflow removal.*
- “(c) If the infiltration/inflow analysis demonstrates the existence or possible existence of excessive infiltration/inflow and the specific sources of excessive infiltration/inflow have not been adequately identified, a sewer system evaluation survey shall be conducted. A detailed plan for the sewer system evaluation survey shall be included in the infiltration/inflow analysis. The plan shall outline the tasks to be performed in the survey and their estimated costs.*
- “(d) The department (DNR) may waive the requirements of pars. (a) through (c) if the owner can demonstrate to the department’s satisfaction the obvious existence or nonexistence of excessive infiltration or inflow, or both. The information necessary for this demonstration may include infiltration and inflow estimates, per capita design flows, ratio*

of total flow to dry weather flow, cubic meters of infiltration per centimeter diameter per kilometer of pipe per day (gallons of infiltration per inch diameter per mile per day), bypassing, and other hydrological and geological factors. The department may require the information be expanded to meet the requirements of pars. (a) through (c) if this demonstration is inconclusive.”

By memorandum from the Wisconsin DNR, dated December 5, 1991, a simplistic I/I analysis can be used to determine whether or not excessive I/I exists in a sewer system. Two (2) methods are suggested:

The first method is from *Facilities Planning*; 1981, EPA 430/9-81-002. The criteria for judging when infiltration is non-excessive is listed below.

LENGTH OF SEWER PIPE	NON-EXCESSIVE INFILTRATION RATE
>100,000 feet	2,000 to 3,000 gpd/in-mi
10,000 to 100,000 feet	3,000 to 6,000 gpd/in-mi
< 10,000 feet	6,000 to 10,000 gpd/in-mi

The infiltration is based upon the highest 7-day to 14-day average infiltration within a 12-month period. The infiltration allowance determined above applies to both I/I Analysis and Sewer System Evaluation Survey (SSES).

A second method is provided in *I/I Analysis & Project Certification*; May, 1995, EPA:

Infiltration is non-excessive if Dry Weather Flows (DWF) \leq 120 gpcd

Inflow is non-excessive if Wet Weather Flows (WWF) \leq 275 gpcd and the treatment plant does not experience hydraulic overloads during storm events.

Inflow is excessive if WWF \geq 275 gpcd or the treatment plant experiences hydraulic overloads during storm events.

DWF = Highest average daily flow recorded over a 7- to 14-day period without precipitation during a period of seasonal high groundwater (typically March through July).

WWF = Highest daily flow recorded during a storm event.

B. INFILTRATION/INFLOW ANALYSIS

An I/I analysis was conducted using data for wastewater treatment influent flows and precipitation. Base flows were estimated as the minimum week flows for each year.

Precipitation data from 2019 through June 2023 was retrieved from the National Centers for Environmental Information’s (NCEI) database. The nearest weather station with the required data is located at the Ephraim WWTF. This information was accessed through the Midwest Regional Climate Center cli-MATE online application. The I/I Analysis for the Village of Ephraim is provided in Appendix #4.

The Village of Ephraim has approximately 36,447 linear feet, or 6.9 miles of gravity flow sanitary sewer in its collection system.

Diameter (in)	Length (ft)	In-Mile
8	31,311	47.4
10	5,136	9.7
Total	36,447	57.1

For communities with 10,000 to 100,000 linear feet of sewer, infiltration is non-excessive if the infiltration rate is between 3,000 to 6,000 gpd/in-mile. Infiltration is computed during a high groundwater period using 7 to 14-days consecutive flow data after rain, but not during rain events.

Infiltration rates ranged from 1,837 to 2,152 gpd/in-mile from 2019 through June 2023. Therefore, infiltration is not considered excessive.

A second method for determining whether infiltration is excessive is based on population. Infiltration is non-excessive if Dry Weather Flows (DWF) are less than 120 gpcd. It is important to consider the effect of tourism for this method, as the Village of Ephraim sees significant increases in tourism during the summer months. As outlined in an Executive Summary published by Destination Door County (DCC) in September 2022, which is included in Appendix #5, the visitor to resident ratio for the Village of Ephraim can increase up to 4.0 (September 2022) during the summer months. Typically, this ratio averages approximately 2.9 during the summer months. For the purposes of estimating infiltration and inflow rates, a population of 345 will be used for off-season months and a total population of 1,345 will be used for the peak season months. This is shown in Appendix #4.

Infiltration rates ranged from 78 to 91 gpcd from 2019 through June 2023. Therefore, infiltration would not be considered excessive using this method. However, this method may not be a very accurate estimate, as tourist populations can vary significantly throughout the year.

Inflow is considered excessive if the amount of wet weather flow to the WWTF exceeds 275 gpcd. WWTF influent flows were graphed together with precipitation data from 2019 through June 2023 to identify maximum day flows resulting from rainfall events. Graphs are included in Appendix #4. Inflows ranged from 108 to 197 gpcd from 2018 through June 2023. Therefore, inflow would not be considered excessive based on EPA criteria. Once again, this method may not be a very accurate estimate, as tourist populations can vary significantly throughout the year.

Peak inflow is estimated by taking the peak flow to the WWTF and subtracting the base flow. Base flow is estimated to be 0.0254 mgd (the average of the minimum week flows from 2019 through June 2023). According to the Ten States Standards, for a population of approximately 345, the peaking factor is 4.0. Similarly, for a population of approximately 1,345, the peaking factor is closer to 3.7.

Peak inflow to the WWTF occurred on August 12, 2019 (peak season), with an influent flow of 0.2643 mgd (183.5 gpm). Therefore, the peak hourly inflow to the WWTF would be approximately 0.0940 mgd (65.3 mgd, 3x 0.0254 mgd). The estimated peak inflow is:

- Peak Flow..... 183.5 gpm
- Estimated Peak Base Flow..... 65.3 gpm
- Estimated Peak Inflow..... 118.2 gpm

Again, this calculation may not be an appropriate estimate, as the tourist population varies significantly throughout the year.

C. ADDRESSING INFILTRATION/INFLOW

The sanitary collection system contains approximately 160 manholes, 36,447 feet of gravity sewer mains, and 23,115 feet of force mains. The Village is aware of the presence of inflow and infiltration in their system and has undertaken efforts to address the issue.

Most of the Village is served by a gravity sewer collection system, originally constructed in 1986, and two (2) sewerage lift stations, one at the public beach (Lift Station #1) and the other at the intersection of Spruce Street and Water Street (Lift Station #2). Lift Station #2 accepts and pumps most of the Village’s wastewater in an 8-inch force main to a newer section of gravity sewer on STH 42 flowing directly to the WWTF. Additional sanitary sewers and a WWTF on-site lift station were constructed in 2005 to serve the areas along STH 42 and Town Line Road near the WWTF. Properties along the bluff on the north (North Shore Road) and south (Crystal Springs Road) ends of the collection systems are served by individual grinder pump stations and common low pressure sewer systems, which connect to the main collection system.

The Village’s sanitary sewer collection system is generally believed to be in good condition. However, there are several unused lateral stubs at vacant lots along Larson Lane, Hidden Springs Road, and Brookside Lane that are believed to be leaking and a source of clear water (infiltration) to the collection system and WWTF.

Ongoing assessments occur each year in conjunction with planned roadway reconstruction projects throughout the City. Mains that are found to be in poor or questionable condition are budgeted to be replaced as part of the roadway project.

A formal SSES is not recommended for the Village of Ephraim’s collection system at this time. As discussed in NR 110.09(5)(c), an SSES shall be conducted when the specific sources of excessive inflow and infiltration have not been adequately identified. The Village of Ephraim is actively identifying and addressing inflow and infiltration problem areas.

A. INTRODUCTION

Prior to evaluating specific wastewater treatment alternatives, wastewater management options require evaluation on the planning level. These options include the 'No Action' Alternative and regional treatment with a neighboring WWTF.

This Chapter summarizes and evaluates planning level alternatives. A preliminary screening was completed to identify those alternatives that are applicable to the Village. Those alternatives surviving the preliminary screening process are evaluated for cost effectiveness in Chapter VIII.

B. 'NO ACTION' ALTERNATIVE

The 'No Action' alternative consists of maintaining status quo conditions with the WWTF. In this alternative, no WWTF improvements or modifications would be implemented.

The Village of Ephraim's WWTF can consistently meet their current effluent permit limits. However, much of the existing infrastructure is original to the 1986 construction and has surpassed its design service life, or is nearing its service life, as it approaches 40-years in service. Additionally, improvements to many of the unit treatment processes are necessary to improve efficiency, operability, maintainability, and safety. Therefore, the 'No Action' alternative is not a feasible long-term solution.

C. REGIONAL TREATMENT ALTERNATIVE

The regional treatment alternative considers joint treatment with another community. Neighboring municipal WWTF's to the Village of Ephraim include the Village of Sister Bay, which is approximately 3-miles northeast from Ephraim's WWTF, the Fish Creek Sanitary District #1, which is approximately 6-miles southwest from Ephraim's WWTF, and the Town of Baileys Harbor, which is approximately 10-miles south from Ephraim's WWTF.

Neither the Fish Creek Sanitary District #1's or the Town of Baileys Harbor's WWTF's have sufficient reserve treatment capacity to accept wastewater from the Village of Ephraim. The cost to improve their treatment facilities coupled with the cost to convey the wastewater to either municipality would far exceed the cost to upgrade the Village of Ephraim's WWTF.

[Does Sister Bay have sufficient reserve capacity?]

D. WASTEWATER COLLECTION & TREATMENT FACILITIES IMPROVEMENTS

The main objective of this Facility Plan Amendment is to determine the most cost-effective means addressing the aging infrastructure and impending needs at the WWTF. Applicable wastewater treatment alternatives should: (1) extend the service life of the existing facilities, (2) improve operator safety, (3), improve operability and maintainability, (4) maintain reserve treatment capacity for future growth, and (5) achieve compliance with permit effluent limits.

1. COLLECTION SYSTEM

Based on an assessment of the existing collection system facilities, improvements are needed at both lift stations, and the sections of sewer with leaking lateral stubs.

a. Lift Station #1 Improvements

- Replacement of the submersible pumps, slide rail systems, and wet well access hatch, to improve Operator safety and increase capacity.
 - ▶ Lift Station #1 has had issues with ragging and capacity. Therefore, the new pumps should have improved capacity and solids handling.
- Replacement of the discharge piping and valves, electrical systems, controls, and telemetry to extend service life and improve operability and maintainability.
- Replacement of the backup generator, if necessary, to operate the larger pumps.

b. Lift Station #2 Improvements

- Complete replacement of the lift station with a submersible type lift station to improve operator safety, operability, and maintainability.
 - ▶ The existing wet well would be converted to a flow through manhole discharging to the new lift station wet well.
- Replacement of the backup generator and integration of fire and intrusion monitoring in the Smith Building to extend service life and improve security.

c. Sewer Lining

- Line the sections of sewer with leaking lateral stubs to reduce infiltration.

An Opinion of Probable Construction Cost (OPCC) will be completed for these proposed Collection System improvements.

2. PRELIMINARY TREATMENT

Based on an assessment of the existing preliminary treatment facilities, improvements are needed at the Influent Pump Station, Headworks, and Hauled-In Waste Receiving.

a. Influent Pump Station Improvements

- Replacement of the wet well access hatch to improve Operator safety.
- Replacement of the submersible pumps and provide variable speed control for the new pumps to improve operability and efficiency.
- Relocating the MCC and controls out of the potentially hazardous and corrosive area to extend service life and improve operator safety.

b. Headworks Improvements

- Replacement of the fine screen, grit removal equipment, and the air lift type grit transfer system with a self-priming grit pump, to improve Operator safety, efficiency, operability, and maintainability.
- Complete HVAC system replacement to contain odors and remove corrosive and hazardous gases from the area to extend service life and improve operator safety.

c. Hauled-In Waste Receiving Improvements

- Replacement of the screening equipment and holding tank access hatches to improve operability and maintainability.
- Concrete repairs to the holding tank cover and repairs to the interior of the tanks to extend service life.
- Replacement of the transfer piping valves and replacement or re-painting of the transfer piping to extend service life and improve operability.
- Providing a new tanker truck.

An OPCC will be completed for these proposed Preliminary Treatment improvements.

3. SECONDARY TREATMENT

Based on an assessment of the existing secondary treatment facilities, improvements are needed to the blowers, aeration piping and mixing, secondary clarifiers, and chemical feed systems.

a. Blowers, Aeration, & Mixing Improvements

- Replacement of the existing blowers and provide new aeration basin mixers and reconfiguration of the air supply piping to improve operability, maintainability, and efficiency.

b. Secondary Clarifier Improvements

- Replacement of the final clarifier chain and sludge scraper to improve operability, maintainability, and efficiency.

c. Chemical Feed Improvements

- Replacement of the alum feed pumps, piping, and accessories, and repairs to the alum storage tank and containment area, as necessary, to extend service life, improve operability and maintainability, and to maintain permit compliance.
- Install an effluent orthophosphate analyzer to maintain permit compliance.

An OPCC will be completed for these proposed Secondary Treatment improvements.

4. TERTIARY TREATMENT & EFFLUENT DISCHARGE

Based on an assessment of the existing tertiary treatment and effluent discharge systems, improvements are needed to the effluent discharge pumps.

- Replacement of the effluent pumps to extend service life and improve operability and maintainability.

An OPCC will be completed for these proposed Plant Effluent or UV Disinfection System improvements.

5. SOLIDS HANDLING

Based on an assessment of the existing solids handling facilities, the proposed improvements to the solids handling facilities include:

- Replacement of the sludge transfer pumps and associated discharge piping and valves to allow for transfer from one basin to another, to extend service life and improve operability and maintainability.
- Modifications to the aerated sludge holding tank piping and valves to improve sludge thickening.

An OPCC will be completed for these proposed Solids Handling improvements.

6. ELECTRICAL, CONTROLS, & SCADA

Based on an assessment of the existing electrical and controls systems, the following improvements are recommended.

- Replacement of the main MCC, plant controls, and SCADA system to extend service life and improve operability and maintainability.

- Replacement of the emergency backup generator with a new outdoor generator to extend service life.

An OPCC will be completed for these proposed electrical, controls and SCADA systems improvements.

7. MAIN TREATMENT BUILDING & SITE IMPROVEMENTS

Proposed improvements to the main treatment building and treatment site include:

- Replace the membrane roofing systems on existing buildings, if necessary.
- Paint exposed metal surfaces.
- Replace entry and overhead doors that show signs of extensive corrosion.
- Complete laboratory renovations.
- Replace building lighting with modern energy efficient fixtures and LED lighting.
- Mill and overlay the existing asphalt paving.

An OPCC will be completed for these proposed Plant Controls and General Site Work improvements.

DRAFT

Chapter VIII
Opinions of Probable Cost

DRAFT

**Chapter IX
Recommended Plan**

PROJECTS \ E0035 \ 092200363 \ ADMIN \ REPORTS \ FACILITY PLAN AMENDMENT

DRAFT

DRAFT



WPDES PERMIT

STATE OF WISCONSIN
DEPARTMENT OF NATURAL RESOURCES
**PERMIT TO DISCHARGE UNDER THE WISCONSIN POLLUTANT DISCHARGE
ELIMINATION SYSTEM**

Village of Ephraim

is permitted, under the authority of Chapter 283, Wisconsin Statutes, to discharge from a facility
located at
10285 Townline Road, Ephraim, Wisconsin
to

Green Bay (Water Body Identification Code number 70) of Lake Michigan

in accordance with the effluent limitations, monitoring requirements and other conditions set
forth in this permit.

The permittee shall not discharge after the date of expiration. If the permittee wishes to continue to discharge after this expiration date an application shall be filed for reissuance of this permit, according to Chapter NR 200, Wis. Adm. Code, at least 180 days prior to the expiration date given below.

State of Wisconsin Department of Natural Resources
For the Secretary

By


Heidi Schmitt Marquez
Wastewater Field Supervisor

April 28, 2022
Date Permit Signed/Issued for Modification

PERMIT TERM: EFFECTIVE DATE - January 01, 2022
EFFECTIVE DATE OF MODIFICATION: May 01, 2022

EXPIRATION DATE - December 31, 2026

TABLE OF CONTENTS

1 INFLUENT REQUIREMENTS	1
1.1 SAMPLING POINT(S)	1
1.2 MONITORING REQUIREMENTS	1
1.2.1 <i>Sampling Point 701 - Influent - Collection System; 702- Influent - Septage</i>	1
1.2.2 <i>Sampling Point 703 - Influent - Calculated</i>	1
2 SURFACE WATER REQUIREMENTS	3
2.1 SAMPLING POINT(S)	3
2.2 MONITORING REQUIREMENTS AND EFFLUENT LIMITATIONS	3
2.2.1 <i>Sampling Point (Outfall) 001 - Effluent</i>	3
3 LAND APPLICATION REQUIREMENTS	6
3.1 SAMPLING POINT(S)	6
3.2 MONITORING REQUIREMENTS AND LIMITATIONS	6
3.2.1 <i>Sampling Point (Outfall) 002 - Liquid Sludge</i>	6
4 STANDARD REQUIREMENTS	11
4.1 REPORTING AND MONITORING REQUIREMENTS	11
4.1.1 <i>Monitoring Results</i>	11
4.1.2 <i>Sampling and Testing Procedures</i>	11
4.1.3 <i>Recording of Results</i>	11
4.1.4 <i>Reporting of Monitoring Results</i>	12
4.1.5 <i>Compliance Maintenance Annual Reports</i>	12
4.1.6 <i>Records Retention</i>	12
4.1.7 <i>Other Information</i>	13
4.1.8 <i>Reporting Requirements – Alterations or Additions</i>	13
4.2 SYSTEM OPERATING REQUIREMENTS	13
4.2.1 <i>Noncompliance Reporting</i>	13
4.2.2 <i>Flow Meters</i>	14
4.2.3 <i>Raw Grit and Screenings</i>	14
4.2.4 <i>Sludge Management</i>	14
4.2.5 <i>Prohibited Wastes</i>	14
4.2.6 <i>Bypass</i>	14
4.2.7 <i>Scheduled Bypass</i>	14
4.2.8 <i>Controlled Diversions</i>	15
4.2.9 <i>Proper Operation and Maintenance</i>	15
4.2.10 <i>Operator Certification</i>	15
4.3 SEWAGE COLLECTION SYSTEMS	16
4.3.1 <i>Sanitary-Sewage-Overflows and Sewage-Treatment-Facility-Overflows</i>	16
4.3.2 <i>Capacity, Management, Operation and Maintenance (CMOM) Program</i>	17
4.3.3 <i>Sewer Cleaning Debris and Materials</i>	17
4.4 SURFACE WATER REQUIREMENTS	18
4.4.1 <i>Permittee-Determined Limit of Quantitation Incorporated into this Permit</i>	18
4.4.2 <i>Appropriate Formulas for Effluent Calculations</i>	18
4.4.3 <i>Effluent Temperature Requirements</i>	18
4.4.4 <i>Visible Foam or Floating Solids</i>	19
4.4.5 <i>Surface Water Uses and Criteria</i>	19
4.4.6 <i>Percent Removal</i>	19
4.4.7 <i>E. coli</i>	19
4.4.8 <i>Seasonal Disinfection</i>	19
4.5 LAND APPLICATION REQUIREMENTS	20
4.5.1 <i>Sludge Management Program Standards And Requirements Based Upon Federally Promulgated Regulations</i>	20
4.5.2 <i>General Sludge Management Information</i>	20

<i>4.5.3 Sludge Samples</i>	20
<i>4.5.4 Land Application Characteristic Report</i>	20
<i>4.5.5 Calculation of Water Extractable Phosphorus</i>	20
<i>4.5.6 Monitoring and Calculating PCB Concentrations in Sludge</i>	20
<i>4.5.7 Annual Land Application Report</i>	21
<i>4.5.8 Other Methods of Disposal or Distribution Report</i>	21
<i>4.5.9 Approval to Land Apply</i>	21
<i>4.5.10 Soil Analysis Requirements</i>	21
<i>4.5.11 Land Application Site Evaluation</i>	21
<i>4.5.12 Sludge Hauling</i>	22
5 SUMMARY OF REPORTS DUE	23

DRAFT

1 Influent Requirements

1.1 Sampling Point(s)

Sampling Point Designation	
Sampling Point Number	Sampling Point Location, Waste Type/Sample Contents and Treatment Description (as applicable)
701	Influent - Collection System: Influent from the sanitary sewage collection system. Representative samples shall be collected from the automatic sampling device drawing samples from the influent pipe prior to the wetwell.
702	Influent - Septage: Influent from the septage receiving stations east and west holding tanks. Representative samples shall be collected from the automatic sampling device drawing samples from the discharge pipe from the holding tanks prior to the wetwell.
703	Influent - Calculated: Calculated total combined influent loading from sample points 701 and 702.

1.2 Monitoring Requirements

The permittee shall comply with the following monitoring requirements.

1.2.1 Sampling Point 701 - Influent - Collection System; 702- Influent - Septage

Monitoring Requirements and Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Flow Rate		MGD	Daily	Continuous	See Section 1.2.1.1
BOD ₅ , Total		mg/L	2/Week	24-Hr Flow Prop Comp	See Section 1.2.1.2
Suspended Solids, Total		mg/L	2/Week	24-Hr Flow Prop Comp	See Section 1.2.1.2

1.2.1.1 Reporting of Flow Rate at 702

If no septage is pumped into the treatment system on any given day, a value of zero (0) shall be reported for that day on the Discharge Monitoring Report (DMR) form.

1.2.1.2 Sampling Events at 701 & 702

Influent samples at sample points 701 & 702 shall be collected during the same 24-hour period.

1.2.2 Sampling Point 703 - Influent - Calculated

Monitoring Requirements and Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Flow Rate		MGD	Daily	Calculated	See Section 1.2.2.1
BOD ₅ , Total		mg/L	2/Week	Calculated	See Section 1.2.2.2
Suspended Solids, Total		mg/L	2/Week	Calculated	See Section 1.2.2.2

1.2.2.1 Calculation of Combined Daily Flow

The permittee shall use the following formula to calculate and report Total Combined Daily Flow:

$$\text{Total Daily Flow 703 (MGD)} = \text{Daily Flow at 701 (MGD)} + \text{Daily Flow at 702 (MGD)}$$

1.2.2.2 Calculation of Combined Concentration

The permittee shall use the following formula to calculate and report the combined concentrations for BOD5 and Suspended Solids at sample point 703.

$$\text{Concentration at 703 (mg/L)} = \frac{[\text{Flow at 701 (MGD)} \times \text{Concentration at 701 (mg/L)}] + [\text{Flow at 702 (MGD)} \times \text{Concentration at 702 (mg/L)}]}{\text{Flow at 701 (MGD)} + \text{Flow at 702 (MGD)}}$$

1.2.2.3 Combined Collection System Influent and Septage Sampling

In lieu of calculating the flow and pollutant concentrations at sample point 703, the permittee may make the necessary facility modifications to collect actual samples of the combined influent. Plans and specifications of the proposed modifications must be submitted to the Department for approval prior to making those modifications. The permittee must provide written notification to the Department 30 days prior to beginning collection of actual combined influent samples at sample point 703. The Department will then change the "Sample Type" description of sample point 703 from "Calculated" to "24-Hr flow proportional composite". Upon beginning collection of actual combined influent samples at sample point 703, the requirement to monitor sample point 701 will be discontinued, and likewise the requirement to monitor sample point 702 for BOD5 and Total Suspended Solids will be discontinued, however the requirement for flow monitoring at sample point 702 will remain. These modifications to the influent sample points and the associated modifications to the permit will be made without public notice.

2 Surface Water Requirements

2.1 Sampling Point(s)

Sampling Point Designation	
Sampling Point Number	Sampling Point Location, Waste Type/Sample Contents and Treatment Description (as applicable)
001	Effluent: Representative composite samples shall be collected from the automatic sampling device drawing samples after the final clarifier and prior to the UV disinfection unit. Representative grab type samples for pH and <i>E. coli</i> shall be collected after the UV disinfection unit.

2.2 Monitoring Requirements and Effluent Limitations

The permittee shall comply with the following monitoring requirements and limitations.

2.2.1 Sampling Point (Outfall) 001 - Effluent

Monitoring Requirements and Effluent Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Flow Rate		MGD	Daily	Continuous	
BOD ₅ , Total	Weekly Avg	45 mg/L	2/Week	24-Hr Flow Prop Comp	
BOD ₅ , Total	Monthly Avg	30 mg/L	2/Week	24-Hr Flow Prop Comp	
Suspended Solids, Total	Weekly Avg	45 mg/L	2/Week	24-Hr Flow Prop Comp	
Suspended Solids, Total	Monthly Avg	30 mg/L	2/Week	24-Hr Flow Prop Comp	
pH Field	Daily Min	6.0 su	5/Week	Grab	
pH Field	Daily Max	9.0 su	5/Week	Grab	
<i>E. coli</i>	Geometric Mean - Monthly	126 #/100 ml	Weekly	Grab	Limit applies May through September annually.
<i>E. coli</i>	% Exceedance	10 Percent	Monthly	Calculated	Limit applies May through September annually. See section 2.2.1.2 for details on the <i>E. coli</i> percent limit. Enter the result in the DMR on the last day of the month.
Nitrogen, Ammonia (NH ₃ -N) Total	Daily Max	18 mg/L	Monthly	24-Hr Flow Prop Comp	
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	18 mg/L	Monthly	24-Hr Flow Prop Comp	
Nitrogen, Ammonia (NH ₃ -N) Total	Weekly Avg	18 mg/L	Monthly	24-Hr Flow Prop Comp	

Monitoring Requirements and Effluent Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Phosphorus, Total	Monthly Avg	0.6 mg/L	2/Week	24-Hr Flow Prop Comp	
Arsenic, Total Recoverable		µg/L	Monthly	24-Hr Flow Prop Comp	Monitoring only in calendar year 2023. See section 2.2.1.3 for analytical requirements.
Nitrogen, Total Kjeldahl		mg/L	See Listed Qtr(s)	24-Hr Flow Prop Comp	Annual in rotating quarters. See section 2.2.1.4 for Nitrogen Series Monitoring requirements and test schedule.
Nitrogen, Nitrite + Nitrate Total		mg/L	See Listed Qtr(s)	24-Hr Flow Prop Comp	Annual in rotating quarters. See section 2.2.1.4 for Nitrogen Series Monitoring requirements and test schedule.
Nitrogen, Total		mg/L	See Listed Qtr(s)	Calculated	Annual in rotating quarters. See section 2.2.1.4 for Nitrogen Series Monitoring requirements and test schedule. Total Nitrogen shall be calculated as the sum of reported values for Total Kjeldahl Nitrogen and Total Nitrite + Nitrate Nitrogen.

2.2.1.1 Annual Average Design Flow

The annual average design flow of the permittee’s wastewater treatment facility is 0.31 MGD.

2.2.1.2 E. coli Percent Limit

No more than 10 percent of *E. coli* bacteria samples collected in any calendar month may exceed 410 #/100 ml. Bacteria samples may be collected more frequently than required. All samples shall be reported on the monthly discharge monitoring reports (DMRs). The following calculation should be used to calculate percent exceedances.

$$\frac{\text{\# of Samples greater than 410 \#/100}}{\text{Total \# of samples}} \times 100 = \% \text{ Exceedance}$$

2.2.1.3 Arsenic Monitoring – Analytical Requirements

Samples shall be analyzed using an approved analytical method from chapter NR 219, Wis. Adm. Code, with a limit of detection (LOD) below the regulatory limit of 0.2 µg/L. If the required level of detection cannot be met by any of the methods available in ch. NR 219, Wis. Adm. Code, then the method with the lowest limit of detection shall be used.

2.2.1.4 Nitrogen Series Monitoring

Monitoring for Total Kjeldahl Nitrogen (TKN), Nitrite + Nitrate Nitrogen, and Total Nitrogen shall be conducted once each year in rotating quarters in order to collect seasonal information about the discharge. Tests are required during the following quarters:

- 3rd Quarter (July 1 to September 30) 2022
- 4th Quarter (October 1 to December 31) 2023
- 1st Quarter (January 1 to March 31) 2024
- 2nd Quarter (April 1 to June 30) 2025
- 3rd Quarter (July 1 to September 30) 2026

Nitrogen Series monitoring shall continue after the permit expiration date (until the permit is reissued) in accordance with the monitoring requirements specified in the last full calendar year of this permit. For example, the next test would be required in 3rd Quarter (July 1 to September 30) 2027.

Testing: Monitoring shall be performed during normal operating conditions. Permittees are not allowed to turn off or otherwise modify treatment systems, production processes, or change other operating or treatment conditions during testing.

3 Land Application Requirements

3.1 Sampling Point(s)

The discharge(s) shall be limited to land application of the waste type(s) designated for the listed sampling point(s) on Department approved land spreading sites or by hauling to another facility.

Sampling Point Designation	
Sampling Point Number	Sampling Point Location, Waste Type/Sample Contents and Treatment Description (as applicable)
002	Class B, Liquid, Aerobically digested biosolids. Representative samples of the aerobically digested liquid sludge shall be collected from the digester. Results of all sludge analyses shall be reported on form 3400-49 "Waste Characteristics Report". Requirements for land application of sludge shall be assured and form 3400-55 "Land Application Report" shall be submitted if sludge is disposed of by land application. If sludge is disposed of by hauling to another facility the permittee shall analyze for List 1 parameters one time annually and shall also submit Form 3400-52 "Other Methods of Disposal or Distribution". All reports required by this section shall be submitted by January 31 following each year that sludge disposal occurs.

3.2 Monitoring Requirements and Limitations

The permittee shall comply with the following monitoring requirements and limitations.

3.2.1 Sampling Point (Outfall) 002 - Liquid Sludge

Monitoring Requirements and Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Solids, Total		Percent	Annual	Composite	Limits apply only when sludge is land applied.
Arsenic Dry Wt	Ceiling	75 mg/kg	Annual	Composite	
Arsenic Dry Wt	High Quality	41 mg/kg	Annual	Composite	
Cadmium Dry Wt	Ceiling	85 mg/kg	Annual	Composite	
Cadmium Dry Wt	High Quality	39 mg/kg	Annual	Composite	
Copper Dry Wt	Ceiling	4,300 mg/kg	Annual	Composite	
Copper Dry Wt	High Quality	1,500 mg/kg	Annual	Composite	
Lead Dry Wt	Ceiling	840 mg/kg	Annual	Composite	
Lead Dry Wt	High Quality	300 mg/kg	Annual	Composite	
Mercury Dry Wt	Ceiling	57 mg/kg	Annual	Composite	
Mercury Dry Wt	High Quality	17 mg/kg	Annual	Composite	
Molybdenum Dry Wt	Ceiling	75 mg/kg	Annual	Composite	
Nickel Dry Wt	Ceiling	420 mg/kg	Annual	Composite	
Nickel Dry Wt	High Quality	420 mg/kg	Annual	Composite	
Selenium Dry Wt	Ceiling	100 mg/kg	Annual	Composite	
Selenium Dry Wt	High Quality	100 mg/kg	Annual	Composite	
Zinc Dry Wt	Ceiling	7,500 mg/kg	Annual	Composite	
Zinc Dry Wt	High Quality	2,800 mg/kg	Annual	Composite	

Monitoring Requirements and Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Nitrogen, Total Kjeldahl		Percent	Annual	Composite	Monitoring required only when sludge is land applied.
Nitrogen, Ammonium (NH ₄ -N) Total		Percent	Annual	Composite	
Phosphorus, Total		Percent	Annual	Composite	
Phosphorus, Water Extractable		% of Tot P	Annual	Composite	
Potassium, Total Recoverable		Percent	Annual	Composite	
PCB Total Dry Wt	Ceiling	50 mg/kg	Once	Composite	Monitoring required in 2023; see Sections 3.2.1.4 and 4.5.6 for monitoring requirements. Limits apply only when sludge is land applied.
PCB Total Dry Wt	High Quality	10 mg/kg	Once	Composite	

Other Sludge Requirements	
Sludge Requirements	Sample Frequency
List 3 Requirements – Pathogen Control: The requirements in List 3 shall be met prior to land application of sludge.	Required only when sludge is land applied
List 4 Requirements – Vector Attraction Reduction: The vector attraction reduction shall be satisfied prior to, or at the time of land application as specified in List 4.	Required only when sludge is land applied

3.2.1.1 List 2 Analysis

Monitoring for List 2 parameters is required prior to land application of sludge.

3.2.1.2 Changes in Feed Sludge Characteristics

If a change in feed sludge characteristics, treatment process, or operational procedures occurs which may result in a significant shift in sludge characteristics, the permittee shall reanalyze the sludge for List 1, 2, 3 and 4 parameters each time such change occurs.

3.2.1.3 Sludge Which Exceeds the High Quality Limit

Cumulative pollutant loading records shall be kept for all bulk land application of sludge which does not meet the high quality limit for any parameter. This requirement applies for the entire calendar year in which any exceedance of Table 3 of s. NR 204.07(5)(c), is experienced. Such loading records shall be kept for all List 1 parameters for each site land applied in that calendar year. The formula to be used for calculating cumulative loading is as follows:

$$[(\text{Pollutant concentration (mg/kg)} \times \text{dry tons applied/ac}) \div 500] + \text{previous loading (lbs/acre)} = \text{cumulative lbs pollutant per acre}$$

When a site reaches 90% of the allowable cumulative loading for any metal established in Table 2 of s. NR 204.07(5)(b), the Department shall be so notified through letter or in the comment section of the annual land application report (3400-55).

3.2.1.4 Sludge Analysis for PCBs

The permittee shall analyze the sludge for Total PCBs one time during **2023**. The results shall be reported as "PCB Total Dry Wt". Either congener-specific analysis or Aroclor analysis shall be used to determine the PCB concentration. The permittee may determine whether Aroclor or congener specific analysis is performed. Analyses shall be performed in accordance with Table EM in s. NR 219.04, Wis. Adm. Code and the conditions specified in Standard Requirements of this permit. PCB results shall be submitted by January 31, following the specified year of analysis.

3.2.1.5 Lists 1, 2, 3, and 4

List 1 TOTAL SOLIDS AND METALS
See the Monitoring Requirements and Limitations table above for monitoring frequency and limitations for the List 1 parameters
Solids, Total (percent)
Arsenic, mg/kg (dry weight)
Cadmium, mg/kg (dry weight)
Copper, mg/kg (dry weight)
Lead, mg/kg (dry weight)
Mercury, mg/kg (dry weight)
Molybdenum, mg/kg (dry weight)
Nickel, mg/kg (dry weight)
Selenium, mg/kg (dry weight)
Zinc, mg/kg (dry weight)

List 2 NUTRIENTS
See the Monitoring Requirements and Limitations table above for monitoring frequency for the List 2 parameters
Solids, Total (percent)
Nitrogen Total Kjeldahl (percent)
Nitrogen Ammonium (NH4-N) Total (percent)
Phosphorus Total as P (percent)
Phosphorus, Water Extractable (as percent of Total P)
Potassium Total Recoverable (percent)

List 3

PATHOGEN CONTROL FOR CLASS B SLUDGE

The permittee shall implement pathogen control as listed in List 3. The Department shall be notified of the pathogen control utilized and shall be notified when the permittee decides to utilize alternative pathogen control.

The following requirements shall be met prior to land application of sludge.

Parameter	Unit	Limit
Fecal Coliform*	MPN/gTS or CFU/gTS	2,000,000
OR, ONE OF THE FOLLOWING PROCESS OPTIONS		
Aerobic Digestion		Air Drying
Anaerobic Digestion		Composting
Alkaline Stabilization		PSRP Equivalent Process
* The Fecal Coliform limit shall be reported as the geometric mean of 7 discrete samples on a dry weight basis.		

List 4

VECTOR ATTRACTION REDUCTION

The permittee shall implement any one of the vector attraction reduction options specified in List 4. The Department shall be notified of the option utilized and shall be notified when the permittee decides to utilize an alternative option.

One of the following shall be satisfied prior to, or at the time of land application as specified in List 4.

Option	Limit	Where/When it Shall be Met
Volatile Solids Reduction	≥38%	Across the process
Specific Oxygen Uptake Rate	≤1.5 mg O ₂ /hr/g TS	On aerobic stabilized sludge
Anaerobic bench-scale test	<17 % VS reduction	On anaerobic digested sludge
Aerobic bench-scale test	<15 % VS reduction	On aerobic digested sludge
Aerobic Process	>14 days, Temp >40°C and Avg. Temp > 45°C	On composted sludge
pH adjustment	>12 S.U. (for 2 hours) and >11.5 (for an additional 22 hours)	During the process
Drying without primary solids	>75 % TS	When applied or bagged
Drying with primary solids	>90 % TS	When applied or bagged
Equivalent Process	Approved by the Department	Varies with process
Injection	-	When applied
Incorporation	-	Within 6 hours of application

3.2.1.6 Daily Land Application Log

Daily Land Application Log		
Discharge Monitoring Requirements and Limitations		
<p>The permittee shall maintain a daily land application log for biosolids land applied each day when land application occurs. The following minimum records must be kept, in addition to all analytical results for the biosolids land applied. The log book records shall form the basis for the annual land application report requirements.</p>		
Parameters	Units	Sample Frequency
DNR Site Number(s)	Number	Daily as used
Outfall number applied	Number	Daily as used
Acres applied	Acres	Daily as used
Amount applied	As appropriate * /day	Daily as used
Application rate per acre	unit */acre	Daily as used
Nitrogen applied per acre	lb/acre	Daily as used
Method of Application	Injection, Incorporation, or surface applied	Daily as used

*gallons, cubic yards, dry US Tons or dry Metric Tons

4 Standard Requirements

NR 205, Wisconsin Administrative Code: The conditions in ss. NR 205.07(1) and NR 205.07(2), Wis. Adm. Code, are included by reference in this permit. The permittee shall comply with all of these requirements. Some of these requirements are outlined in the Standard Requirements section of this permit. Requirements not specifically outlined in the Standard Requirement section of this permit can be found in ss. NR 205.07(1) and NR 205.07(2).

4.1 Reporting and Monitoring Requirements

4.1.1 Monitoring Results

Monitoring results obtained during the previous month shall be summarized and reported on a Department Wastewater Discharge Monitoring Report. The report may require reporting of any or all of the information specified below under 'Recording of Results'. This report is to be returned to the Department no later than the date indicated on the form. A copy of the Wastewater Discharge Monitoring Report Form or an electronic file of the report shall be retained by the permittee.

Monitoring results shall be reported on an electronic discharge monitoring report (eDMR). The eDMR shall be certified electronically by a responsible executive or municipal officer, manager, partner or proprietor as specified in s. 283.37(3), Wis. Stats., or a duly authorized representative of the officer, manager, partner or proprietor that has been delegated signature authority pursuant to s. NR 205.07(1)(g)2, Wis. Adm. Code. The 'eReport Certify' page certifies that the electronic report form is true, accurate and complete.

If the permittee monitors any pollutant more frequently than required by this permit, the results of such monitoring shall be included on the Wastewater Discharge Monitoring Report.

The permittee shall comply with all limits for each parameter regardless of monitoring frequency. For example, monthly, weekly, and/or daily limits shall be met even with monthly monitoring. The permittee may monitor more frequently than required for any parameter.

4.1.2 Sampling and Testing Procedures

Sampling and laboratory testing procedures shall be performed in accordance with Chapters NR 218 and NR 219, Wis. Adm. Code and shall be performed by a laboratory certified or registered in accordance with the requirements of ch. NR 149, Wis. Adm. Code. Groundwater sample collection and analysis shall be performed in accordance with ch. NR 140, Wis. Adm. Code. The analytical methodologies used shall enable the laboratory to quantitate all substances for which monitoring is required at levels below the effluent limitation. If the required level cannot be met by any of the methods available in NR 219, Wis. Adm. Code, then the method with the lowest limit of detection shall be selected. Additional test procedures may be specified in this permit.

4.1.3 Recording of Results

The permittee shall maintain records which provide the following information for each effluent measurement or sample taken:

- the date, exact place, method and time of sampling or measurements;
- the individual who performed the sampling or measurements;
- the date the analysis was performed;
- the individual who performed the analysis;
- the analytical techniques or methods used; and
- the results of the analysis.

4.1.4 Reporting of Monitoring Results

The permittee shall use the following conventions when reporting effluent monitoring results:

- Pollutant concentrations less than the limit of detection shall be reported as < (less than) the value of the limit of detection. For example, if a substance is not detected at a detection limit of 0.1 mg/L, report the pollutant concentration as < 0.1 mg/L.
- Pollutant concentrations equal to or greater than the limit of detection, but less than the limit of quantitation, shall be reported and the limit of quantitation shall be specified.
- For purposes of calculating NR 101 fees, the 2 mg/l lower reporting limits for BOD₅ and Total Suspended Solids shall be considered to be limits of quantitation
- For the purposes of reporting a calculated result, average or a mass discharge value, the permittee may substitute a “0” (zero) for any pollutant concentration that is less than the limit of detection. However, if the effluent limitation is less than the limit of detection, the department may substitute a value other than zero for results less than the limit of detection, after considering the number of monitoring results that are greater than the limit of detection and if warranted when applying appropriate statistical techniques.
- If no discharge occurs through an outfall, flow related parameters (e.g. flow rate, hydraulic application rate, volume, etc.) should be reported as “0” (zero) at the required sample frequency specified for the outfall. For example: if the sample frequency is daily, “0” would be reported for any day during the month that no discharge occurred.

4.1.5 Compliance Maintenance Annual Reports

Compliance Maintenance Annual Reports (CMAR) shall be completed using information obtained over each calendar year regarding the wastewater conveyance and treatment system. The CMAR shall be submitted and certified by the permittee in accordance with ch. NR 208, Wis. Adm. Code, by June 30, each year on an electronic report form provided by the Department.

In the case of a publicly owned treatment works, a resolution shall be passed by the governing body and submitted as part of the CMAR, verifying its review of the report and providing responses as required. Private owners of wastewater treatment works are not required to pass a resolution; but they must provide an Owner Statement and responses as required, as part of the CMAR submittal.

The CMAR shall be certified electronically by a responsible executive or municipal officer, manager, partner or proprietor as specified in s. 283.37(3), Wis. Stats., or a duly authorized representative of the officer, manager, partner or proprietor that has been delegated signature authority pursuant to s. NR 205.07(1)(g)2, Wis. Adm. Code. The certification verifies that the electronic report is true, accurate and complete.

4.1.6 Records Retention

The permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings or electronic data records for continuous monitoring instrumentation, copies of all reports required by the permit, and records of all data used to complete the application for the permit for a period of at least 3 years from the date of the sample, measurement, report or application. All pertinent sludge information, including permit application information and other documents specified in this permit or s. NR 204.06(9), Wis. Adm. Code shall be retained for a minimum of 5 years.

4.1.7 Other Information

Where the permittee becomes aware that it failed to submit any relevant facts in a permit application or submitted incorrect information in a permit application or in any report to the Department, it shall promptly submit such facts or correct information to the Department.

4.1.8 Reporting Requirements – Alterations or Additions

The permittee shall give notice to the Department as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is only required when:

- The alteration or addition to the permitted facility may meet one of the criteria for determining whether a facility is a new source.
- The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification requirement applies to pollutants which are not subject to effluent limitations in the existing permit.
- The alteration or addition results in a significant change in the permittee's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use of disposal sites not reported during the permit application process nor reported pursuant to an approved land application plan. Additional sites may not be used for the land application of sludge until department approval is received.

4.2 System Operating Requirements

4.2.1 Noncompliance Reporting

Sanitary sewer overflows and sewage treatment facility overflows shall be reported according to the 'Sanitary Sewer Overflows and Sewage Treatment Facility Overflows' section of this permit.

The permittee shall report the following types of noncompliance by a telephone call to the Department's regional office within 24 hours after becoming aware of the noncompliance:

- any noncompliance which may endanger health or the environment;
- any violation of an effluent limitation resulting from a bypass;
- any violation of an effluent limitation resulting from an upset; and
- any violation of a maximum discharge limitation for any of the pollutants listed by the Department in the permit, either for effluent or sludge.

A written report describing the noncompliance shall also be submitted to the Department's regional office within 5 days after the permittee becomes aware of the noncompliance. On a case-by-case basis, the Department may waive the requirement for submittal of a written report within 5 days and instruct the permittee to submit the written report with the next regularly scheduled monitoring report. In either case, the written report shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times; the steps taken or planned to reduce, eliminate and prevent reoccurrence of the noncompliance; and if the noncompliance has not been corrected, the length of time it is expected to continue.

A scheduled bypass approved by the Department under the 'Scheduled Bypass' section of this permit shall not be subject to the reporting required under this section.

NOTE: Section 292.11(2)(a), Wisconsin Statutes, requires any person who possesses or controls a hazardous substance or who causes the discharge of a hazardous substance to notify the Department of Natural Resources **immediately** of any discharge not authorized by the permit. **The discharge of a hazardous substance that is not authorized by this permit or that violates this permit may be a hazardous substance spill. To report a hazardous substance spill, call DNR's 24-hour HOTLINE at 1-800-943-0003.**

4.2.2 Flow Meters

Flow meters shall be calibrated annually, as per s. NR 218.06, Wis. Adm. Code.

4.2.3 Raw Grit and Screenings

All raw grit and screenings shall be disposed of at a properly licensed solid waste facility or picked up by a licensed waste hauler. If the facility or hauler are located in Wisconsin, then they shall be licensed under chs. NR 500-555, Wis. Adm. Code.

4.2.4 Sludge Management

All sludge management activities shall be conducted in compliance with ch. NR 204 "Domestic Sewage Sludge Management", Wis. Adm. Code.

4.2.5 Prohibited Wastes

Under no circumstances may the introduction of wastes prohibited by s. NR 211.10, Wis. Adm. Code, be allowed into the waste treatment system. Prohibited wastes include those:

- which create a fire or explosion hazard in the treatment work;
- which will cause corrosive structural damage to the treatment work;
- solid or viscous substances in amounts which cause obstructions to the flow in sewers or interference with the proper operation of the treatment work;
- wastewaters at a flow rate or pollutant loading which are excessive over relatively short time periods so as to cause a loss of treatment efficiency; and
- changes in discharge volume or composition from contributing industries which overload the treatment works or cause a loss of treatment efficiency.

4.2.6 Bypass

This condition applies only to bypassing at a sewage treatment facility that is not a scheduled bypass, approved blending as a specific condition of this permit, a sewage treatment facility overflow or a controlled diversion as provided in the sections titled 'Scheduled Bypass', 'Blending' (if approved), 'SSO's and Sewage Treatment Facility Overflows' and 'Controlled Diversions' of this permit. Any other bypass at the sewage treatment facility is prohibited and the Department may take enforcement action against a permittee for such occurrences under s. 283.89, Wis. Stats. The Department may approve a bypass if the permittee demonstrates all the following conditions apply:

- The bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
- There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities or adequate back-up equipment, retention of untreated wastes, reduction of inflow and infiltration, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventative maintenance. When evaluating feasibility of alternatives, the department may consider factors such as technical achievability, costs and affordability of implementation and risks to public health, the environment and, where the permittee is a municipality, the welfare of the community served; and
- The bypass was reported in accordance with the Noncompliance Reporting section of this permit.

4.2.7 Scheduled Bypass

Whenever the permittee anticipates the need to bypass for purposes of efficient operations and maintenance and the permittee may not meet the conditions for controlled diversions in the 'Controlled Diversions' section of this permit, the permittee shall obtain prior written approval from the Department for the scheduled bypass. A permittee's written

request for Department approval of a scheduled bypass shall demonstrate that the conditions for bypassing specified in the above section titled 'Bypass' are met and include the proposed date and reason for the bypass, estimated volume and duration of the bypass, alternatives to bypassing and measures to mitigate environmental harm caused by the bypass. The department may require the permittee to provide public notification for a scheduled bypass if it is determined there is significant public interest in the proposed action and may recommend mitigation measures to minimize the impact of such bypass.

4.2.8 Controlled Diversions

Controlled diversions are allowed only when necessary for essential maintenance to assure efficient operation. Sewage treatment facilities that have multiple treatment units to treat variable or seasonal loading conditions may shut down redundant treatment units when necessary for efficient operation. The following requirements shall be met during controlled diversions:

- Effluent from the sewage treatment facility shall meet the effluent limitations established in the permit. Wastewater that is diverted around a treatment unit or treatment process during a controlled diversion shall be recombined with wastewater that is not diverted prior to the effluent sampling location and prior to effluent discharge;
- A controlled diversion does not include blending as defined in s. NR 210.03(2e), Wis. Adm. Code, and as may only be approved under s. NR 210.12. A controlled diversion may not occur during periods of excessive flow or other abnormal wastewater characteristics;
- A controlled diversion may not result in a wastewater treatment facility overflow; and
- All instances of controlled diversions shall be documented in sewage treatment facility records and such records shall be available to the department on request.

4.2.9 Proper Operation and Maintenance

The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control which are installed or used by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance includes effective performance, adequate funding, adequate operator staffing and training as required in ch. NR 114, Wis. Adm. Code, and adequate laboratory and process controls, including appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems only when necessary to achieve compliance with the conditions of the permit.

4.2.10 Operator Certification

The wastewater treatment facility shall be under the direct supervision of a state certified operator. In accordance with s. NR 114.53, Wis. Adm. Code, every WPDES permitted treatment plant shall have a designated operator-in-charge holding a current and valid certificate. The designated operator-in-charge shall be certified at the level and in all subclasses of the treatment plant, except laboratory. Treatment plant owners shall notify the department of any changes in the operator-in-charge within 30 days. Note that s. NR 114.52(22), Wis. Adm. Code, lists types of facilities that are excluded from operator certification requirements (i.e. private sewage systems, pretreatment facilities discharging to public sewers, industrial wastewater treatment that consists solely of land disposal, agricultural digesters and concentrated aquatic production facilities with no biological treatment).

4.3 Sewage Collection Systems

4.3.1 Sanitary Sewage Overflows and Sewage Treatment Facility Overflows

4.3.1.1 Overflows Prohibited

Any overflow or discharge of wastewater from the sewage collection system or at the sewage treatment facility, other than from permitted outfalls, is prohibited. The permittee shall provide information on whether any of the following conditions existed when an overflow occurred:

- The sanitary sewer overflow or sewage treatment facility overflow was unavoidable to prevent loss of life, personal injury or severe property damage;
- There were no feasible alternatives to the sanitary sewer overflow or sewage treatment facility overflow such as the use of auxiliary treatment facilities or adequate back-up equipment, retention of untreated wastes, reduction of inflow and infiltration, or preventative maintenance activities;
- The sanitary sewer overflow or the sewage treatment facility overflow was caused by unusual or severe weather related conditions such as large or successive precipitation events, snowmelt, saturated soil conditions, or severe weather occurring in the area served by the sewage collection system or sewage treatment facility; and
- The sanitary sewer overflow or the sewage treatment facility overflow was unintentional, temporary, and caused by an accident or other factors beyond the reasonable control of the permittee.

4.3.1.2 Permittee Response to Overflows

Whenever a sanitary sewer overflow or sewage treatment facility overflow occurs, the permittee shall take all feasible steps to control or limit the volume of untreated or partially treated wastewater discharged, and terminate the discharge as soon as practicable. Remedial actions, including those in NR 210.21 (3), Wis. Adm. Code, shall be implemented consistent with an emergency response plan developed under the CMOM program.

4.3.1.3 Permittee Reporting

Permittees shall report all sanitary sewer overflows and sewage treatment overflows as follows:

- The permittee shall notify the department by telephone, fax or email as soon as practicable, but no later than 24 hours from the time the permittee becomes aware of the overflow;
- The permittee shall, no later than five days from the time the permittee becomes aware of the overflow, provide to the department the information identified in this paragraph using department form number 3400-184. If an overflow lasts for more than five days, an initial report shall be submitted within 5 days as required in this paragraph and an updated report submitted following cessation of the overflow. At a minimum, the following information shall be included in the report:
 - The date and location of the overflow;
 - The surface water to which the discharge occurred, if any;
 - The duration of the overflow and an estimate of the volume of the overflow;
 - A description of the sewer system or treatment facility component from which the discharge occurred such as manhole, lift station, constructed overflow pipe, or crack or other opening in a pipe;
 - The estimated date and time when the overflow began and stopped or will be stopped;
 - The cause or suspected cause of the overflow including, if appropriate, precipitation, runoff conditions, areas of flooding, soil moisture and other relevant information;
 - Steps taken or planned to reduce, eliminate and prevent reoccurrence of the overflow and a schedule of major milestones for those steps;
 - A description of the actual or potential for human exposure and contact with the wastewater from the overflow;

- Steps taken or planned to mitigate the impacts of the overflow and a schedule of major milestones for those steps;
- To the extent known at the time of reporting, the number and location of building backups caused by excessive flow or other hydraulic constraints in the sewage collection system that occurred concurrently with the sanitary sewer overflow and that were within the same area of the sewage collection system as the sanitary sewer overflow; and
- The reason the overflow occurred or explanation of other contributing circumstances that resulted in the overflow event. This includes any information available including whether the overflow was unavoidable to prevent loss of life, personal injury, or severe property damage and whether there were feasible alternatives to the overflow.

NOTE: A copy of form 3400-184 for reporting sanitary sewer overflows and sewage treatment facility overflows may be obtained from the department or accessed on the department's web site at <http://dnr.wi.gov/topic/wastewater/SSOreport.html>. As indicated on the form, additional information may be submitted to supplement the information required by the form.

- The permittee shall identify each specific location and each day on which a sanitary sewer overflow or sewage treatment facility overflow occurs as a discrete sanitary sewer overflow or sewage treatment facility overflow occurrence. An occurrence may be more than one day if the circumstances causing the sanitary sewer overflow or sewage treatment facility overflow results in a discharge duration of greater than 24 hours. If there is a stop and restart of the overflow at the same location within 24 hours and the overflow is caused by the same circumstance, it may be reported as one occurrence. Sanitary sewer overflow occurrences at a specific location that are separated by more than 24 hours shall be reported as separate occurrences; and
- A permittee that is required to submit wastewater discharge monitoring reports under NR 205.07 (1) (r) shall also report all sanitary sewer overflows and sewage treatment facility overflows on that report.

4.3.1.4 Public Notification

The permittee shall notify the public of any sanitary sewer and sewage treatment facility overflows consistent with its emergency response plan required under the CMOM (Capacity, Management, Operation and Maintenance) section of this permit and s. NR 210.23 (4) (f), Wis. Adm. Code. Such public notification shall occur promptly following any overflow event using the most effective and efficient communications available in the community. At minimum, a daily newspaper of general circulation in the county(s) and municipality whose waters may be affected by the overflow shall be notified by written or electronic communication.

4.3.2 Capacity, Management, Operation and Maintenance (CMOM) Program

- The permittee shall have written documentation of the Capacity, Management, Operation and Maintenance (CMOM) program components in accordance with s. NR 210.23(4), Wis. Adm. Code. Such documentation shall be available for Department review upon request. The Department may request that the permittee provide this documentation or prepare a summary of the permittee's CMOM program at the time of application for reissuance of the WPDES permit.
- The permittee shall implement a CMOM program in accordance with s. NR 210.23, Wis. Adm. Code.
- The permittee shall at least annually conduct a self-audit of activities conducted under the permittee's CMOM program to ensure CMOM components are being implemented as necessary to meet the general standards of s. NR 210.23(3), Wis. Adm. Code.

4.3.3 Sewer Cleaning Debris and Materials

All debris and material removed from cleaning sanitary sewers shall be managed to prevent nuisances, run-off, ground infiltration or prohibited discharges.

- Debris and solid waste shall be dewatered, dried and then disposed of at a licensed solid waste facility.
- Liquid waste from the cleaning and dewatering operations shall be collected and disposed of at a permitted wastewater treatment facility.
- Combination waste including liquid waste along with debris and solid waste may be disposed of at a licensed solid waste facility or wastewater treatment facility willing to accept the waste.

4.4 Surface Water Requirements

4.4.1 Permittee-Determined Limit of Quantitation Incorporated into this Permit

For pollutants with water quality-based effluent limits below the Limit of Quantitation (LOQ) in this permit, the LOQ calculated by the permittee and reported on the Discharge Monitoring Reports (DMRs) is incorporated by reference into this permit. The LOQ shall be reported on the DMRs, shall be the lowest quantifiable level practicable, and shall be no greater than the minimum level (ML) specified in or approved under 40 CFR Part 136 for the pollutant at the time this permit was issued, unless this permit specifies a higher LOQ.

4.4.2 Appropriate Formulas for Effluent Calculations

The permittee shall use the following formulas for calculating effluent results to determine compliance with average concentration limits and mass limits and total load limits:

Weekly/Monthly/Six-Month/Annual Average Concentration = the sum of all daily results for that week/month/six-month/year, divided by the number of results during that time period. [Note: When a six-month average effluent limit is specified for Total Phosphorus the applicable periods are May through October and November through April.]

Weekly Average Mass Discharge (lbs/day): Daily mass = daily concentration (mg/L) x daily flow (MGD) x 8.34, then average the daily mass values for the week.

Monthly Average Mass Discharge (lbs/day): Daily mass = daily concentration (mg/L) x daily flow (MGD) x 8.34, then average the daily mass values for the month.

Six-Month Average Mass Discharge (lbs/day): Daily mass = daily concentration (mg/L) x daily flow (MGD) x 8.34, then average the daily mass values for the six-month period. [Note: When a six-month average effluent limit is specified for Total Phosphorus the applicable periods are May through October and November through April.]

Annual Average Mass Discharge (lbs/day): Daily mass = daily concentration (mg/L) x daily flow (MGD) x 8.34, then average the daily mass values for the entire year.

Total Monthly Discharge: = monthly average concentration (mg/L) x total flow for the month (MG/month) x 8.34.

Total Annual Discharge: = sum of total monthly discharges for the calendar year.

12-Month Rolling Sum of Total Monthly Discharge: = the sum of the most recent 12 consecutive months of Total Monthly Discharges.

4.4.3 Effluent Temperature Requirements

Weekly Average Temperature – The permittee shall use the following formula for calculating effluent results to determine compliance with the weekly average temperature limit (as applicable): Weekly Average Temperature = the sum of all daily maximum results for that week divided by the number of daily maximum results during that time period.

Cold Shock Standard – Water temperatures of the discharge shall be controlled in a manner as to protect fish and aquatic life uses from the deleterious effects of cold shock. ‘Cold Shock’ means exposure of aquatic organisms to a rapid decrease in temperature and a sustained exposure to low temperature that induces abnormal behavior or physiological performance and may lead to death.

Rate of Temperature Change Standard – Temperature of a water of the state or discharge to a water of the state may not be artificially raised or lowered at such a rate that it causes detrimental health or reproductive effects to fish or aquatic life of the water of the state.

4.4.4 Visible Foam or Floating Solids

There shall be no discharge of floating solids or visible foam in other than trace amounts.

4.4.5 Surface Water Uses and Criteria

In accordance with NR 102.04, Wis. Adm. Code, surface water uses and criteria are established to govern water management decisions. Practices attributable to municipal, industrial, commercial, domestic, agricultural, land development or other activities shall be controlled so that all surface waters including the mixing zone meet the following conditions at all times and under all flow and water level conditions:

- a) Substances that will cause objectionable deposits on the shore or in the bed of a body of water, shall not be present in such amounts as to interfere with public rights in waters of the state.
- b) Floating or submerged debris, oil, scum or other material shall not be present in such amounts as to interfere with public rights in waters of the state.
- c) Materials producing color, odor, taste or unsightliness shall not be present in such amounts as to interfere with public rights in waters of the state.
- d) Substances in concentrations or in combinations which are toxic or harmful to humans shall not be present in amounts found to be of public health significance, nor shall substances be present in amounts which are acutely harmful to animal, plant or aquatic life.

4.4.6 Percent Removal

During any 30 consecutive days, the average effluent concentrations of BOD₅ and of total suspended solids shall not exceed 15% of the average influent concentrations, respectively. This requirement does not apply to removal of total suspended solids if the permittee operates a lagoon system and has received a variance for suspended solids granted under NR 210.07(2), Wis. Adm. Code.

4.4.7 *E. coli*

The monthly limit for *E. coli* shall be expressed as a geometric mean. In calculating the geometric mean, a value of 1 is used for any result of 0.

4.4.8 Seasonal Disinfection

Disinfection shall be provided from May 1 through September 30 of each year. Monitoring requirements and the limitations *E. coli* apply only during the period in which disinfection is required. Whenever chlorine is used for disinfection or other uses, the limitations and monitoring requirements for residual chlorine shall apply. A dechlorination process shall be in operation whenever chlorine is used.

4.5 Land Application Requirements

4.5.1 Sludge Management Program Standards And Requirements Based Upon Federally Promulgated Regulations

In the event that new federal sludge standards or regulations are promulgated, the permittee shall comply with the new sludge requirements by the dates established in the regulations, if required by federal law, even if the permit has not yet been modified to incorporate the new federal regulations.

4.5.2 General Sludge Management Information

The General Sludge Management Form 3400-48 shall be completed and submitted prior to any significant sludge management changes.

4.5.3 Sludge Samples

All sludge samples shall be collected at a point and in a manner which will yield sample results which are representative of the sludge being tested, and collected at the time which is appropriate for the specific test.

4.5.4 Land Application Characteristic Report

Each report shall consist of a Characteristic Form 3400-49 and Lab Report. The Characteristic Report Form 3400-49 shall be submitted electronically by January 31 following each year of analysis.

Following submittal of the electronic Characteristic Report Form 3400-49, this form shall be certified electronically via the 'eReport Certify' page by a responsible executive or municipal officer, manager, partner or proprietor as specified in s. 283.37(3), Wis. Stats., or a duly authorized representative of the officer, manager, partner or proprietor that has been delegated signature authority pursuant to s. NR 205.07(1)(g)2, Wis. Adm. Code. The 'eReport Certify' page certifies that the electronic report is true, accurate and complete. The Lab Report must be sent directly to the facility's DNR sludge representative or basin engineer unless approval for not submitting the lab reports has been given.

The permittee shall use the following convention when reporting sludge monitoring results: Pollutant concentrations less than the limit of detection shall be reported as < (less than) the value of the limit of detection. For example, if a substance is not detected at a detection limit of 1.0 mg/kg, report the pollutant concentration as < 1.0 mg/kg .

All results shall be reported on a dry weight basis.

4.5.5 Calculation of Water Extractable Phosphorus

When sludge analysis for Water Extractable Phosphorus is required by this permit, the permittee shall use the following formula to calculate and report Water Extractable Phosphorus:

Water Extractable Phosphorus (% of Total P) =

$$[\text{Water Extractable Phosphorus (mg/kg, dry wt)} \div \text{Total Phosphorus (mg/kg, dry wt)}] \times 100$$

4.5.6 Monitoring and Calculating PCB Concentrations in Sludge

When sludge analysis for "PCB, Total Dry Wt" is required by this permit, the PCB concentration in the sludge shall be determined using either congener-specific analysis or Aroclor analysis. The permittee may decide which of these analyses is performed. Analyses shall be performed in accordance with the following provisions and Table EM in s. NR 219.04, Wis. Adm. Code:

- If congener-specific analysis is employed: All PCB congeners shall be delineated. Non-detects shall be treated as zero. The values that are between the limit of detection (LOD) and the limit of quantitation

shall be used when calculating the total value of all congeners. All results shall be added together and the total PCB concentration by dry weight reported.

- If Aroclor analysis is employed, reporting protocols, consistent with s. NR 106.07(6)(e), should be as follows: If all Aroclors are less than the LOD, then the Total PCB Dry Wt result should be reported as less than the highest LOD. If a single Aroclor is detected, then that is what should be reported for the Total PCB result. If multiple Aroclors are detected, they should be summed and reported as Total PCBs. If the LOD cannot be achieved after using the appropriate clean up techniques, a reporting limit that is achievable for the Aroclors or each congener for the sample shall be determined. This reporting limit shall be reported and qualified indicating the presence of an interference.

4.5.7 Annual Land Application Report

Land Application Report Form 3400-55 shall be submitted electronically by January 31, each year whether or not non-exceptional quality sludge is land applied. Non-exceptional quality sludge is defined in s. NR 204.07(4), Wis. Adm. Code. Following submittal of the electronic Annual Land Application Report Form 3400-55, this form shall be certified electronically via the 'eReport Certify' page by a responsible executive or municipal officer, manager, partner or proprietor as specified in s. 283.37(3), Wis. Stats., or a duly authorized representative of the officer, manager, partner or proprietor that has been delegated signature authority pursuant to s. NR 205.07(1)(g)2, Wis. Adm. Code. The 'eReport Certify' page certifies that the electronic report form is true, accurate and complete.

4.5.8 Other Methods of Disposal or Distribution Report

The permittee shall submit electronically the Other Methods of Disposal or Distribution Report Form 3400-52 by January 31, each year whether or not sludge is hauled, landfilled, incinerated, or exceptional quality sludge is distributed or land applied. Following submittal of the electronic Report Form 3400-52, this form shall be certified electronically via the 'eReport Certify' page by a responsible executive or municipal officer, manager, partner or proprietor as specified in s. 283.37(3), Wis. Stats., or a duly authorized representative of the officer, manager, partner or proprietor that has been delegated signature authority pursuant to s. NR 205.07(1)(g)2, Wis. Adm. Code. The 'eReport Certify' page certifies that the electronic report form is true, accurate and complete.

4.5.9 Approval to Land Apply

Bulk non-exceptional quality sludge as defined in s. NR 204.07(4), Wis. Adm. Code, may not be applied to land without a written approval letter or Form 3400-122 from the Department unless the Permittee has obtained permission from the Department to self approve sites in accordance with s. NR 204.06 (6), Wis. Adm. Code. Analysis of sludge characteristics is required prior to land application. Application on frozen or snow covered ground is restricted to the extent specified in s. NR 204.07(3) (l), Wis. Adm. Code.

4.5.10 Soil Analysis Requirements

Each site requested for approval for land application must have the soil tested prior to use. Each approved site used for land application must subsequently be soil tested such that there is at least one valid soil test in the four years prior to land application. All soil sampling and submittal of information to the testing laboratory shall be done in accordance with UW Extension Bulletin A-2100. The testing shall be done by the UW Soils Lab in Madison or Marshfield, WI or at a lab approved by UW. The test results including the crop recommendations shall be submitted to the DNR contact listed for this permit, as they are available. Application rates shall be determined based on the crop nitrogen recommendations and with consideration for other sources of nitrogen applied to the site.

4.5.11 Land Application Site Evaluation

For non-exceptional quality sludge, as defined in s. NR 204.07(4), Wis. Adm. Code, a Land Application Site Request Form 3400-053 shall be submitted to the Department for the proposed land application site. The Department will

evaluate the proposed site for acceptability and will either approve or deny use of the proposed site. The permittee may obtain permission to approve their own sites in accordance with s. NR 204.06(6), Wis. Adm. Code.

4.5.12 Sludge Hauling

The permittee is required to submit Form 3400-52 to the Department. If sludge is hauled to another facility, information shall include the quantity of sludge hauled, the name, address, phone number, contact person, and permit number of the receiving facility. Form 3400-52 shall be submitted annually by January 31 each year whether or not sludge is hauled.

5 Summary of Reports Due

FOR INFORMATIONAL PURPOSES ONLY

Description	Date	Page
Compliance Maintenance Annual Reports (CMAR)	by June 30, each year	12
General Sludge Management Form 3400-48	prior to any significant sludge management changes	20
Characteristic Form 3400-49 and Lab Report	by January 31 following each year of analysis	20
Land Application Report Form 3400-55	by January 31, each year whether or not non-exceptional quality sludge is land applied	21
Other Methods of Disposal or Distribution Report Form 3400-52	by January 31, each year whether or not sludge is hauled, landfilled, incinerated, or exceptional quality sludge is distributed or land applied	21
Wastewater Discharge Monitoring Report	no later than the date indicated on the form	11

Report forms shall be submitted electronically in accordance with the reporting requirements herein. Any facility plans or plans and specifications for municipal, industrial, industrial pretreatment and non industrial wastewater systems shall be submitted to the Bureau of Water Quality, P.O. Box 7921, Madison, WI 53707-7921. All other submittals required by this permit shall be submitted to:

Northeast Region, 2984 Shawano Avenue, Green Bay, WI 54313-6727

WWTF Influent Flows & Loadings and Plant Performance Data Tables

DRAFT

Table #1
Village of Ephraim WWTF
2019 Influent Flows & Loadings

Month	Influent (Collection Sytem)										Influent (Septage)								Total Combined Influent											
	Flow		BOD				TSS				Flow		BOD				TSS				Flow		BOD				TSS			
	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max
Jan-19	0.039	0.066	104	249	38	136	103	214	38	117	732	7,100	617	3,033	19.8	71	1,731	9,733	50	227	0.040	0.067	125	249	48	136	159	550	63	247
Feb-19	0.036	0.056	84	180	25	54	79	120	24	36	1,193	7,800	144	236	5.0	6.5	102	297	2.3	2.8	0.037	0.056	88	180	28	54	79	120	25	36
Mar-19	0.065	0.112	58	146	23	43	56	116	21	32	1,319	8,300	175	230	8.8	10	105	210	5.3	8.9	0.066	0.112	67	146	27	51	60	119	24	37
Apr-19	0.106	0.157	57	121	48	93	57	104	49	80	737	8,600	606	1,456	14.7	27	1,686	4,000	29	54	0.107	0.157	62	152	53	119	68	171	59	134
May-19	0.103	0.152	82	110	68	132	90	126	75	151	1,139	8,500	146	252	2.6	5.1	145	223	3.5	10	0.104	0.152	83	115	69	125	90	129	75	141
Jun-19	0.122	0.162	155	228	154	253	184	262	180	264	1,110	7,100	212	421	10.6	14	187	570	8.2	12	0.123	0.162	157	228	157	253	162	255	160	264
Jul-19	0.137	0.166	199	285	220	306	199	226	220	248	3,790	16,600	168	217	14.0	20	113	160	9.3	16	0.141	0.169	198	285	228	306	195	219	225	248
Aug-19	0.128	0.264	194	278	233	458	200	228	238	472	2,945	20,000	819	2,206	32.0	131	2,353	7,320	78	345	0.131	0.270	207	288	253	466	237	493	287	582
Sep-19	0.105	0.153	146	163	114	126	154	186	121	144	2,007	14,700	192	274	13.1	21	256	450	18	35	0.107	0.153	148	173	125	147	161	210	137	179
Oct-19	0.098	0.132	107	156	84	128	118	184	92	151	2,255	11,800	349	733	10.6	26	805	2,267	21	65	0.100	0.132	112	159	90	128	130	217	105	152
Nov-19	0.053	0.121	69	79	25	32	74	84	26	34	753	4,100	287	1,043	3.9	6.3	655	2,960	7.4	13	0.054	0.121	74	80	28	33	85	103	32	39
Dec-19	0.062	0.148	65	91	34	77	65	86	35	92	642	5,500	133	247	2.4	6.6	131	253	2.1	6.6	0.063	0.149	67	100	36	77	67	86	37	92
Avg	0.088		110		89		115		93		1,559		321		11.3		690		19		0.090		116		95		125		102	
Off-Season Avg (Nov-Apr)	0.060		73		32		72		32		896		327		9.1		735		16		0.061		80		37		86		40	
Peak Avg (May-Oct)	0.115		146		143		156		152		2,215		308		14.3		621		24		0.118		149		151		161		162	
Max	0.137	0.264	199	285	233	458	200	262	238	472	3,790	20,000	819	3,033	32.0	131	2,353	9,733	78	345	0.141	0.270	207	288	253	466	237	550	287	582

DRAFT

Table #2
Village of Ephraim WWTF
2020 Influent Flows & Loadings

Month	Influent (Collection Sytem)										Influent (Septage)										Total Combined Influent									
	Flow		BOD				TSS				Flow		BOD				TSS				Flow		BOD				TSS			
	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max
Jan-20	0.059	0.101	48	75	23	63	53	88	26	74	287	3,100	118	194	1.1	3.5	141	283	1.1	4.7	0.059	0.101	49	75	24	63	54	88	27	74
Feb-20	0.041	0.061	62	78	19	24	80	104	24	31	662	4,200	108	137	2.2	3.9	88	117	1.8	3.0	0.042	0.061	65	81	21	27	80	102	26	34
Mar-20	0.064	0.113	49	68	24	54	54	80	25	44	810	5,300	130	167	2.8	6.5	138	270	2.8	11	0.065	0.113	53	80	27	54	58	103	28	47
Apr-20	0.071	0.109	49	77	29	44	46	74	27	47	590	3,400	182	262	3.0	6.1	110	280	1.8	4.9	0.072	0.109	52	80	31	50	48	75	29	49
May-20	0.085	0.175	72	101	47	73	72	112	48	81	1,494	8,300	214	255	6.1	16	136	187	3.7	9.7	0.086	0.175	78	106	53	80	74	113	52	85
Jun-20	0.109	0.144	131	188	121	199	146	204	134	216	2,040	6,800	190	307	6.2	17	172	384	5.5	19	0.111	0.147	134	189	127	203	147	206	140	221
Jul-20	0.144	0.173	189	222	213	237	196	238	222	276	2,816	10,100	190	217	7.9	16	140	188	5.9	12	0.146	0.173	189	220	221	243	194	232	228	288
Aug-20	0.134	0.203	178	213	190	228	211	240	227	334	3,194	8,400	238	373	9.6	22	277	610	12	36	0.138	0.209	180	221	200	250	214	252	238	348
Sep-20	0.099	0.132	142	179	105	122	173	212	130	173	1,897	8,200	859	2,791	27.6	137	2,142	6,520	62	321	0.101	0.132	168	255	133	248	238	487	192	474
Oct-20	0.088	0.131	132	156	76	102	161	226	94	139	2,219	7,100	467	1,659	10.5	19	926	4,520	18	53	0.090	0.131	144	190	86	106	186	281	112	160
Nov-20	0.049	0.084	80	118	31	55	103	164	40	69	940	12,700	477	1,272	12.5	89	1,669	5,700	37	261	0.050	0.084	106	288	44	119	186	718	77	298
Dec-20	0.033	0.044	117	190	32	63	141	220	38	72	900	5,000	102	131	2.1	3.7	97	180	2.0	3.9	0.034	0.044	116	183	34	65	138	209	40	74
Avg	0.082		104		75		120		85		1,493		276		7.9		509		13	0.083		111		83		135		98		
Off-Season Avg (Nov-Apr)	0.053		68		26		79		30		698		186		4.0		374		7.7	0.054		73		30		94		38		
Peak Avg (May-Oct)	0.110		140		125		160		142		2,280		372		11.7		673		19	0.112		149		136		177		161		
Max	0.144	0.203	189	222	213	237	211	240	227	334	3,194	12,700	859	2,791	27.6	137	2,142	6,520	62	321	0.146	0.209	189	288	221	250	238	718	238	474

Table #3
Village of Ephraim WWTF
2021 Influent Flows & Loadings

Month	Influent (Collection Sytem)										Influent (Septage)										Total Combined Influent									
	Flow		BOD				TSS				Flow		BOD				TSS				Flow		BOD				TSS			
	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max
Jan-21	0.031	0.052	171	447	35	92	269	852	55	176	661	6,400	124	231	2.3	7.7	125	270	1.7	4.9	0.032	0.052	167	411	38	95	252	775	57	179
Feb-21	0.033	0.047	107	142	26	47	125	192	30	63	903	9,100	109	145	2.9	11	83	140	1.5	5.0	0.034	0.047	108	139	28	52	121	186	31	66
Mar-21	0.046	0.065	102	146	40	51	118	152	47	66	1,058	6,000	339	917	7.6	13	440	1,330	5.1	9.8	0.047	0.070	108	157	45	63	120	152	51	73
Apr-21	0.059	0.095	86	117	42	63	94	134	45	81	887	4,300	694	2,364	9.1	37	1,496	6,600	13	65	0.060	0.097	100	205	49	75	117	295	55	107
May-21	0.082	0.120	129	217	79	135	128	208	78	132	945	7,500	240	422	6.0	14	203	520	3.5	6.8	0.083	0.120	130	214	83	145	126	206	81	138
Jun-21	0.113	0.145	214	292	191	246	206	262	187	243	2,287	9,400	177	261	5.9	12	158	373	4.7	9.8	0.115	0.145	213	291	197	250	204	264	191	253
Jul-21	0.140	0.182	233	253	261	280	241	268	270	292	1,490	6,500	150	182	6.2	7.7	132	247	5.4	11	0.142	0.182	231	249	268	287	237	263	275	297
Aug-21	0.129	0.146	211	253	220	290	233	268	241	301	1,958	8,700	147	189	6.6	11	126	172	5.4	7.7	0.131	0.151	209	247	227	296	229	263	247	304
Sep-21	0.102	0.132	179	242	147	232	191	234	156	224	1,650	9,100	179	309	4.5	7.7	278	600	6.3	17	0.103	0.132	178	242	152	232	192	238	163	224
Oct-21	0.089	0.117	148	176	100	124	183	240	123	172	1,219	7,900	143	226	5.0	7.4	232	470	8.0	15	0.090	0.117	148	173	105	130	185	246	131	185
Nov-21	0.032	0.060	142	199	31	47	180	228	40	61	890	5,600	94	149	1.7	3.8	128	249	1.9	4.2	0.033	0.060	139	192	33	49	174	207	41	65
Dec-21	0.030	0.049	128	167	33	57	164	220	43	75	1,110	6,000	92	131	2.4	6.6	84	122	2.0	5.3	0.031	0.052	125	167	36	57	157	220	45	75
Avg	0.074		154		101		178		110		1,255		204		4.8		281		4.7		0.075		155		105		176		114	
Off-Season Avg (Nov-Apr)	0.039		123		35		158		43		918		242		4.3		393		4.3		0.040		124		38		157		47	
Peak Avg (May-Oct)	0.109		186		167		197		177		1,588		173		5.7		185		5.6		0.111		185		173		196		182	
Max	0.140	0.182	233	447	261	290	269	852	270	301	2,287	9,400	694	2,364	9.1	37	1,496	6,600	13.4	65	0.142	0.182	231	411	268	296	252	775	275	304

DRAFT

Table #4
Village of Ephraim WWTF
2022 Influent Flows & Loadings

Month	Influent (Collection Sytem)										Influent (Septage)								Total Combined Influent												
	¹ Flow MGD		BOD				TSS				¹ Flow gpd		BOD				TSS				¹ Flow MGD		BOD				TSS				
	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg
Jan-22	0.027	0.045	136	178	28	39	160	200	32	44	413	4,300	119	181	1.3	4.2	167	428	1.2	3.7	0.027	0.045	134	175	29	41	156	200	34	45	
Feb-22	0.026	0.036	117	132	21	23	143	176	25	32	500	4,300	128	228	1.7	2.9	159	355	1.2	2.1	0.026	0.036	115	132	22	25	137	165	26	33	
Mar-22	0.053	0.184	79	124	26	74	91	154	33	117	723	11,600	235	434	4.5	21	233	620	2.0	7.9	0.054	0.185	83	138	31	74	88	131	36	118	
Apr-22	0.093	0.183	36	75	25	34	42	114	28	45	880	7,100	118	203	2.5	6.5	96	232	2.3	8.9	0.094	0.183	38	80	27	36	43	120	30	54	
May-22	0.115	0.172	65	107	58	109	72	110	63	113	1,923	9,700	141	226	5.5	10.4	149	280	5.6	12	0.117	0.176	68	109	63	116	75	117	69	125	
Jun-22	0.123	0.139	113	142	112	144	105	148	104	143	1,617	6,700	309	689	5.7	16	457	1,540	7.1	22	0.124	0.139	116	150	118	153	109	157	111	160	
Jul-22	0.143	0.157	146	197	171	257	136	202	159	219	1,642	13,100	336	817	6.6	13	563	1,800	6.9	13	0.145	0.157	147	197	176	257	138	197	164	223	
Aug-22	0.128	0.150	137	182	141	196	138	224	141	194	1,861	7,800	171	251	6.4	14	209	530	7.9	23	0.130	0.150	138	180	147	200	140	222	148	200	
Sep-22	0.098	0.131	109	158	85	130	101	176	79	145	2,147	7,800	297	704	16.3	46	448	1,560	29	101	0.100	0.131	120	164	97	143	123	229	100	200	
Oct-22	0.090	0.109	127	155	95	104	111	138	78	82	3,338	12,600	486	2,130	11.3	17	2,310	14,400	18	33	0.093	0.109	139	150	103	114	123	134	91	105	
Nov-22	0.029	0.039	133	256	31	52	180	340	42	69	791	4,300	424	1,149	4.2	17	1,456	5,000	15	74	0.030	0.039	158	258	35	53	251	468	57	125	
Dec-22	0.026	0.053	146	200	28	45	213	312	41	76	555	2,700	285	572	5.1	11	488	1,170	8.5	22	0.027	0.053	158	207	33	51	238	319	50	86	
Avg	0.080		112		68		124		69		1,281		255		5.5		560		7.9		0.081		116		73		134		77		
Off-Season Avg (Nov-Apr)	0.042		108		26		138		33		644		218		3.2		433		5.1		0.043		114		29		152		39		
Peak Avg (May-Oct)	0.119		116		112		111		107		1,955		283		7.8		656		10.7		0.121		119		119		117		116		
Max	0.143	0.184	146	256	171	257	213	340	159	219	3,338	13,100	486	2,130	16.3	46	2,310	14,400	29	101	0.145	0.185	158	258	176	257	251	468	164	223	

¹No flow data provided from 10/15/2022 through 11/7/2022.

Table #5
Village of Ephraim WWTF
2023 Influent (Jan-Jun) Flows & Loadings

Month	Influent (Collection Sytem)										Influent (Septage)										Total Combined Influent									
	Flow		BOD				TSS				Flow		BOD				TSS				Flow		BOD				TSS			
	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max
Jan-23	0.028	0.042	142	253	31	60	178	536	39	127	642	3,400	334	1,232	6.0	25	571	2,640	10.2	53	0.029	0.042	156	329	37	85	206	700	49	180
Feb-23	0.027	0.038	116	144	22	26	162	248	33	58	343	3,000	366	634	3.6	8.3	401	700	3.8	11	0.027	0.038	126	170	26	34	170	249	36	58
Mar-23	0.052	0.170	68	107	26	38	81	130	30	48	319	4,000	715	1,803	4.1	14	2,058	4,900	10.3	38	0.052	0.170	71	109	28	53	90	124	36	80
Apr-23	0.095	0.197	36	66	27	67	31	56	25	80	570	5,200	441	1,018	3.2	5.9	1,356	4,370	9.7	26	0.095	0.197	38	66	29	71	36	61	30	89
May-23	0.076	0.122	81	113	50	84	92	154	57	100	1,352	3,800	413	1,417	4.7	7.9	544	2,167	3.7	5.6	0.078	0.122	85	117	54	91	94	158	60	103
Jun-23	0.111	0.149	142	171	125	154	153	174	134	161	1,673	8,400	282	382	7.7	18	343	1,033	6.4	13	0.111	0.149	142	171	125	154	153	174	134	161
Jul-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Aug-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Sep-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Oct-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Nov-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Dec-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Avg	0.065		97		46		116		52		407		428		5.1		854		7.2	0.066		103		49		124		57		
Off-Season Avg (Jan-Apr)	0.050		90		26		113		32		469		464		4.2		1,097		8.5	0.051		98		30		126		38		
Peak Avg (May-Jun)	0.093		109		84		119		91		501		355		6.2		455		5.1	0.094		110		85		120		93		
Max	0.111	0.197	142	253	125	154	178	536	134	161	1,673	8,400	715	1,803	7.7	25	2,058	4,900	10.3	53	0.111	0.197	156	329	125	154	206	700	134	180
2019 through June 2023																														
Avg	0.079		117		79		132		86		1,198		281		6.8		546		10.3	0.081		122		85		140		93		
Off-Season Avg (Nov-Apr)	0.049		92		29		112		34		743		275		5.0		571		8.3	0.050		98		33		123		40		
Peak Avg (May-Oct)	0.112		144		133		153		141		1,703		290		9.3		528		13.3	0.114		148		140		160		151		
Max	0.144	0.264	233	447	261	458	269	852	270	472	3,790	20,000	859	3,033	32.0	137	2,353	14,400	78	345	0.146	0.270	231	411	268	466	252	775	287	582

Table #6
Village of Ephraim WWTF
2019 Plant Performance

Month	Effluent																					
	Flow MGD		BOD				TSS				Total P				NH3-N		pH		Fecal Coliform		E. coli	
	Avg	Max	mg/L		lbs./day		mg/L		lbs./day		mg/L		lbs./day		mg/L		s.u.		#/100 mL		#/100 mL	
Jan-19	0.038	0.066	4.9	9.4	1.8	5.0	9.6	15.6	3.5	7.6	0.17	0.23	0.06	0.11	0.05	0.05	7.1	7.4	-	-	-	-
Feb-19	0.036	0.054	3.7	5.8	1.2	1.9	8.9	13.6	2.9	6.1	0.18	0.29	0.06	0.13	0.03	0.03	7.2	7.5	-	-	-	-
Mar-19	0.065	0.110	4.1	6.0	1.9	3.8	12.1	16.6	6.1	12.7	0.25	0.36	0.13	0.27	0.04	0.04	7.4	7.6	-	-	-	-
Apr-19	0.105	0.156	4.5	6.1	4.0	5.8	16.4	21.2	14.6	20.1	0.31	0.36	0.28	0.36	0.61	0.61	7.3	7.4	-	-	-	-
May-19	0.103	0.152	5.0	6.5	4.0	5.9	13.2	16.0	10.8	17.6	0.26	0.34	0.22	0.39	0.05	0.05	7.3	7.4	1.0	1.0	1.0	1.0
Jun-19	0.118	0.157	4.4	6.3	4.4	7.2	11.5	15.6	11.3	17.8	0.39	0.51	0.36	0.58	0.03	0.03	7.2	7.4	1.3	2.0	1.3	2.0
Jul-19	0.135	0.164	4.7	6.4	5.2	7.1	12.1	19.6	13.3	20.9	0.54	0.69	0.60	0.86	0.06	0.06	7.0	7.1	2.7	6.3	3.3	9.5
Aug-19	0.126	0.265	4.4	5.6	5.1	10.0	10.8	16.4	12.6	24.3	0.49	0.88	0.55	0.92	0.06	0.06	7.0	7.2	1.5	3.1	1.4	3.1
Sep-19	0.103	0.150	3.6	5.0	2.9	3.5	9.7	13.4	7.8	9.2	0.25	0.39	0.21	0.34	0.04	0.04	7.3	7.6	1.0	1.0	1.0	1.0
Oct-19	0.097	0.130	4.1	4.7	3.2	3.9	11.2	13.2	8.5	11.3	0.36	0.49	0.27	0.40	0.03	0.03	7.2	7.5	-	-	-	-
Nov-19	0.053	0.121	3.7	5.6	1.3	2.1	10.3	13.6	3.8	4.9	0.33	0.42	0.12	0.16	0.05	0.05	7.3	7.5	-	-	-	-
Dec-19	0.063	0.149	4.4	6.5	2.4	5.0	13.5	21.0	7.1	14.9	0.44	0.83	0.21	0.37	0.29	0.29	7.5	7.9	-	-	-	-
Avg	0.087		4.3		3.1		11.6		8.6		0.33		0.26		0.11		7.2		1.5		1.6	
Off-Season Avg (Nov-Apr)	0.060		4.2		2.1		11.8		6.3		0.28		0.14		0.18		7.3		-		-	
Peak Avg (May-Oct)	0.114		4.4		4.1		11.4		10.7		0.38		0.37		0.04		7.1		1.5		1.6	
Max	0.135	0.265	5.0	9.4	5.2	10.0	16.4	21.2	14.6	24.3	0.54	0.88	0.60	0.92	0.61	0.61	7.5	7.9	2.7	6.3	3.3	9.5

Table #7
Village of Ephraim WWTF
2020 Plant Performance

Month	Flow		BOD				TSS				Effluent				NH3-N		pH		Fecal Coliform		E. coli	
	MGD		mg/L		lbs./day		mg/L		lbs./day		mg/L		lbs./day		mg/L		s.u.		#/100 mL		#/100 mL	
	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max
Jan-20	0.057	0.099	3.7	4.8	1.7	2.9	12.7	16.8	5.9	10.2	0.32	0.62	0.14	0.25	0.29	0.29	7.4	7.7	-	-	-	-
Feb-20	0.040	0.059	2.9	3.7	0.9	1.2	8.5	12.4	2.7	4.4	0.21	0.34	0.07	0.12	0.03	0.03	7.2	7.3	-	-	-	-
Mar-20	0.064	0.113	3.3	4.5	1.8	3.6	7.0	10.8	3.4	5.4	0.21	0.36	0.10	0.13	0.04	0.04	7.2	7.3	-	-	-	-
Apr-20	0.071	0.109	2.6	3.1	1.6	2.3	5.7	7.6	3.5	4.8	0.15	0.19	0.09	0.12	0.01	0.01	7.2	7.4	-	-	-	-
May-20	0.085	0.173	3.5	5.3	2.5	3.6	9.2	12.4	6.7	14.2	0.24	0.33	0.18	0.38	0.05	0.05	7.0	7.2	1.0	1.0	1.0	1.0
Jun-20	0.107	0.141	3.4	4.0	3.1	4.7	10.3	18.6	9.1	17.0	0.32	0.55	0.29	0.51	0.00	0.00	6.9	7.0	1.0	1.0	1.5	2.0
Jul-20	0.141	0.168	4.0	5.5	4.5	6.2	5.9	7.4	6.7	8.9	0.56	0.68	0.64	0.81	0.03	0.03	6.9	7.1	1.0	1.0	2.0	5.0
Aug-20	0.131	0.204	3.6	5.2	3.7	5.7	6.5	9.8	6.8	10.6	0.56	0.80	0.61	0.92	0.04	0.04	7.0	7.2	1.0	1.0	2.6	5.2
Sep-20	0.097	0.127	4.0	6.0	2.9	4.1	5.2	8.0	3.8	5.7	0.29	0.48	0.22	0.36	0.09	0.09	6.9	7.1	3.1	5.2	3.9	7.5
Oct-20	0.086	0.128	3.6	4.3	2.0	2.5	5.2	6.2	3.0	3.9	0.19	0.32	0.11	0.17	0.05	0.05	7.1	7.3	-	-	-	-
Nov-20	0.047	0.080	3.1	4.0	1.2	1.5	6.7	8.2	2.5	3.1	0.24	0.40	0.09	0.15	0.04	0.04	7.4	7.5	-	-	-	-
Dec-20	0.032	0.042	3.3	4.4	0.9	1.3	8.8	11.4	2.4	3.2	0.27	0.36	0.07	0.10	0.04	0.04	7.5	7.6	-	-	-	-
Avg	0.080		3.4		2.2		7.7		4.7		0.30		0.22		0.06		7.1		1.4		2.1	
Off-Season Avg (Nov-Apr)	0.052		3.1		1.3		8.2		3.4		0.23		0.09		0.08		7.3		-		-	
Peak Avg (May-Oct)	0.108		3.7		3.1		7.1		6.1		0.36		0.34		0.04		7.0		1.4		2.1	
Max	0.141	0.204	4.0	6.0	4.5	6.2	12.7	18.6	9.1	17.0	0.56	0.80	0.64	0.92	0.29	0.29	7.5	7.7	3.1	5.2	3.9	7.5

Table #8
Village of Ephraim WWTF
2021 Plant Performance

Month	Effluent																					
	Flow MGD		BOD				TSS				Total P				NH3-N		pH		Fecal Coliform		E. coli	
	Avg	Max	mg/L		lbs./day		mg/L		lbs./day		mg/L		lbs./day		mg/L		s.u.		#/100 mL		#/100 mL	
Jan-21	0.030	0.050	3.3	5.1	0.7	1.2	8.8	11.2	1.9	2.5	0.26	0.34	0.06	0.07	0.82	0.82	7.3	7.5	-	-	-	-
Feb-21	0.033	0.046	3.3	4.9	0.9	1.7	7.1	10.8	1.8	3.9	0.16	0.28	0.04	0.10	0.04	0.04	7.3	7.4	-	-	-	-
Mar-21	0.046	0.069	3.8	5.1	1.6	2.5	8.1	12.8	3.4	7.3	0.22	0.34	0.09	0.19	0.04	0.04	7.3	7.4	-	-	-	-
Apr-21	0.058	0.096	4.2	6.1	2.1	3.6	10.9	12.8	5.4	8.3	0.27	0.31	0.13	0.21	0.05	0.05	7.4	7.6	-	-	-	-
May-21	0.079	0.114	3.6	5.0	2.1	3.1	10.4	16.8	6.1	9.1	0.23	0.31	0.14	0.20	0.11	0.11	7.3	7.6	1.0	1.0	1.0	1.0
Jun-21	0.109	0.139	4.0	5.9	3.5	5.0	8.7	12.2	7.5	10.2	0.33	0.48	0.29	0.40	0.06	0.06	7.2	7.3	1.0	1.0	1.0	1.0
Jul-21	0.136	0.176	4.6	5.8	5.1	6.9	8.7	11.8	9.6	14.0	0.43	0.50	0.47	0.59	0.05	0.05	7.2	7.4	1.0	1.0	1.4	3.2
Aug-21	0.124	0.144	3.8	4.9	3.9	5.5	8.7	11.4	8.8	10.8	0.45	0.53	0.46	0.53	0.07	0.07	7.2	7.3	1.0	1.0	1.0	1.0
Sep-21	0.099	0.128	3.1	3.5	2.5	3.4	6.6	8.4	5.4	7.4	0.33	0.40	0.27	0.37	0.10	0.10	7.3	7.4	1.0	1.0	1.0	1.0
Oct-21	0.087	0.112	2.7	3.4	1.8	2.6	6.1	7.2	4.1	4.9	0.25	0.28	0.17	0.22	0.07	0.07	7.2	7.3	-	-	-	-
Nov-21	0.032	0.060	2.3	2.9	0.5	1.0	6.2	9.8	1.4	2.5	0.18	0.24	0.04	0.08	0.07	0.07	7.1	7.2	-	-	-	-
Dec-21	0.030	0.052	2.7	3.0	0.8	1.3	9.4	12.0	2.6	3.9	0.25	0.33	0.07	0.10	0.05	0.05	7.1	7.2	-	-	-	-
Avg	0.072		3.4		2.1		8.3		4.8		0.28		0.19		0.13		7.3		1.0		1.1	
Off-Season Avg (Nov-Apr)	0.038		3.3		1.1		8.4		2.7		0.22		0.07		0.18		7.3		-		-	
Peak Avg (May-Oct)	0.106		3.6		3.2		8.3		7.0		0.34		0.30		0.08		7.2		1.0		1.1	
Max	0.136	0.176	4.6	6.1	5.1	6.9	10.9	16.8	9.6	14.0	0.45	0.53	0.47	0.59	0.82	0.82	7.4	7.6	1.0	1.0	1.4	3.2

Table #9
Village of Ephraim WWTF
2022 Plant Performance

Month	Effluent																					
	¹ Flow MGD		BOD				TSS				Total P				NH3-N		pH s.u.		Fecal Coliform #/100 mL		E. coli #/100 mL	
	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max		
Jan-22	0.026	0.045	2.7	3.3	0.5	0.7	10.1	13.8	2.1	3.1	0.24	0.32	0.05	0.07	0.12	0.12	7.2	7.3	-	-	-	-
Feb-22	0.025	0.034	2.7	3.0	0.5	0.6	9.1	10.8	1.7	2.1	0.20	0.23	0.04	0.04	0.04	0.04	7.1	7.3	-	-	-	-
Mar-22	0.054	0.183	3.1	4.4	1.8	6.7	10.8	18.6	6.6	28.3	0.23	0.40	0.14	0.61	0.20	0.20	7.2	7.4	-	-	-	-
Apr-22	0.094	0.181	3.4	5.2	2.7	3.8	15.1	22.0	11.6	15.7	0.26	0.38	0.21	0.32	0.04	0.04	7.4	7.4	-	-	-	-
May-22	0.116	0.174	4.2	5.8	3.7	4.8	14.4	19.0	12.6	20.7	0.28	0.32	0.25	0.35	0.23	0.23	7.3	7.4	-	-	1.0	1.0
Jun-22	0.118	0.133	3.4	4.1	3.3	4.4	9.8	20.0	9.5	21.2	0.38	0.49	0.36	0.47	0.08	0.08	7.3	7.4	-	-	1.5	2.0
Jul-22	0.137	0.150	4.8	7.4	5.4	9.2	10.4	13.0	11.7	16.0	0.45	0.58	0.51	0.67	0.08	0.08	7.2	7.3	-	-	1.2	2.0
Aug-22	0.121	0.141	3.9	6.5	3.9	7.4	9.6	17.6	9.8	20.0	0.36	0.63	0.37	0.71	0.13	0.13	7.1	7.2	-	-	1.0	1.0
Sep-22	0.095	0.123	4.3	4.8	3.3	4.4	11.9	15.8	9.0	13.8	0.34	0.45	0.26	0.39	0.09	0.09	7.2	7.4	-	-	1.0	1.0
Oct-22	0.088	0.105	3.7	4.5	2.5	2.8	11.0	13.8	7.1	7.8	0.29	0.42	0.16	0.21	0.06	0.06	7.1	7.2	-	-	-	-
Nov-22	0.027	0.038	3.0	3.7	0.6	0.9	9.1	11.2	1.8	2.7	0.21	0.26	0.04	0.06	0.10	0.10	7.1	7.3	-	-	-	-
Dec-22	0.026	0.051	3.2	4.1	0.7	1.1	12.3	15.6	2.5	4.0	0.25	0.36	0.05	0.09	0.05	0.05	7.2	7.5	-	-	-	-
Avg	0.078		3.5		2.4		11.1		7.3		0.29		0.21		0.10		7.2		-		1.1	
Off-Season Avg (Nov-Apr)	0.042		3.0		1.1		11.1		4.4		0.23		0.09		0.09		7.2		-		-	
Peak Avg (May-Oct)	0.115		4.0		3.8		11.2		10.2		0.35		0.33		0.11		7.2		-		1.1	
Max	0.137	0.183	4.8	7.4	5.4	9.2	15.1	22.0	12.6	28.3	0.45	0.63	0.51	0.71	0.23	0.23	7.4	7.5	-	-	1.5	2.0

¹ No flow data provided from 10/15/2022 through 11/7/2022.

Table #10
Village of Ephraim WWTF
2023 (Jan-Jun) Plant Performance

Month	Effluent																							
	Flow MGD		BOD				TSS				Total P				NH3-N		pH s.u.		Fecal Coliform #/100 mL		E. coli #/100 mL		Total Recoverable Arsenic ug/L	
	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max	Avg	Max
Jan-23	0.027	0.040	3.8	4.4	0.8	1.1	14.6	17.2	3.1	5.1	0.31	0.39	0.07	0.11	0.14	0.14	7.2	7.3	-	-	-	-	8.30	8.30
Feb-23	0.026	0.036	3.6	4.9	0.7	1.1	11.8	14.8	2.3	3.7	0.21	0.26	0.04	0.07	0.14	0.14	7.3	7.3	-	-	-	-	0.28	0.28
Mar-23	0.051	0.169	3.2	4.4	1.2	2.1	11.2	14.2	4.4	7.7	0.21	0.29	0.08	0.13	0.14	0.14	7.3	7.4	-	-	-	-	0.28	0.28
Apr-23	0.094	0.197	4.7	10.2	4.7	16.7	13.4	21.9	12.3	35.9	0.23	0.34	0.21	0.56	0.14	0.14	7.6	7.8	-	-	-	-	0.28	0.28
May-23	0.074	0.118	4.0	7.8	2.4	5.8	11.5	16.8	6.6	10.1	0.22	0.29	0.13	0.18	0.14	0.14	7.3	7.5	-	-	1.0	1.0	0.28	0.28
Jun-23	0.104	0.140	5.4	11.1	4.4	8.6	10.5	17.6	8.4	13.6	0.31	0.43	0.25	0.34	0.14	0.14	7.2	7.3	-	-	1.0	1.0	0.28	0.28
Jul-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Aug-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Sep-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Oct-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Nov-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Dec-23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Avg	0.063		4.1		2.3		12.2		6.1		0.25		0.13		0.14		7.3		-		1.0		1.62	
Off-Season Avg (Jan-Apr)	0.049		3.8		1.9		12.7		5.6		0.24		0.10		0.14		7.4		-		-		2.29	
Peak Avg (May-Jun)	0.089		4.6		3.3		11.0		7.4		0.26		0.18		0.14		7.3		-		1.0		0.28	
Max	0.104	0.197	5.4	11.1	4.7	16.7	14.6	21.9	12.3	35.9	0.31	0.43	0.25	0.56	0.14	0.14	7.6	7.8	-	-	1.0	1.0	8.30	8.30

¹ One (1) sample per month.

2019 through June 2023

Avg	0.078		3.7		2.5		9.9		6.3		0.30		0.21		0.10		7.2		1.3		1.5		1.62	
Off-Season Avg (Nov-Apr)	0.048		3.5		1.5		10.3		4.4		0.24		0.10		0.13		7.3		-		-		2.29	
Peak Avg (May-Oct)	0.109		4.0		3.5		9.6		8.4		0.35		0.33		0.07		7.1		1.3		1.5		0.28	
Max	0.141	0.265	5.4	11.1	5.4	16.7	16.4	22.0	14.6	35.9	0.56	0.88	0.64	0.92	0.82	0.82	7.6	7.9	3.1	6.3	3.9	9.5	8.30	8.30

DRAFT

April 26, 2023

Jason Knutson, Wastewater Section Chief
Wisconsin Department of Natural Resources
Bureau of Water Quality
PO Box 7921
Madison, WI 53707-7921

Re: Village of Ephraim
Wastewater Treatment Facility Plan
Request for Effluent Limits
WPDES Permit No. WI-0061271-07-1
McM. No. E0035-09-22-00363.04

Dear Mr. Knutson,

McMahon Associates, Inc. (McMAHON) has been retained by the Village of Ephraim to complete a Facilities Plan Amendment for their Wastewater Treatment Plant. McMAHON would like to request effluent discharge limits for use in Facilities Planning.

The Village of Ephraim's Wastewater Treatment Plant is located at 10285 Townline Road, Ephraim, WI 54234 in Door County. The facility's WPDES Permit number is WI-0061271-07-11. The current effluent limits are based upon a design discharge flow of 0.31 mgd. A summary of the current effluent limits are as follows:

- BOD₅ and TSS.....45 mg/l (Weekly Average)
- BOD₅ and TSS.....30 mg/l (Monthly Average)
- Total P0.6 mg/l (Monthly Average)
- pH 6 - 9 s.u. (Daily Minimum and Maximum)
- E. coli126#/100 ml (Geometric Monthly Mean, May through September)
- E. coli10 (% Exceedance > 410#/100 ml, May through September)
- Total NH₃-N.....18 mg/l (Daily Max, Weekly Average, and Monthly Average)

The design flows and loadings determined in the Facilities Plan Amendment and the Plant's rated capacity are summarized in the table below.

DESIGN FUTURE FLOWS & LOADINGS VS. DESIGN CRITERIA

Parameter	PEAK SEASON		OFF-SEASON	
	Design	Rated Capacity	Design	Rated Capacity
Flow, mgd				
Average Day	0.114	0.310	0.050	0.083
Max Day	0.270	0.620	0.197	0.165
BOD, lbs./day				
Average	142	1,400	33	300
Max Day	466	2,100	136	600
TSS, lbs./day				
Average	152	1,200	40	250
Max Day	599	1,800	311	500
Total P, lbs./day				
Average	-	48	-	10
Max Day	-	72	-	20

If you have any questions or if you need additional information, please contact me at 920-751-4200, ext. 332 or via email to elang@mcmgrp.com.

Respectfully,

McMahon Associates, Inc.

Ethan Lang / jlh

Ethan S. Lang, E.I.T.
Water & Wastewater Engineer

ESL:jlh

cc: Anthony Kappell, McMAHON

DRAFT

**Village of Ephraim WWTF
I/I Analysis**

Gravity Sewer

Diameter (in.)	Length (ft)	(in-mi)
8	31,311	47.4
10	5,136	9.7
Total	36,447	57.2

Population Estimate	345
---------------------	-----

2019

Base Flow

Min. Avg. Week Flow (MGD)	0.030	Corresponds to week of 2/7/2019 through 2/13/2019.
---------------------------	-------	--

Infiltration

Max Flow Week w/o Precip. (MGD)	0.149	Corresponds to week of 8/9/2019 through 8/15/2019.	
Infiltration (MGD)	0.119		
Based on in./mi (gpd/in-mi)	2,082	Non-Excessive	*Excessive if >3,000 to 6,000 gpd/in-mi for sewers between 10,000 to 100,000 ft.
Based on Population (gpcd)	345	Excessive	*Excessive if DWF >120 gpcd.

Inflow

Influent Flow (MGD)	Date	Inflow (gpcd)	Excessive / Non Excessive	
0.2643	8/12/2019	766	Excessive	*Excessive if WWF > 275 gpcd.
0.1661	7/6/2019	481	Excessive	*Excessive if WWF > 275 gpcd.
0.1623	6/16/2019	470	Excessive	*Excessive if WWF > 275 gpcd.

2020

Base Flow

Min. Avg. Week Flow (MGD)	0.030	Corresponds to week of 12/14/2020 through 12/20/2020.
---------------------------	-------	---

Infiltration

Max Flow Week w/o Precip. (MGD)	0.142	Corresponds to week of 7/1/2020 through 7/6/2020.	
Infiltration (MGD)	0.112		
Based on in./mi (gpd/in-mi)	1,959	Non-Excessive	*Excessive if >3,000 to 6,000 gpd/in-mi for sewers between 10,000 to 100,000 ft.
Based on Population (gpcd)	325	Excessive	*Excessive if DWF >120 gpcd.

Inflow

Influent Flow (MGD)	Date	Inflow (gpcd)	Excessive / Non Excessive	
0.2031	8/10/2020	589	Excessive	*Excessive if WWF > 275 gpcd.
0.1749	5/18/2020	507	Excessive	*Excessive if WWF > 275 gpcd.
0.1684	7/19/2020	488	Excessive	*Excessive if WWF > 275 gpcd.

2021

Base Flow

Min. Avg. Week Flow (MGD)	0.024	Corresponds to week of 11/28/2021 through 12/4/2021.
---------------------------	-------	--

Infiltration

Max Flow Week w/o Precip. (MGD)	0.140	Corresponds to week of 8/1/2021 through 8/7/2021.	
Infiltration (MGD)	0.116		
Based on in./mi (gpd/in-mi)	2,029	Non-Excessive	*Excessive if >3,000 to 6,000 gpd/in-mi for sewers between 10,000 to 100,000 ft.
Based on Population (gpcd)	336	Excessive	*Excessive if DWF >120 gpcd.

Inflow

Influent Flow (MGD)	Date	Inflow (gpcd)	Excessive / Non Excessive	
0.1818	7/24/2021	527	Excessive	*Excessive if WWF > 275 gpcd.
0.1517	7/5/2021	440	Excessive	*Excessive if WWF > 275 gpcd.
0.1448	6/27/2021	420	Excessive	*Excessive if WWF > 275 gpcd.

2022

Base Flow

Min. Avg. Week Flow (MGD)	0.021	Corresponds to week of 12/18/2022 through 12/24/2022.
---------------------------	-------	---

Infiltration

Max Flow Week w/o Precip. (MGD)	0.144	Corresponds to week of 7/14/2022 through 7/20/2022.	
Infiltration (MGD)	0.123		
Based on in./mi (gpd/in-mi)	2,152	Non-Excessive	*Excessive if >3,000 to 6,000 gpd/in-mi for sewers between 10,000 to 100,000 ft.
Based on Population (gpcd)	357	Excessive	*Excessive if DWF >120 gpcd.

Inflow

Influent Flow (MGD)	Date	Inflow (gpcd)	Excessive / Non Excessive	
0.1843	3/23/2022	534	Excessive	*Excessive if WWF > 275 gpcd.
0.1830	4/6/2022	530	Excessive	*Excessive if WWF > 275 gpcd.
0.1720	5/12/2022	499	Excessive	*Excessive if WWF > 275 gpcd.

2023

Base Flow

Min. Avg. Week Flow (MGD)	0.022	Corresponds to week of 1/28/2023 through 2/3/2023.
---------------------------	-------	--


Infiltration

Max Flow Week w/o Precip. (MGD)	0.127	Corresponds to week of 6/16/2023 through 6/22/2023.	
Infiltration (MGD)	0.105		
Based on in./mi (gpd/in-mi)	1,837	Non-Excessive	*Excessive if >3,000 to 6,000 gpd/in-mi for sewers between 10,000 to 100,000 ft.
Based on Population (gpcd)	304	Excessive	*Excessive if DWF >120 gpcd.


Inflow

Influent Flow (MGD)	Date	Inflow (gpcd)	Excessive / Non Excessive	
0.1968	4/4/2023	570	Excessive	*Excessive if WWF > 275 gpcd.
0.1702	3/31/2023	493	Excessive	*Excessive if WWF > 275 gpcd.


Village of Ephraim WWTF 2019 Influent Flow and Precipitation

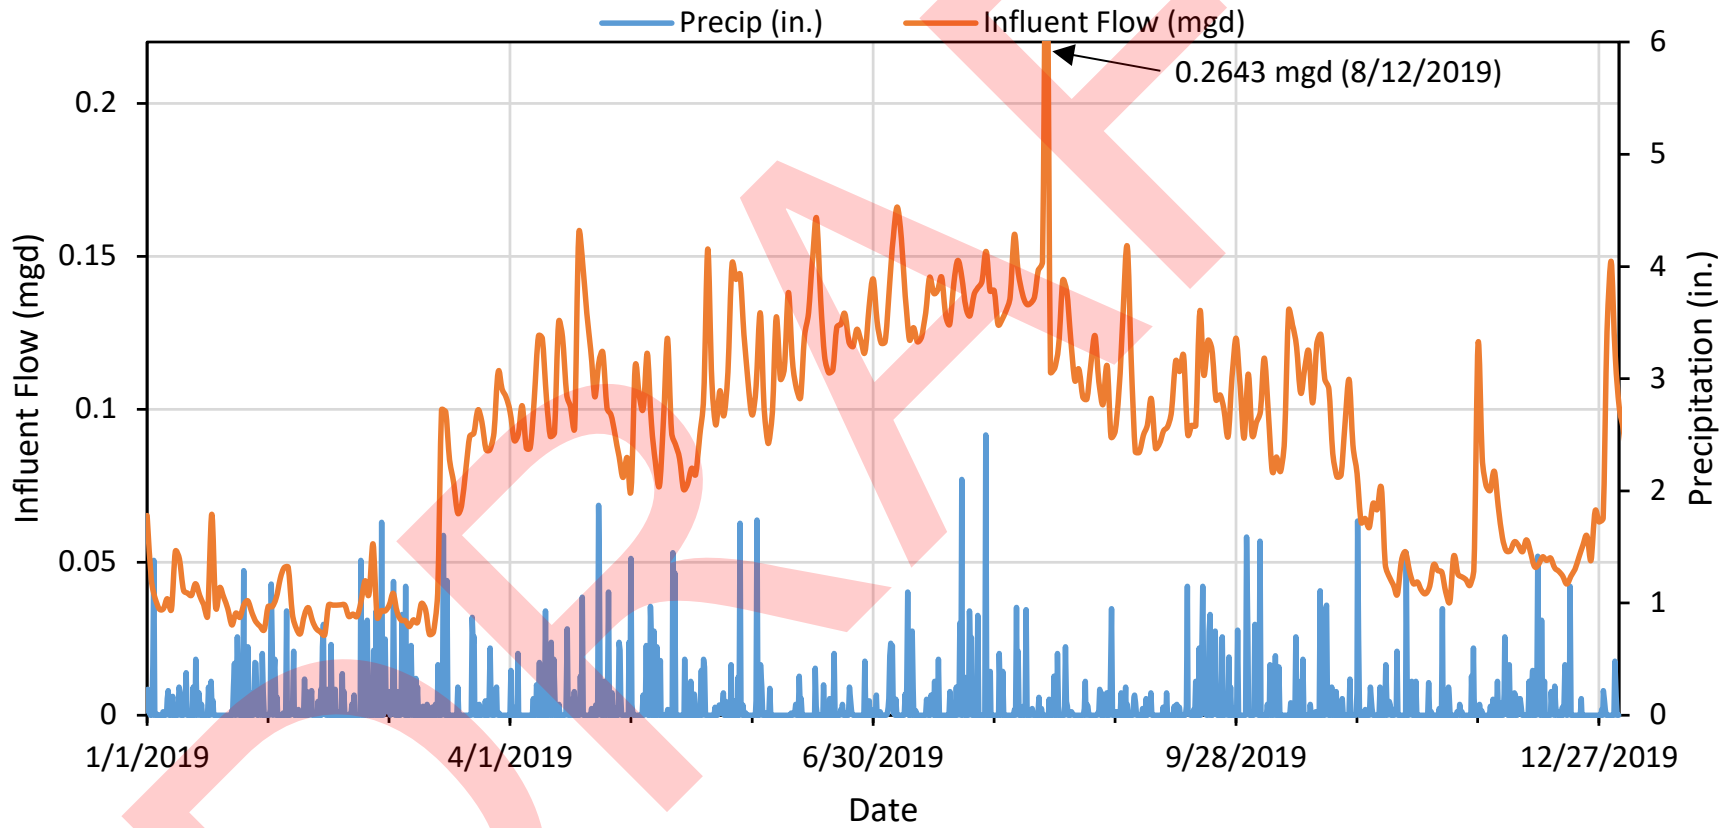


Village of Ephraim WWTF 2020 Influent Flow and Precipitation

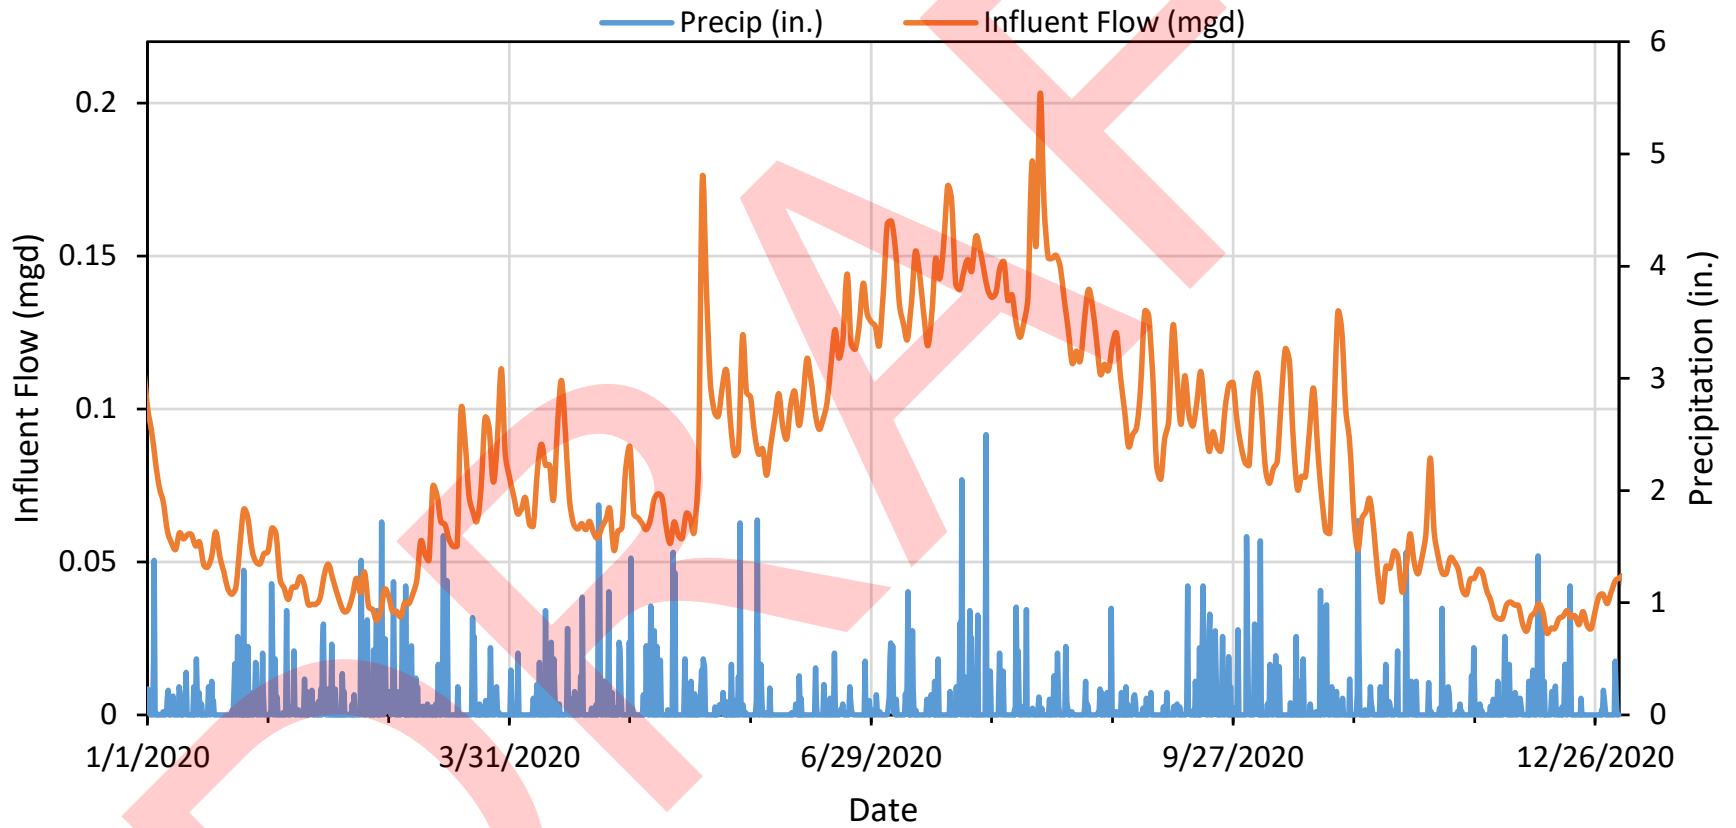


Village of Ephraim WWTF 2021 Influent Flow and Precipitation

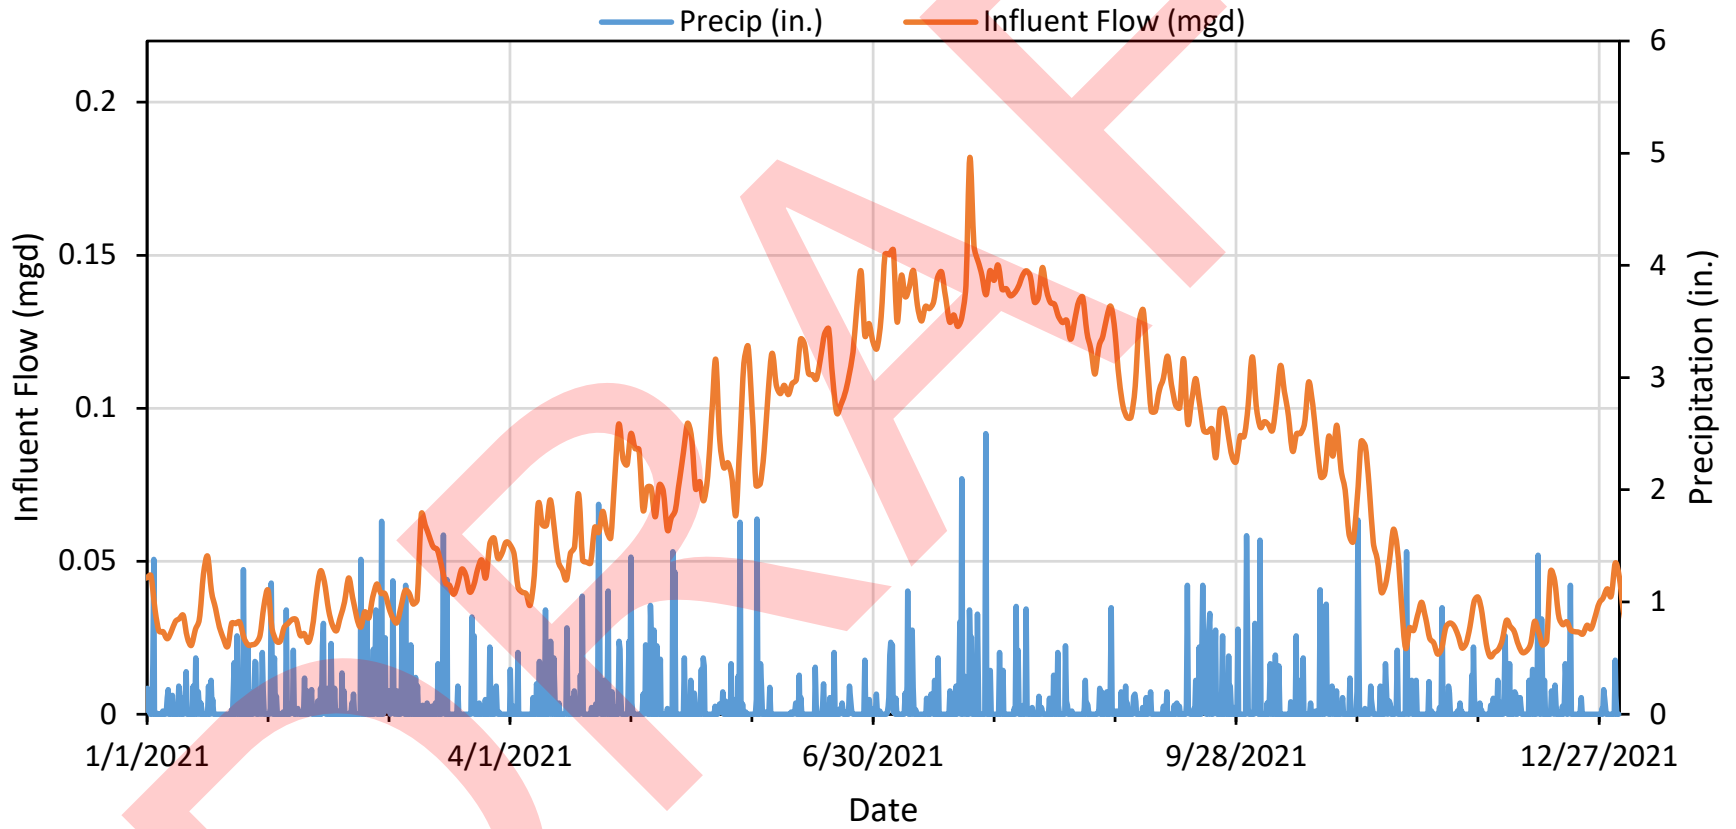

Village of Ephraim WWTF 2022 Influent Flow and Precipitation

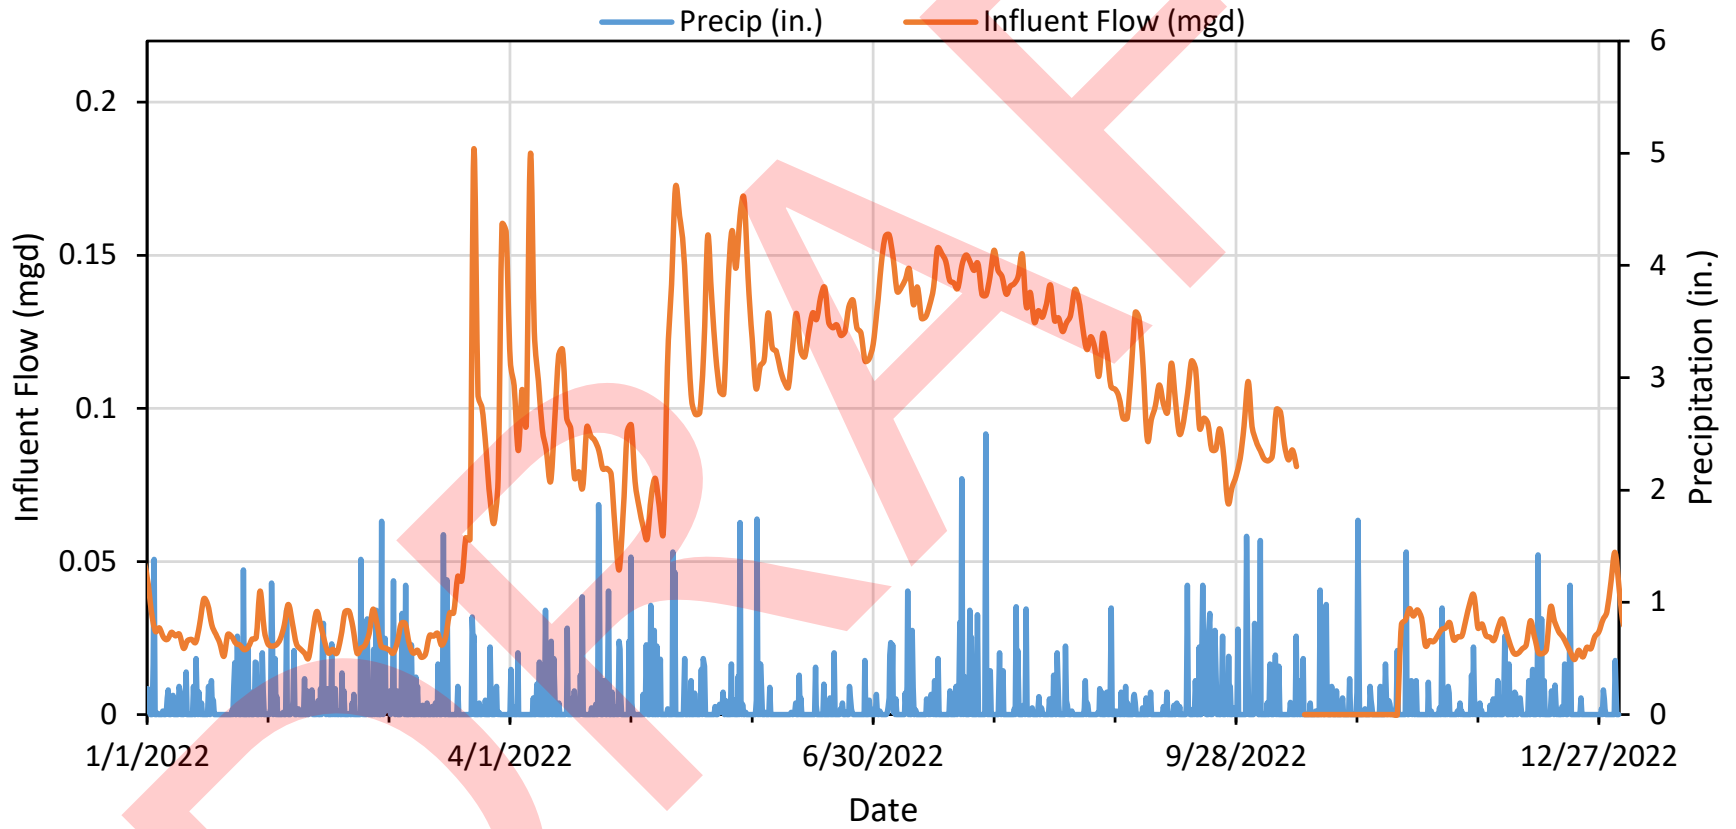

Village of Ephraim WWTF 2023 Influent Flow and Precipitation

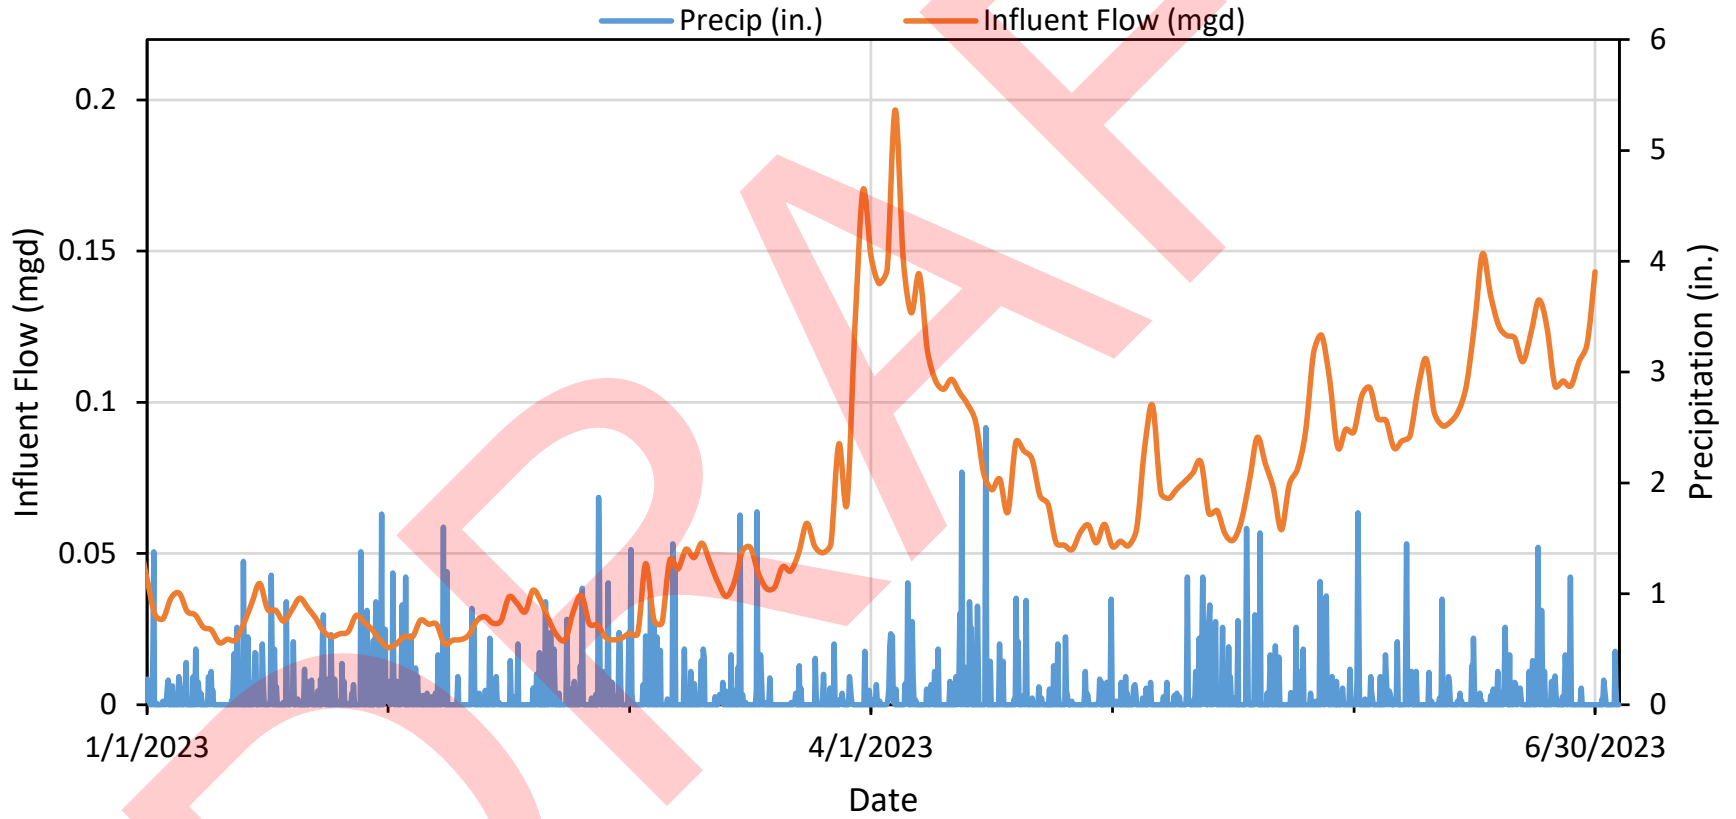


DRAFT


MARKETING & BRAND STRATEGY

DOORCOUNTY.COM

Overall traffic was down compared to 2021 for the month of September following the same trend we have noted through prior months. Traffic on site from all sources combined is still lower than what we saw in 2021 and 2020 due to record interest and traffic during the COVID19 pandemic. Organic traffic accounted for the most sessions on site seeing over 91,000 sessions last month. Paid search traffic was the next most popular channel with 33,000 sessions followed by direct traffic and (other) traffic accounting for around 20,000 sessions each.

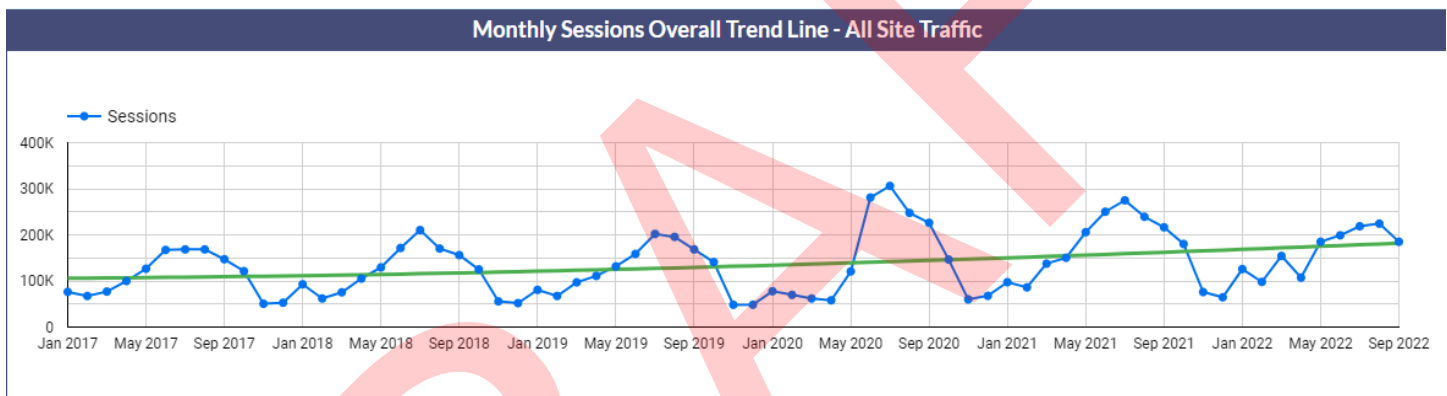

Below, you'll see 2022 sessions compared to 2019. While we continue to compare YOY as we traditionally have done, it's important to also note where we stand when looking at pre-pandemic levels. The tourism industry has embraced the idea that 2019 is the last 'normal' year before COVID and is measuring against those numbers across the board. You can see our sessions have been slightly up from 2019 each month this year.

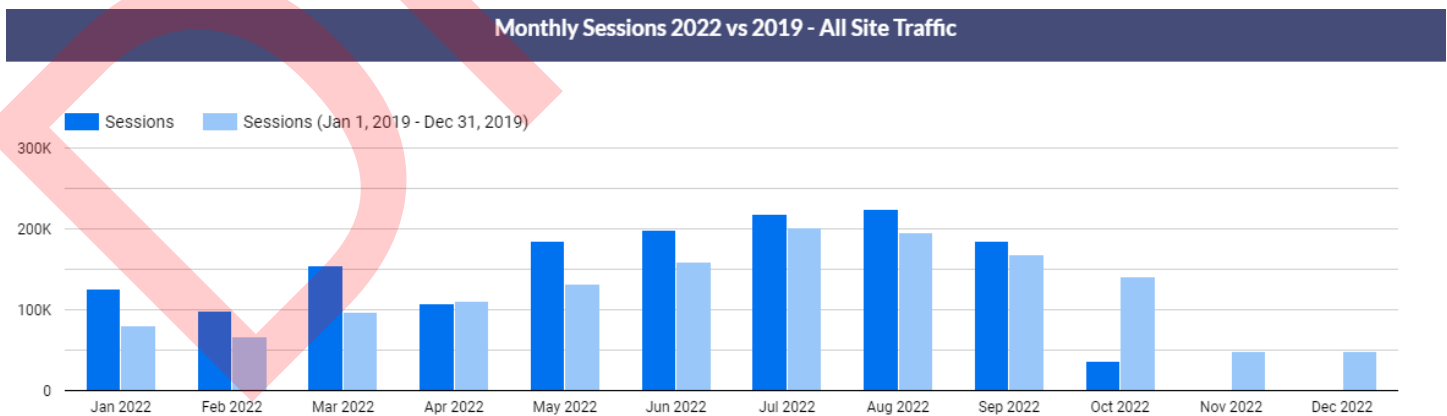

The table below highlights the conversion activity on site for the month. When the new Kentico site launched in July we established the most important conversion goals and are now tracking 9 specific goals to gauge performance of traffic on the site:

All Goal Completions		
Goal 1 - Newsletter Sign-Ups 1,673	Goal 2 - Interest Profile Completions 2	Goal 3 - Booking Widget Submission 6,395
Goal 4 - View Guide Online (All Guides) 3,439	Goal 5 - Trip Planner Quiz Completion 1,091	Goal 6 - Register for Account 344
Goal 7 - Session Duration > 3min 46,048	Goal 8 - Pledge for DDC Completion 57	Goal 9 - Business Directory Site Click 1

ENEWSLETTER

The September newsletter saw some great numbers, open rates have been strong and we saw a very high number of clicks. Some of the most engaged links within the newsletter for the month were the 20 things to do in fall in Door County article and the 5 chef teams article. These two links combined saw almost 7,400 clicks of the 14,058 total clicks.

September Newsletter - Combined Sends				
Total Recipients 231,267	Successful Deliveries: 229,759	Recipients Who Opened: 95,595	Combined Total Open Rate 61.13%	Combined Total Click Rate 6.12%
Recipients Who Clicked: 7,464	Total Opens: 140,445	Total Clicks: 14,058	Combined Unique Open Rate 41.61%	Combined Unique Click Rate 3.25%

PAID MEDIA

In September we continued our fall campaign including digital interactive, paid social, digital boards and EVS stations. Across all channels, we were able to generate 6.4million impressions with messaging focused on planning a fall visit as well exploring responsibly once you arrive. When it comes to website traffic, the campaigns drove 52K users to DoorCounty.com.

Google Adwords

September's campaign, YOY, saw an increase in clicks (28,411 - up 28%) but impressions were down just slightly (130,183 - down 5.6%). Compared to 2019, clicks and impressions were both up (41% and 10.7% respectively). Hotels, Resorts and Things to do ad groups saw an increase in impressions served, while Events & Festivals, Pet Friendly, Cabins, Wineries, and Romantic Getaways saw a decrease. Events and Family Attractions ad groups had the highest CTR.



Digital Interactive Ad Results

Fall digital ads ran in our primary markets and included banner, native and mobile video for the month of September. Overall, ads generated 2.23mm impressions with 4,697 clicks. Additionally, in-market display ads ran focusing on Care for Door County messaging and responsible travel serving up 260K impressions and 400 clicks to DoorCounty.com.

Paid Social Campaign

In September, we ran paid social campaigns out-of-county as well as in-market. Our in-market ads followed suite with digital interactive, focusing on Care for Door County messaging. This campaign garnered 150K impressions and 1400 clicks. Out-of-county inspired travelers to visit Door County, with 1.6mm impressions and 17K clicks.



Out of Home

Digital billboards and electric vehicle charging station ads focused on fall travel messaging from 8/22 -

9/12. Billboards ran in all 5 primary markets (Chicago, Green Bay, Madison, Milwaukee, Minneapolis) and electric vehicle charging station ads ran in Chicago only. Total impressions for out of home ads were 1MM.



Streaming Audio - In-Market

Our Care for Door County ad began running 9/12 on Pandora, reaching 128K listeners.

ORGANIC SOCIAL

FACEBOOK

Although total impressions were down 2.7% over last month, organic impressions saw a 68.3% increase! While placing an emphasis on publishing more content that keeps the users on the platform, our re-shares saw a 41.6% increase over last month.

Received Messages: 344 Private Messages

INSTAGRAM


Coming off a really high month last month with a hosted giveaway on the platform and an organic reel that did really well, metrics have dropped for this month, 18% decrease in impressions and 31% decrease in engagement. By putting more of an emphasis on video content, we did see a small 7% increase in saved content.

Received Messages: 58 Direct Messages

TWITTER


This was a great month for this platform. We saw a 224% increase in total impressions, and a 117% increase in engagement on our tweets. Users are enjoying more question and answer type posts, and beginning to engage more with our content.


Received Messages: 82 Mentions, 12 Retweets

 134,087 Followers

 76,731 Followers

 8,292 Followers

 2,146 Followers


 2,530 Followers

 313 Followers

TOP PERFORMING POSTS

Destination Door County
Tue 9/13/2022 8:05 am PDT


Come enjoy the fall colors in Ephraim - Door County, Wisconsin! There's no better place to watch the changing of the seasons than on th...



Total Engagements	3,679
Reactions	1,589
Comments	203
Shares	140
Post Link Clicks	304
Other Post Clicks	1,443

doorcounty
Fri 9/16/2022 7:59 am PDT


While most people prefer to dig their toes in the sand, Schoolhouse Beach, on the northern reaches of Washington Island here in...



Total Engagements	4,843
Likes	4,234
Comments	42
Saves	185

@mydoorcounty
Wed 9/21/2022 2:14 pm UTC

One of the oldest trees here in #DoorCounty. Do you know where it planted its roots? Let us know your guess in the comments...



Total Engagements	93
Likes	15
@Replies	6
Retweets	1
Post Link Clicks	2
Other Post Clicks	69
Other Engagements	0


GROUP & MEETING



In September we were busy helping groups finalize tour plans for October and heard from a number of operators starting to plan for 2023. We provided 236 welcome bags for different bus tours that came through the county this month. Circle Wisconsin held their annual board retreat in Door County Sept 27th-28th and was hosted by Rowleys Bay Resort.

We assisted Landmark Resort in the RFP process to hopefully bring at least one of three 100+ attendee events hosted by WSAE and a larger/international association event that is considering Door County among several other cities throughout the world.


SEPTEMBER VISITATION

In September, the majority of our visitors came from the Green Bay/Appleton area followed by Milwaukee and then Chicago. The top communities visited were Sturgeon Bay, Fish Creek, Sister Bay and Egg Harbor. Visitor to resident ratio was high across every community with the exception of Southern Door and Sturgeon Bay that saw a more even balance closer to 1 to 1. (Note: When comparing visitor to resident ratio in various destinations, Zartico has determined a Visitor-to-Resident Ratio of less than 1, tends to have little resident friction. Between 1 & 1.5 has increasing friction and for prologued periods above 1.5 a proactive destination management plan is recommended.

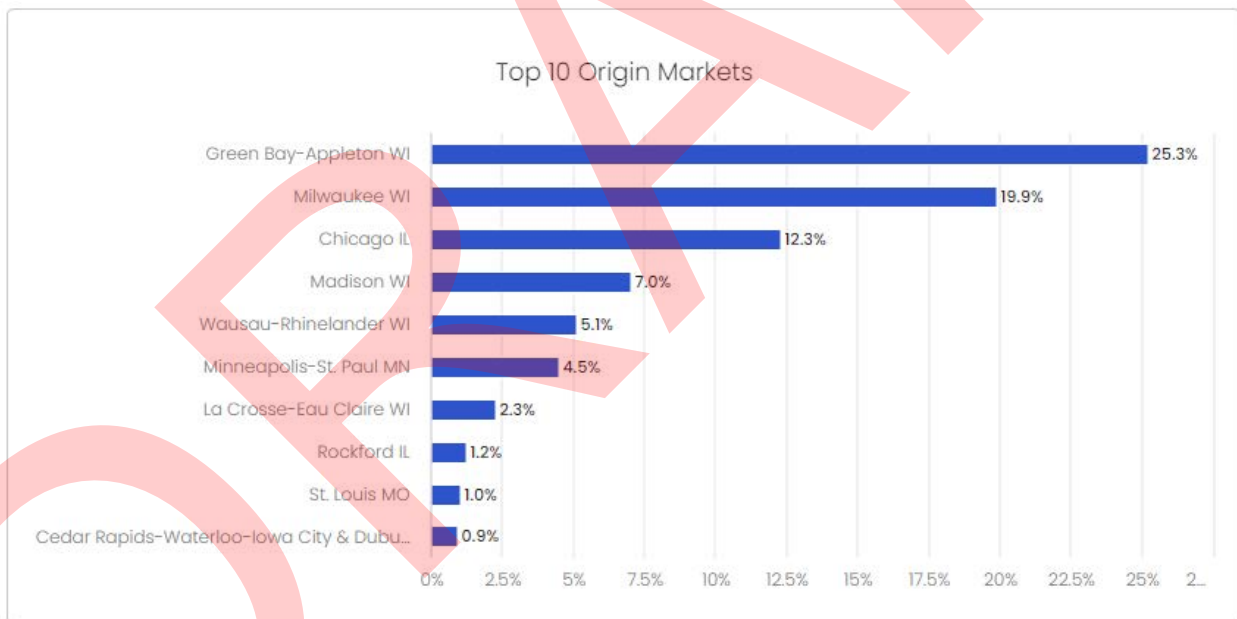


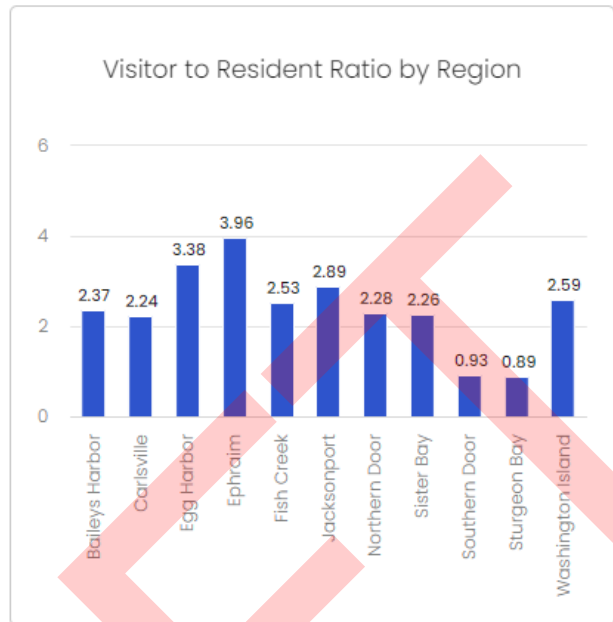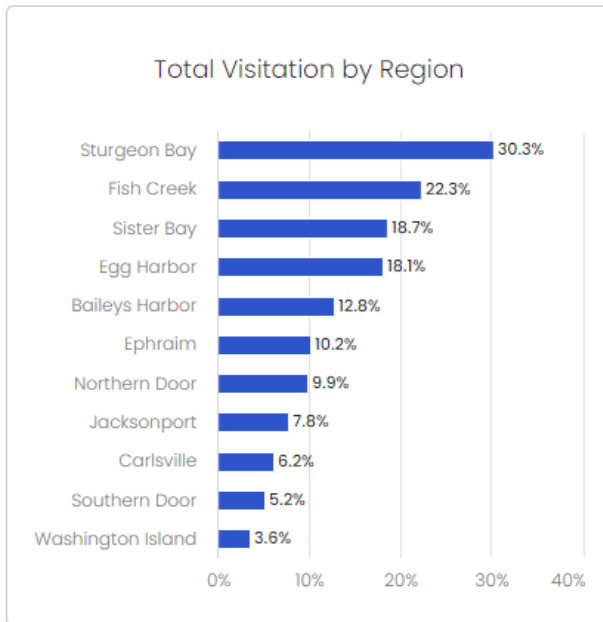


When comparing visitor to resident ratio over the past 12 months, we can see where there are opportunities to spread visitation to times and places where the visitation is less to ease resident friction during times the balance exceeds 1.5. We can also take into account where people are coming from during those times to better focus messaging.

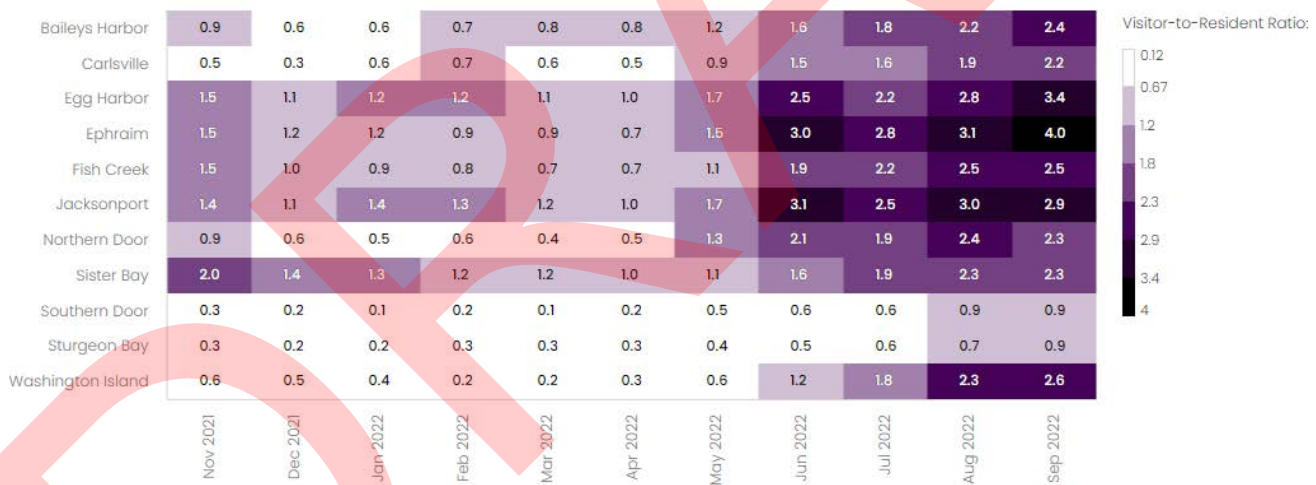

Seasonality In Visitation By Origin Market

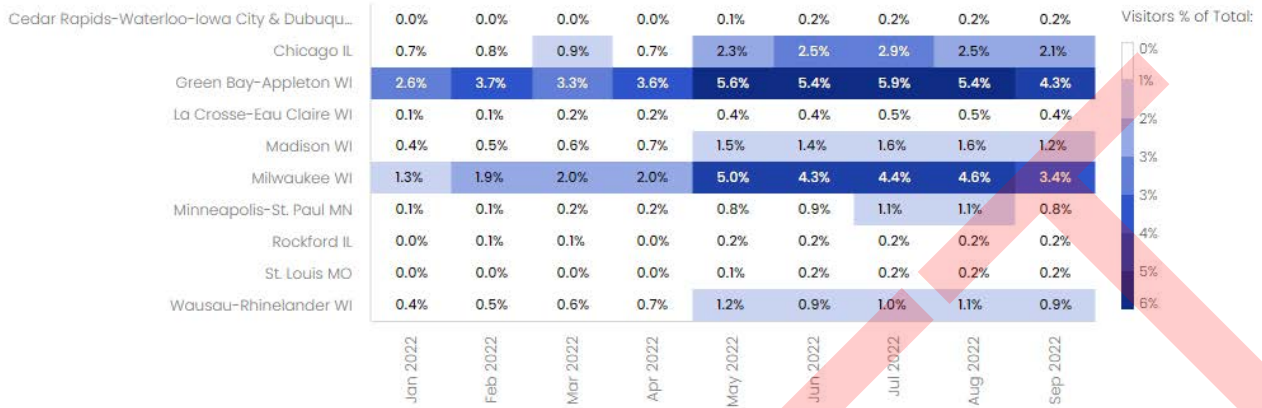

Visitation by Region by Season

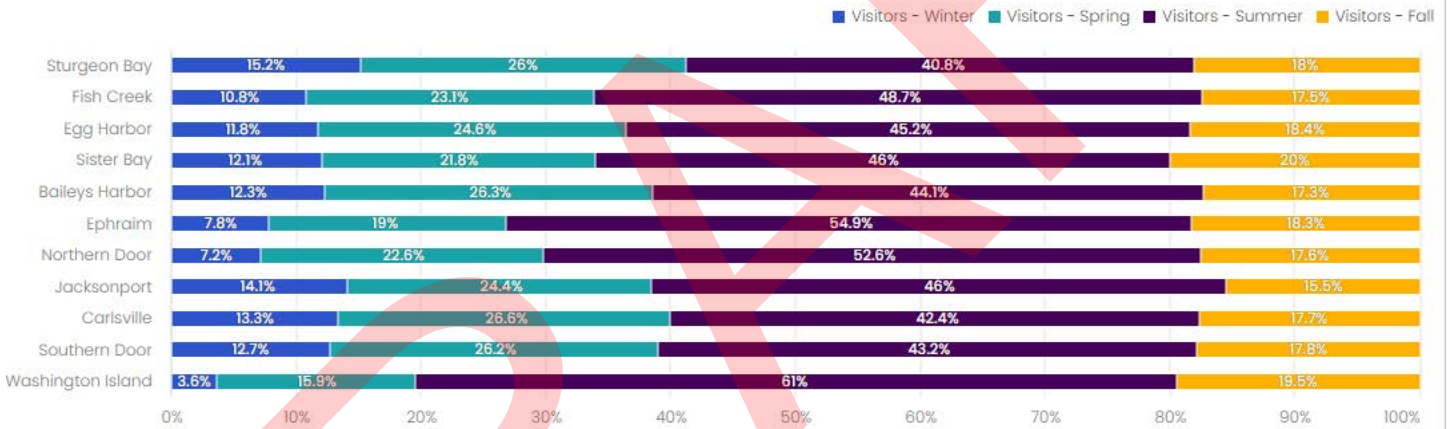


COMMUNICATIONS & ADVOCACY

- Media assistance was provided to **10** journalists/media outlets in September by providing images, information, on-air/on-camera interviews and/or support for Door County based articles/stories. Some highlights included Experience Wisconsin magazine, Lake Homes Lifestyle magazine, AAA Living Wisconsin and the Waukesha Freeman.
- **14** articles were reported from our earned media marketing program efforts in September and reached a total of **14,075,379** readers/listeners/viewers. Select media outlets that ran Door County stories during the reported time included *Southern Boating Magazine*, *Family RVing Magazine*, *FOX 7 Austin*, *Travel Awaits*, and *Matador Network*. View all program articles via our Google Drive folder at <http://tinyurl.com/yafamdpg>.
- In September, articles reported through our earned media marketing program generated **\$213,354** worth of media coverage measured in terms of ad value equivalency. Since this program began in 2007, we've generated a total of **\$36,861,737** in earned media coverage for Door County.
- The return on investment for our earned media marketing program to date is **1,301%**. For every dollar spent, we have gotten back **\$13.01** worth of Door County media coverage measured in terms of ad value equivalency.
- We have two press trips remaining in 2022. Our next scheduled trip is set for October 23-26. View our complete 2022 [press trip schedule](#). Our last trip of the year is in December.
- We welcomed 8 journalists on an arts and culinary themed press trip September 18-21.
- We hosted journalist Lori Helke on an individual press trip, September 7-9.
- We hosted journalist Rob Taylor on an individual press trip, September 25-28.
- We distributed a [media release](#) to local media encouraging tourism stakeholders to complete a special survey to help provide insight and feedback to DDC
- Views of DDC produced videos across all online platforms totaled **175,365** in September. Our most watched videos on Facebook included a video about Rock Island State Park, a video about area shipwrecks, and a video about DDC's Care for Door County program. On YouTube, the most watched video was a sponsored video about fall hiking in Door County, next was a sponsored video about summer kayaking, and third was a video about shipwrecks in Door County.

Recent Media Highlights

- *Travel Awaits* highlighted fall in Door County in a story titled, "15 Amazing Door County Experiences That Are Better in Fall." Read the story on travelawaits.com.
- Door County was highlighted in the *Milwaukee Journal Sentinel* on September 25, 2022 in a story about our "key to the door" recipient, AJ Dillon. Read the story on jsonline.com. A corresponding story gave a local perspective - "Locals give Packers' AJ Dillon suggestions on what to do and see in Door County." Read the story on jsonline.com.
- Fall in Door County was highlighted in Minnesota's *Star Tribune* in a story titled, "Door County is Wisconsin's Fall Color Capital – and it looks even better from the water." Read the story on startribune.com.
- *EATER* Chicago featured the Door County Wine Trail in a story titled, "The Midwest's Best Wine Road Trips for a Scenic Getaway From Chicago." Read the story at chicago.eater.com.
- Door County was featured in a 6-page story in the September 2022 issue of *family RVing Magazine*.
- Matador Network highlighted Door County in a story by Anela Malik. Read the story at matadornetwork.com.

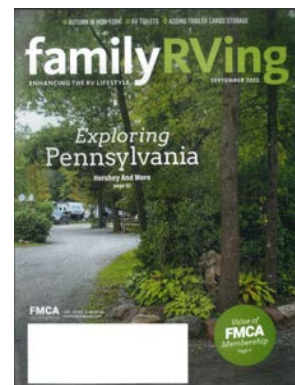

Annual Dinner

Preparations for our 97th Annual Dinner, scheduled for October 18, 2022, are underway and coming together very well. Registrations came in strong reaching 149 as our deadline hit and the seating capacity at Burton's is 150. Since then, we had 20 more interested individuals request to be on the waitlist and I'm thrilled to say that Burton's has given us permission to seat additional attendees at the high-tops in the adjacent lounge area to accommodate all 20 - who were more than happy to accept seating in the bar area. I believe this is the largest gatherings we have had for a sit-down Annual Dinner in decades!

Digital Equity and Inclusion

While this committee is in the early development stages, Quantum Technologies was able to offer a series of Digital Equity and Inclusion workshops in partnership with United Way of Door County, We Are Hope, Destination Door County, Help of Door County and the Door County Library.

Workshops, led by Nathan Drager and Erin Helgeson of Quantum Technologies and hosted at the Aging and Disability Resource Center (ADRC), are intended to help anyone struggling with technology in the digital world. The workshops will cover foundational topics such as: How to Get Connected to the Internet, How to Use Wifi, How to Use an iPhone, How to Create an Email Address and How to Stay Safe Online.

The series of workshops also included an evening session with an English-Spanish translator from the United Way of Door County. Workshops were offered Oct. 4-7, and the Spanish language workshop on Oct. 6.

Our local DEI committee is a collaboration of local organizations working to create solutions and raise awareness addressing home internet access, personal devices, and local technology training and support programs throughout the community to help ensure no one in our community is left at a disadvantage by not being able to access opportunities for support, work-search and education that are available online. Watch for more developments as we create meaningful opportunities for DDC partners to make a difference in our community.

MatchUp Door County - Light Duty Workforce Initiative

Work on the development of the MatchUp Door County program is all coming together and being prepared for testing. More on this next month. Committee members include Cynthia Germain – Do Good Door County; Jewel Ouradnik – Rowleys Bay Resort; Diane Taillon – Arbor Crowne Properties; Heather Mundy – Sunshine House; Allyson Fleck – Midsummer's Music; Cathy Clark – We Are Hope, Inc.; Jeremy Paszczak – Sunshine House; Tyler Powell – Door County YMCA; and others involved with learning in retirement, and those serving clients with special needs. While the MatchUp program will offer individual support and training, the program itself is not exclusive to individuals with special needs, as it will also help area businesses identify themselves as a MatchUp employer that is trained to support and gratefully welcome applicants with limitations on time or abilities.

Aging Coalition of Door County

The Aging Coalition of Door County (ACDC) is working with St. Norbert's College to craft a meaningful survey to better assess how our aging residents are preparing for housing and care needs as they grow older, and where any lack of preparedness or services need attention. It has been an enlightening process and I'm very proud to represent our organization and collective tourism industry at the table.

Summer Work Travel Host Employers

Fielding a lot of calls from partners who are looking for inside advice for finding the right Sponsor to work with to become a SWT Host Employer. Each scenario is so different than the next and it's very rewarding to hear their confidence restored after we have talked.

Partner Report - September 2022 EOM

Total Partners: 687

New/Rejoined Active Partners September 2022: 9

New

Category	Business Name	Physical Address	City	Date Added
Services	Enclave by Jodi Rose Studio	120 S Madison Ave	Sturgeon Bay	9/1/2022
Hotels/Motels/B&B's	Goose & Twigs Lodging and Café	2322 Mill Rd	Sister Bay	9/1/2022
Services	BOLD. hydration	714 Jefferson St	Sturgeon Bay	9/14/2022
Retail	Knit Whit's Yarn & Crafts	8024 State Highway 57	Baileys Harbor	9/21/2022
Education/Classes	The Garden Door	4312 WI Hwy 42	Sturgeon Bay	9/21/2022
Retail	The Red Geranium	8024 State Highway 57	Baileys Harbor	9/21/2022
Retail	Door County Wildwood Market	2208 Wildwood Road	Sister Bay	9/22/2022
Cottage/Home/Condo/Vacation Rental	Dragonfly Dell Cottage	12465 Cedar Dell Lane	Ellison Bay	9/27/2022
Cottage/Home/Condo/Vacation Rental	Shoreline Village Condominiums	12747 Hwy 42	Ellison Bay	9/28/2022

Inactive

Drop Reason	Category	Account Name	Address	City	Date
Closed	Restaurants/Cafes/Taverns	Parador	7829 Highway 42	Egg Harbor	9/12/2022

Partnership Web Stats for September 2022 <https://www.doorcounty.com/partnership/>

Sep 1, 2022 - Sep 30, 2022

All Users
100.00% Entrances

+ Add Segment


Explorer Entrance Paths

Summary Site Usage Goal Set 1 Goal Set 2 Goal Set 3 Goal Set 4 Ecommerce

Sessions VS. Select a metric

Day Week Month

Sessions

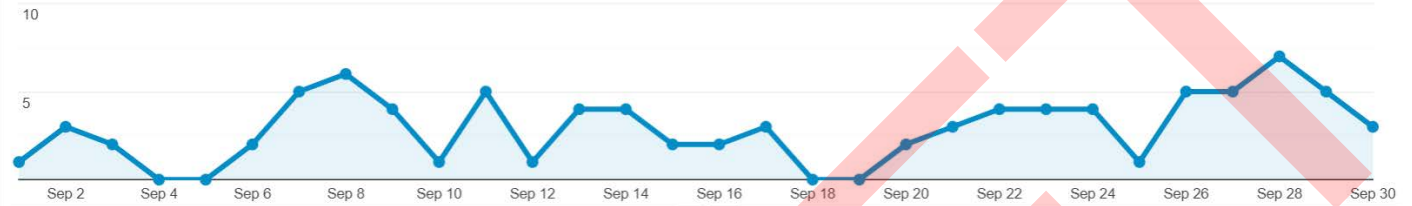

Primary Dimension: Landing Page Other







Plot Rows Secondary dimension Sort Type: Default partnership advanced

Landing Page	Acquisition			Behavior			Conversions		
	Sessions	% New Sessions	New Users	Bounce Rate	Pages / Session	Avg. Session Duration	Listing Index Book Now Button Click (Results Page) (Goal 3 Conversion Rate)	Listing Index Book Now Button Click (Results Page) (Goal 3 Completions)	Listing Index Book Now Button Click (Results Page) (Goal 3 Value)
	88 % of Total: 0.05% (185,033)	45.45% Avg for View: 68.24% (-33.39%)	40 % of Total: 0.03% (126,266)	79.55% Avg for View: 54.73% (45.34%)	1.50 Avg for View: 2.73 (-45.11%)	00:02:16 Avg for View: 00:03:06 (-26.65%)	0.00% Avg for View: 0.00% (0.00%)	0 % of Total: 0.00% (0)	\$0.00 % of Total: 0.00% (\$0.00)
1. /partnership	33 (37.50%)	54.55%	18 (45.00%)	69.70%	1.97	00:02:49	0.00%	0 (0.00%)	\$0.00 (0.00%)
2. /partnership/post-jobs	19 (21.59%)	5.26%	1 (2.50%)	84.21%	1.21	00:01:00	0.00%	0 (0.00%)	\$0.00 (0.00%)
3. /partnership/partner-resources/research-planning	14 (15.91%)	42.86%	6 (15.00%)	85.71%	1.36	00:04:31	0.00%	0 (0.00%)	\$0.00 (0.00%)
4. /partnership/spirit-of-door-county-scholarship	9 (10.23%)	88.89%	8 (20.00%)	100.00%	1.00	00:00:00	0.00%	0 (0.00%)	\$0.00 (0.00%)
5. /partnership/environmental-resources	5 (5.68%)	40.00%	2 (5.00%)	100.00%	1.00	00:00:00	0.00%	0 (0.00%)	\$0.00 (0.00%)
6. /partnership/the-power-of-tourism-in-door-county	3 (3.41%)	66.67%	2 (5.00%)	66.67%	1.33	00:01:22	0.00%	0 (0.00%)	\$0.00 (0.00%)
7. /partnership/j-1-visa-resources	2 (2.27%)	100.00%	2 (5.00%)	50.00%	1.50	00:00:09	0.00%	0 (0.00%)	\$0.00 (0.00%)
8. /discover/media-assistance/destination-door-county-forms-sustainable-tourism-partnership-with-leave-no-trace	1 (1.14%)	100.00%	1 (2.50%)	100.00%	1.00	00:00:00	0.00%	0 (0.00%)	\$0.00 (0.00%)
9. /partnership/partner-resources/annual-audit	1 (1.14%)	0.00%	0 (0.00%)	0.00%	2.00	00:20:33	0.00%	0 (0.00%)	\$0.00 (0.00%)
10. /partnership/partner-resources/research-and-planning	1 (1.14%)	0.00%	0 (0.00%)	100.00%	1.00	00:00:00	0.00%	0 (0.00%)	\$0.00 (0.00%)

Partner Social Media Stats for September 2022







Farthest reaching posts:

Content ⓘ Sort by: Reach ▾

 <p>Thu Sep 8, 5:16pm Wisconsin *might* not be ... Post Reach 2,301</p>	 <p>Thu Sep 15, 12:37pm Voting for Wisconsin Hotel... Post Reach 1,659</p>	 <p>Mon Sep 19, 10:18am COOL THING ALERT... Post Reach 1,225</p>
 <p>Wed Sep 7, 6:22pm Wisconsin *might* not be ... Post Reach 1,090</p>	 <p>Mon Sep 26, 4:26pm Fall is definitely in th... Post Reach 471</p>	 <p>Wed Sep 21, 4:25pm We want to hear fro... Post Reach 471</p>

Most post reactions:

Content ⓘ Sort by: Likes and reactions ▾

 <p>Sat Sep 24, 7:33am Our Climate Change BIG P... Post Likes 76</p>	 <p>Thu Sep 8, 5:16pm Wisconsin *might* not be ... Post Likes 39</p>	 <p>Sun Sep 25, 9:21am LAST CHANCE!! Post Likes 32</p>
 <p>Mon Sep 19, 10:18am COOL THING ALERT... Post Reactions 24</p>	 <p>Thu Sep 15, 12:37pm Voting for Wisconsin Hotel... Post Reactions 19</p>	 <p>Wed Sep 7, 6:22pm Wisconsin *might* not be ... Post Reactions 19</p>

Partner Social Media: Facebook													
Reach	January	February	March	April	May	June	July	August	Sept.	Oct.	Nov.	Dec.	YTD
2020	0	25	1,316	7,197	697	373	597	1,318	619	542	1,887	292	
2021	375	2,052	692	2,792	4,391	3,854	2,470	710	4,645	1,001	2,079	607	14,553
2022	4,307	9,200	3,927	6,491	10,114	3,076	1,820	2,325	3,309				28,380
YOY Growth	1048.53%	348.34%	467.49%	132.49%	130.33%	-20.19%	-26.32%	227.46%	-28.76%				95.01%
2022 Goal (40%)	525	2,873	969	3,909	6,147	5,396	3,458	994	6,503	1,401	2,911	850	20,374
% to Goal	820%	320%	405%	166%	165%	57%	53%	234%	51%	0%	0%	0%	139%
Likes	January	February	March	April	May	June	July	August	September	October	November	December	Year Growth
2020	1,235	1,235	1,235	1,263	1,264	1,262	1,263	1,263	1,265	1,270	1,278	1,275	3%
2021	1,271	1,273	1,316	1,321	1,333	1,350	1,354	1,352	1,420	1,420	1,423	1,433	13%
2022	1,444	1,477	1,687	1,715	1,831	1,861	1,866	1,883	1,888				31%

Partner Social Media: Instagram													
Reach	January	February	March	April	May	June	July	August	Sept	Oct.	Nov.	Dec.	YTD
2020	329	329	329	433	18	27	196	108	290	290	406	366	
2021	499	1,059	456	1,742	1,582	1,758	1,456	1,006	1,013	1,406	1,314	1162	7,090
2022	6,616	8,793	10,144	8,283	5,386	2,225	9,789	6,919	2,863				45,856
YOY Growth	1225.85%	730.31%	2124.56%	375.49%	240.46%	26.56%	572.32%	587.77%	182.63%				546.77%
2022 Goal (100%)	998	2,118	912	3,484	3,164	3,516	2,912	2,012	2,026	2,812	2,628	2,324	14,180
% to Goal	663%	415%	1112%	238%	170%	63%	336%	344%	141%	0%	0%	0%	323%
Followers	January	February	March	April	May	June	July	August	September	October	November	December	Year Growth
2021	-	-	-	-	-	-	-	-	1,021	1,028	1,049	1,052	3%
2022	1,076	1,126	1,179	1,207	1,273	1,303	1,331	1,357	1,361				26%

OPERATIONS

SEPTEMBER PUBLICATION REQUESTS

2022 Visitor Guide Requests: 1,224

2021 Visitor Guide Requests: 848

2022 E-mail Requests Answered: 81

SEPTEMBER GIFT CERTIFICATES

2022 Door County Gift Certificates Sold: \$30,585

2022 Door County Gift Certificates Redeemed: \$47,475

2021 Door County Gift Certificates Sold: \$40,405

2021 Door County Gift Certificates Redeemed: \$42,050

SEPTEMBER VISITOR CENTER DATA

2022 Welcome Center Visitors: 3,898

2021 Welcome Center Visitors: 4,681

2022 Welcome Center Calls: 1,052

2021 Welcome Center Calls: 1,516

JOB SITE STATS - JOBSINDOORCOUNTY.COM

24 Hours | Week | Month | Total | Custom 9/01/2022 - 9/30/2022 | Go

As of: 10/07/2022 1:00pm

Jobs Posted 36	Job Seekers Added 34	Employers Added 5	Alerts Added Job 13 Resume 0	Purchases Billed 0 Paid 0
Job Searches 2,920	Jobs Viewed 4,008	Applications Added 125	Apply Redirects 63	Logins Seeker 269 Employer 138

